

IMPORTANT,

anchors.

REGARDING CONSTRUCTION EITHER ON OR ADJACENT BOUNDARIES ATTENTION IS DRAWN TO BOTH THE REQUIREMENTS OF THE PARTY WALL ACT 1966: AND TO THE NEED FOR PRIOR AGREEMENT WITH ADJOINING OWNERS TO ACCESS ON OR OVER ADJOINING LAND/PROPERTY, FOR EITHER CONSTRUCTION PROCESSES AND/OR MAINTENANCE. IT IS RECOMMENDED THAT PERMISSION IS OBTAINED IN WRITING PRIOR TO WORKS START.

STRIP FOUNDATIONS

Clear site of all vegetable matter, top soil etc., and excavate to dimensions shown, lay strip foundations to width and thickness to suit L.A. requirements in grade C20 concrete containing min. 260kg. O.P.C. per m³. founds. shown are to suit natural ground conditions having a safe increase bearing capacity of 100Kpa/m².
Where founds. 1 linear metre of any drain then found. strip should be excavated to min. invert level of drain in question. Founds. to have min. 900mm cover, and excavations to be to B.S.8000 part 1.

EXTERNAL WALLS

Cavity walls to be constructed as shown with materials stated. Austenetic steel wall ties to be inserted for stability of 450mm min. vertical / 750mm min. horizontal and doubled up at side of openings and 900mm min. arise. ctrs. ties to have min. 50mm embedment in each leaf. Insert vertical D.P.C. round all new door and windows openings. Lay bitumen based (or sim. approved) horizontal D.P.C. in all walls at min. 150mm above ground level.
Cavities to be firestopped at roof level. All walls to be filled with rigid insulation to meet current requirements of 'U' value : 0.35W/m²k

STEEL BEAMS

R.S.J.'s and U.B.'s and catnic lintols to be supported by grade C25 conc. padstones to sizes specified by consulting structural engineer and encase in fireline p.b.d. to manufacturers instructions and skim.
A clear headroom of 2000mm should remain after positioning any steel beam in a habitable room.

VENTILATION

Habitable room ventilation should be provided by one or more ventilation openings with a total area of at least $\frac{1}{20}$ th of the floor area of the room with some part of the ventilation min. 1750mm above floor level. Kitchen & Utility rooms to have rapid mechanical ventilation rated at 60litres/second and maybe operated intermittently. Bathroom rapid mechanical ventilation should be provided with either mechanical extract ventilation rated 15 litres/second which may be operated intermittently. All habitable rooms to have controllable and secure background ventilation openings of 8000mm² min. located so as to avoid undue moisture.

PARTITIONS

Construct partitions in position shown in 100x50mm studs faced both sides in Gyproc wallboarding and skim, insulate between framework using 100mm fibreglass quilt. Studding to be nogged to floor/roof members at 600mm ctrs.

DRAINS

Soil and storm drains to be laid at falls of not less than 1 in 40 and are to be encased in grade C25 concrete in the event of passing beneath building. Where any drain passes through a load bearing wall, lay 150mm deep x wall thickness R.C. lintol over and pack out with polystyrene off-cuts.
40mm diameter waste pipes from sinks, washdown room and any other room as required. 32mm diameter from basins and 100mm from W.C.s. All traps to be 75mm deep seal. Any waste exceeding 1.7m in length to have anti-syphonic traps. Any waste exceeding 2.3m in length to be 50mm diameter. All waste pipework to BS 8000.

ELECTRICAL SAFETY

The amount of light fitting/sockets/switches etc. is to be agreed between the client and the contractor before work commences on site. All wiring and electrical work will be designed, installed, inspected and tested in accordance with the requirements of BS:7671-2008, the IEE 17th edition wiring guidance and building regulation part P (Electrical safety) by a competent person registered with a electrical self certification body authorised by the secretary of state. The competent person is to send the local authority a self-certification certificate within 30days of completion of the electrical works. The client is to be provided with a copy of the self-certification certificate and a BS:7671 electrical installation test certificate.

LIGHTING EFFICIENCY

At least $\frac{1}{4}$ th of all new light fittings which are to be installed will be capable of taking lamps having a luminous efficiency greater than 40 lumens per curcuit watt e.g. Fluorescent and compact fluorescent lighting fittings meet this requirement. All external lighting to have lamps that do not exceed 150 watts and switch off when there is enough daylight and when not required at night.

MASONRY

Class B Engineering brickwork to be set in 1:1:4 mortar. 20N concrete common brickwork and 7N concrete brickwork to be set in 1:1:4 mortar. 2.8N blockwork to be set in 1:1:6 mortar. Movement joints to be incorporated at max. distances as recommended by material/product supplier.

GLAZING

Any glazed window area between floor level and 800mm above that level and any glazed area between floor level and 1500mm above that level in a door and any glazed area within 300mm of door casing must be fitted with toughened safety glass to suit table in paragraph 4 section 1. document "N" of 1991 Building Regulations. External Glazing to be 24mm gap double glazing argon filled (low E) Pilkington Kappafloat or similar. U value 1.7W/m²K.

CONCRETE

All concrete to be ready mixed. Designed Mixes to B.S. 5328, obtained from depot accredited by Quality Scheme for Ready Mix Concrete. All workmanship to comply with B.S. 8110 Part 1 Section 6.

GRADE C20

For strip footings, padstones, unreinforced bases and unreinforced concrete. Min. cementitious content 220 kg/m³.

GRADE C35

For floor slabs and reinforced concrete. Min. cementitious content, 300 kg/m³.

ALL CONCRETE GRADES

Nominal max. aggregate size 20mm workability 60mm slump.

REINFORCEMENT

Mesh to B.S. 4483, bars to B.S. 4449, bent and cut to B.S. 8666: 2000. Mesh laps 350mm.

COVER

75 to trimmed earth faces, 40 to shuttered faces and to u/s floor slab, 50 to top faces, U.D.O.

WALL INSULATION TO WALLS SHOULD BE SUITABLE RIGID FOAM 50mm THICK OR BE PROVIDED BY OTHER MEANS TO COMPLY WITH A "U" VALUE OF 0.35W/m².
ROOF INSULATION SHOULD BE CONFIRMED AS BEING POSITIONED BETWEEN AND OVER THE CEILING JOISTS, 125MM IN-BETWEEN AND 15MM @ 90° ABOVE.
PROVISION MUST BE MADE FOR LIMITING AIR LEAKAGE FROM THE BUILDING, BY LINKING OF INSULATION ELEMENTS AT THEIR JOINTS AND THE GENERAL SEALING OF CONSTRUCTION JOINTS AND SERVICE PIPES WHERE THEY PASS THROUGH THE STRUCTURE.

WINDOWS DOUBLE GLAZED UNITS TO HAVE MIN. 16mm AIR GAP AND TO HAVE A LOW "U" COATING.

THE CONTRACTOR IS TO IDENTIFY THE EXACT LOCATION OF ALL UNDERGROUND SERVICES AND DRAINS.

THE CONTRACTOR SHALL PROVIDE ANY TEMPORARY PROPPING, NEEDLE BEAMS, PLANKING OR STRUTTING ETC. NECESSARY TO MAINTAIN THE STABILITY OF THE EXISTING STRUCTURE AND ADJOINING STRUCTURES AND OF THE EXCAVATIONS DURING THE COURSE OF THE WORKS.


THE GUIDANCE IN "BUILDING RESEARCH ESTABLISHMENT GOOD BUILDING GUIDES Nos. 15 & 20 - "PROVIDING TEMPORARY SUPPORT DURING WORK ON OPENINGS IN EXTERNAL WALLS" and "REMOVING INTERNAL LOAD-BEARING WALLS IN OLDER DWELLINGS"

DWG NO 3


Rev.	Description/Amount	Date



08-06-08

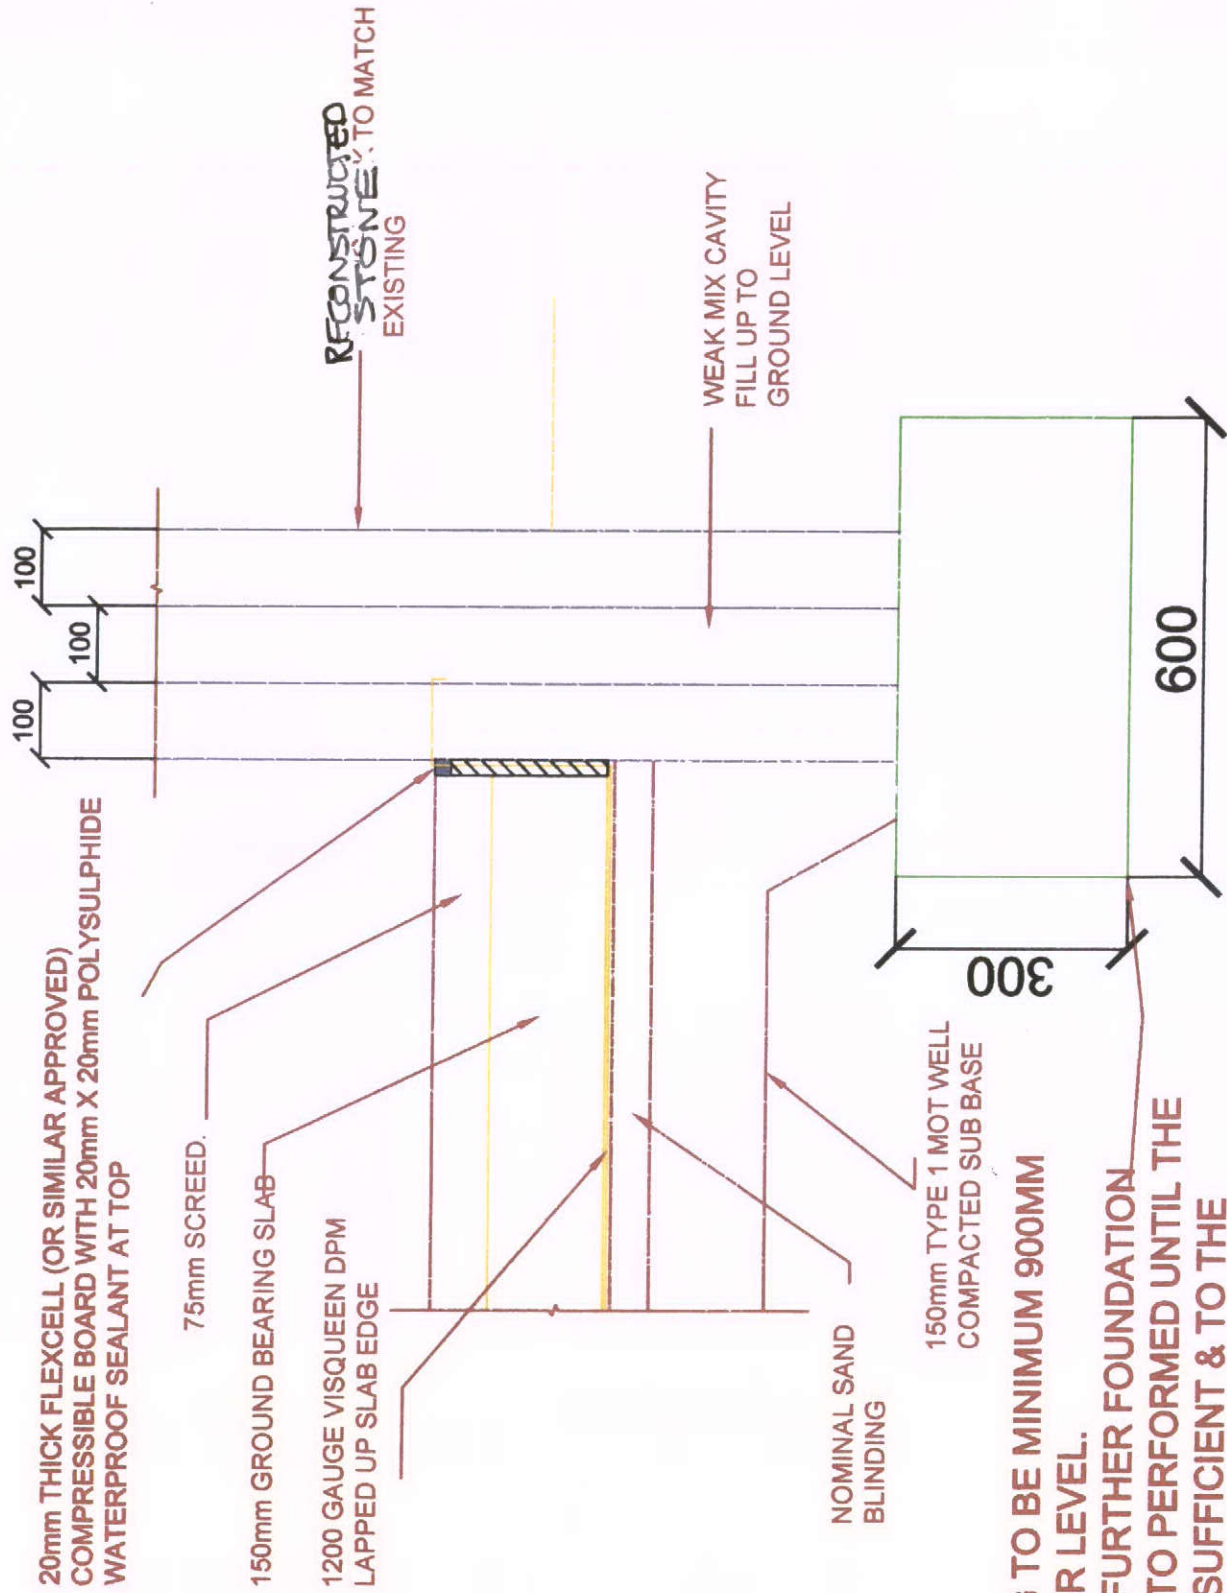


BOTTOM OF FOOTING TO BE MINIMUM 900MM FROM GROUND FLOOR LEVEL.
 LABC MAY REQUEST FURTHER FOUNDATION EXCAVATION THIS IS TO PERFORMED UNTIL THE GROUND IS DEEMED SUFFICIENT & TO THE SATISFACTION OF LABC AND REGULATION A1/A2.

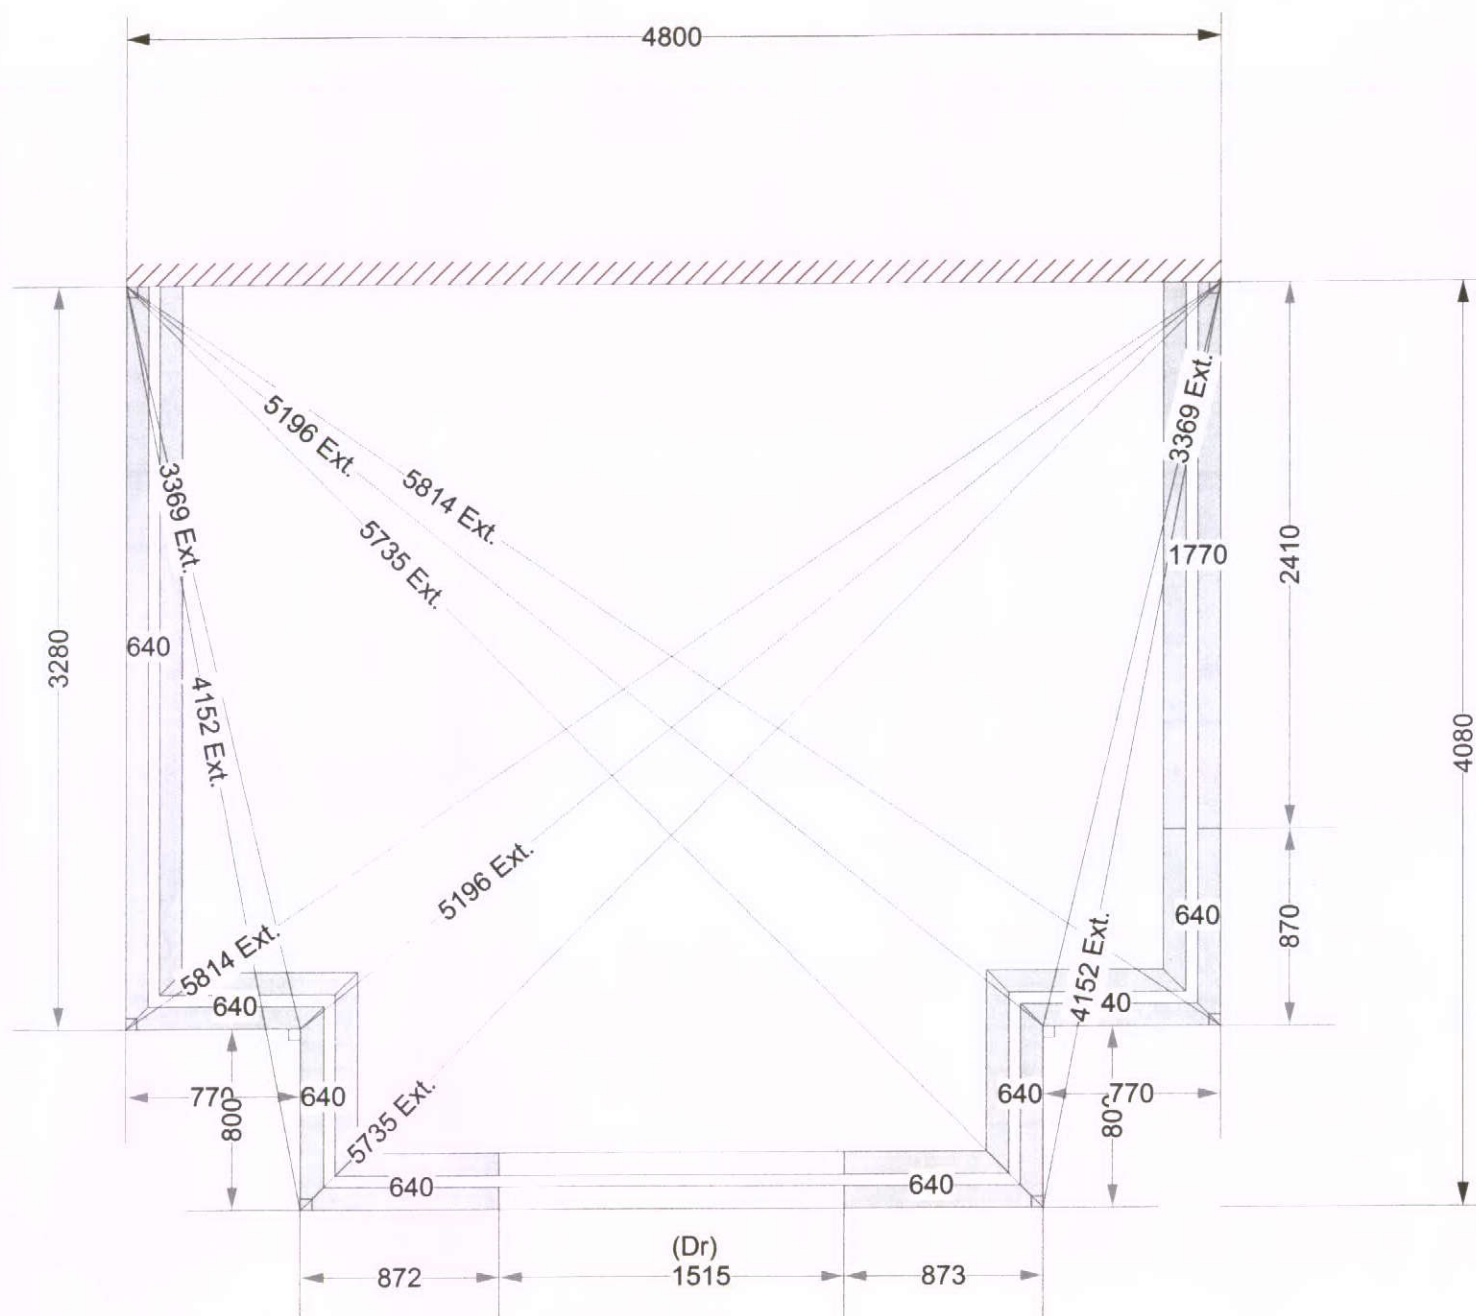


Span:	4600 mm
Order Number:	187
Projection:	3980 mm
Customer:	
Pitch:	25.0°, 0.0°, 22.7°, 0.0°, 23.5°, 0.0°
Reference:	
External Heights:	3168, 3168, 3168
Delivery Date:	28/08/2010
Base Heights:	2970, 2970, 2970
Price Ex Tax:	£0.00
Floor Area:	15.24m ²
Price Inc Tax :	£0.00
Wall Area:	10.05m ²
Drawn By:	Phillip Mellish
Volume:	41.51m ³
Roof Colour:	White
Dataset:	Aluminium 6.108
Glazing Material:	Pittington Active Cable Blue
Cresting:	Diamond Spike
Window Colour:	White

Guttering:	White
Cill Colour:	White
Sheet Area:	18.57m ²
Glazed:	True
Bar Type:	Standard
Hip Type:	Standard
RingBeam Type:	Standard
Bar Material:	Aluminium\PVCu
Frame Profile:	Default 70mm
Options:	
Dwarf Wall Height:	640 mm
Notes:	
Cill Type:	50mm Cill
Int. Window Colour:	White
Ext. Window Colour:	White
Roof System:	Aluminium 6.108
Software Version:	6.9.0.204
Int. Roof Colour:	White
Ext. Roof Colour:	White


White
35mm ATHLETIC BWE/OPAL POLYCARBONATE.

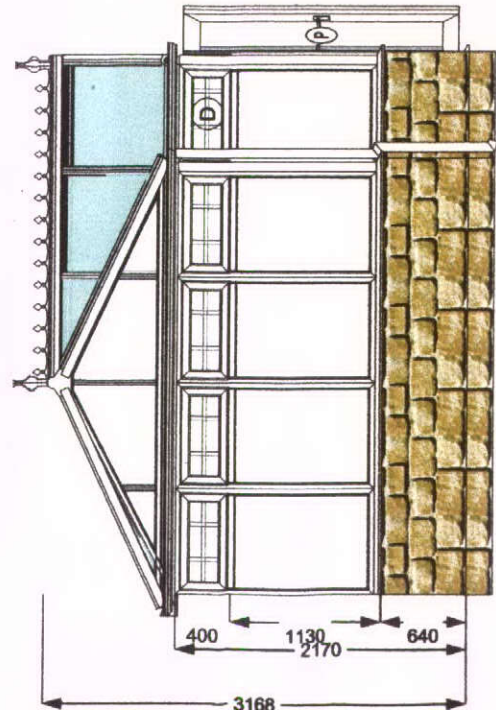



(W1) 795 (W2) 795 (W3) 795 (W4) 795 (W6) 730
3980

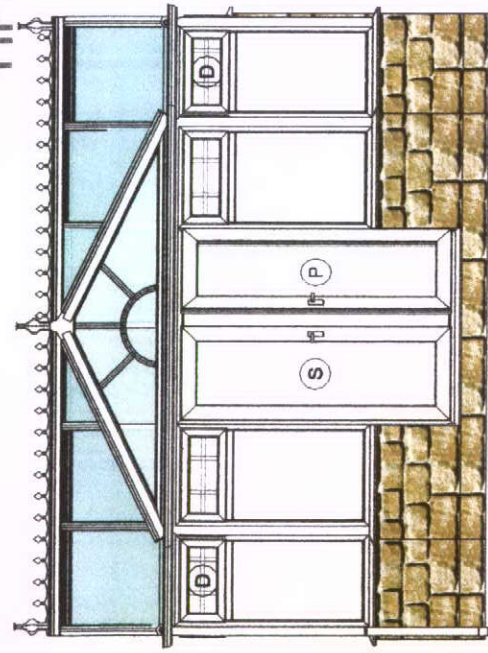

(W5) 700 (W7) 777 (W8) 1505 (W9) 778 (W11) 700
4800

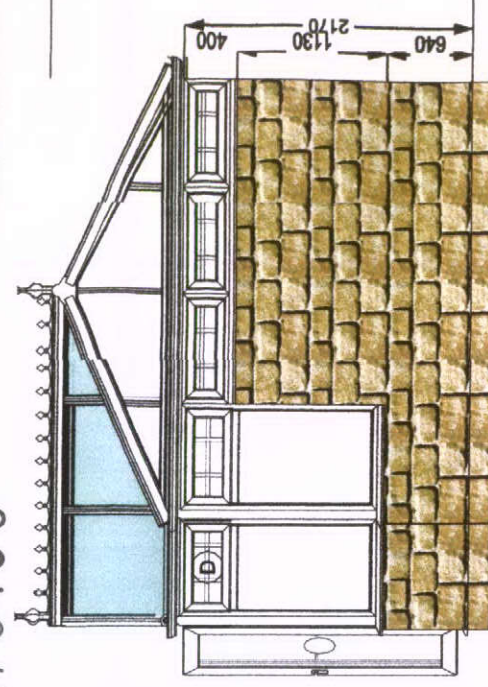

(W10) 730 (W12) 770 (W13) 804 (W14) 803 (W15) 803
3980

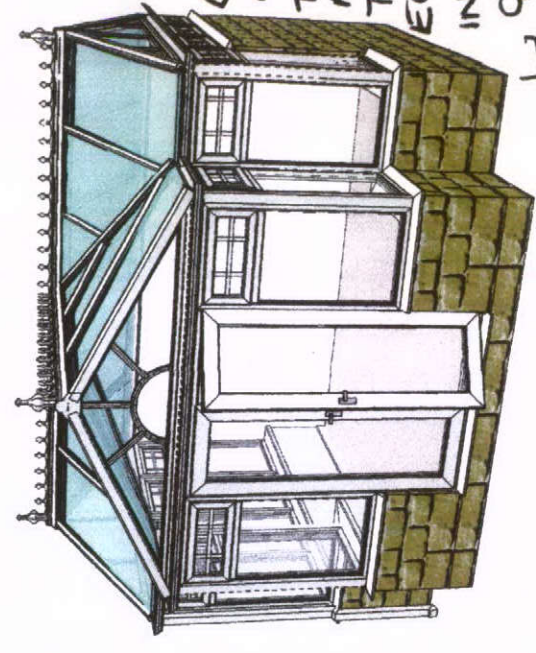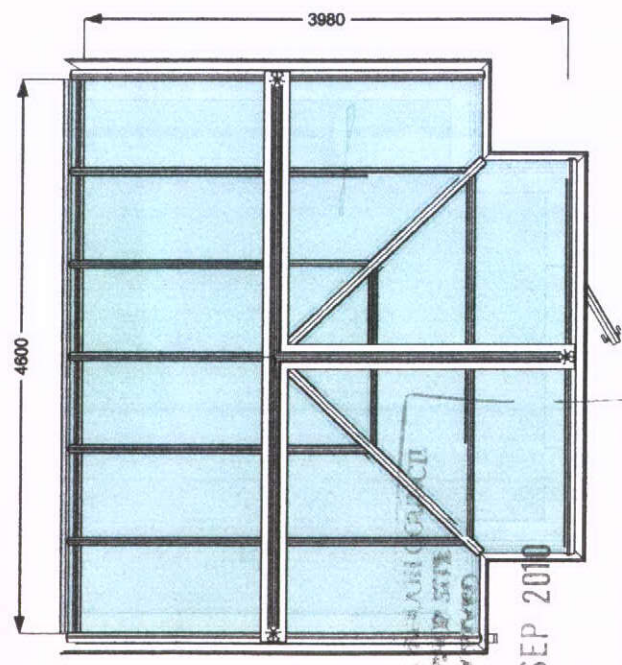

DWG
NO 1

20 SEP 2010

PLEASE
REPLY BY 10/10/10