MATERIAL SPEC	SYSTEM DF
INNER 316 STAINLESS STEEL	
OUTER 304 STAINLESS STEEL	
25MM THICK INSULATION	
ALL SEAM WELDED C/W	
O-RING SEALS ON JOINTS	

JOB No

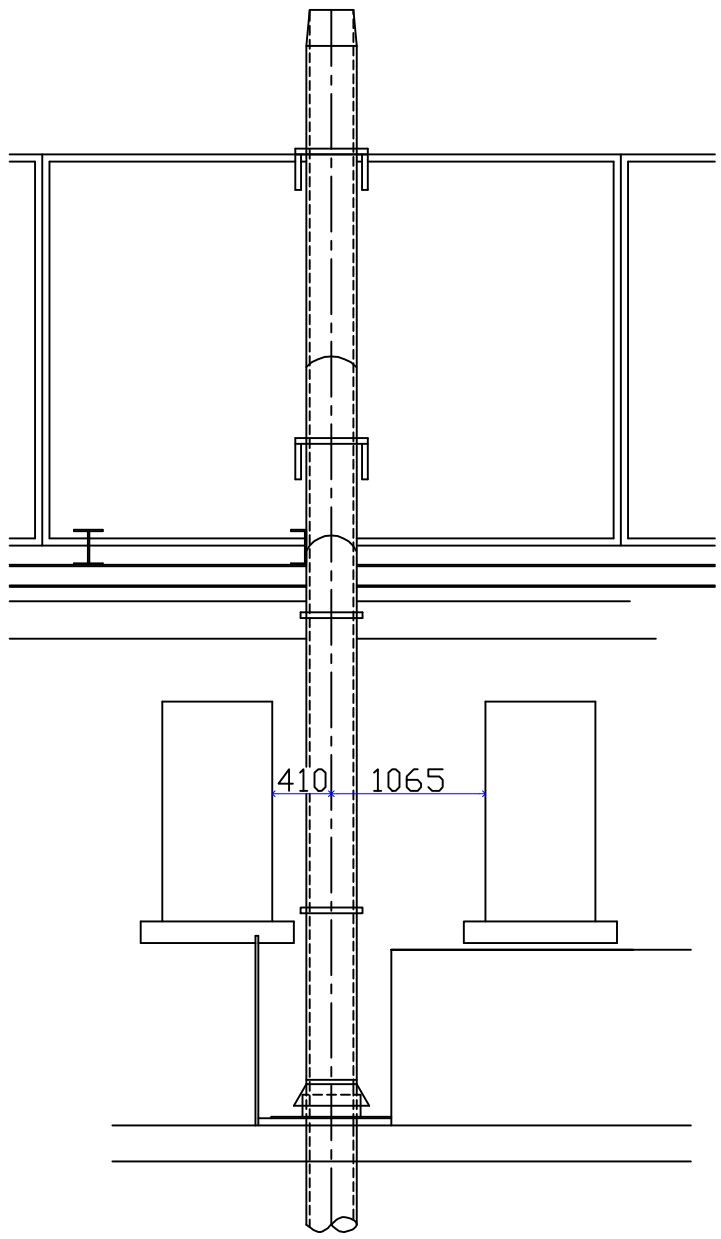

VIEW ON FRONT

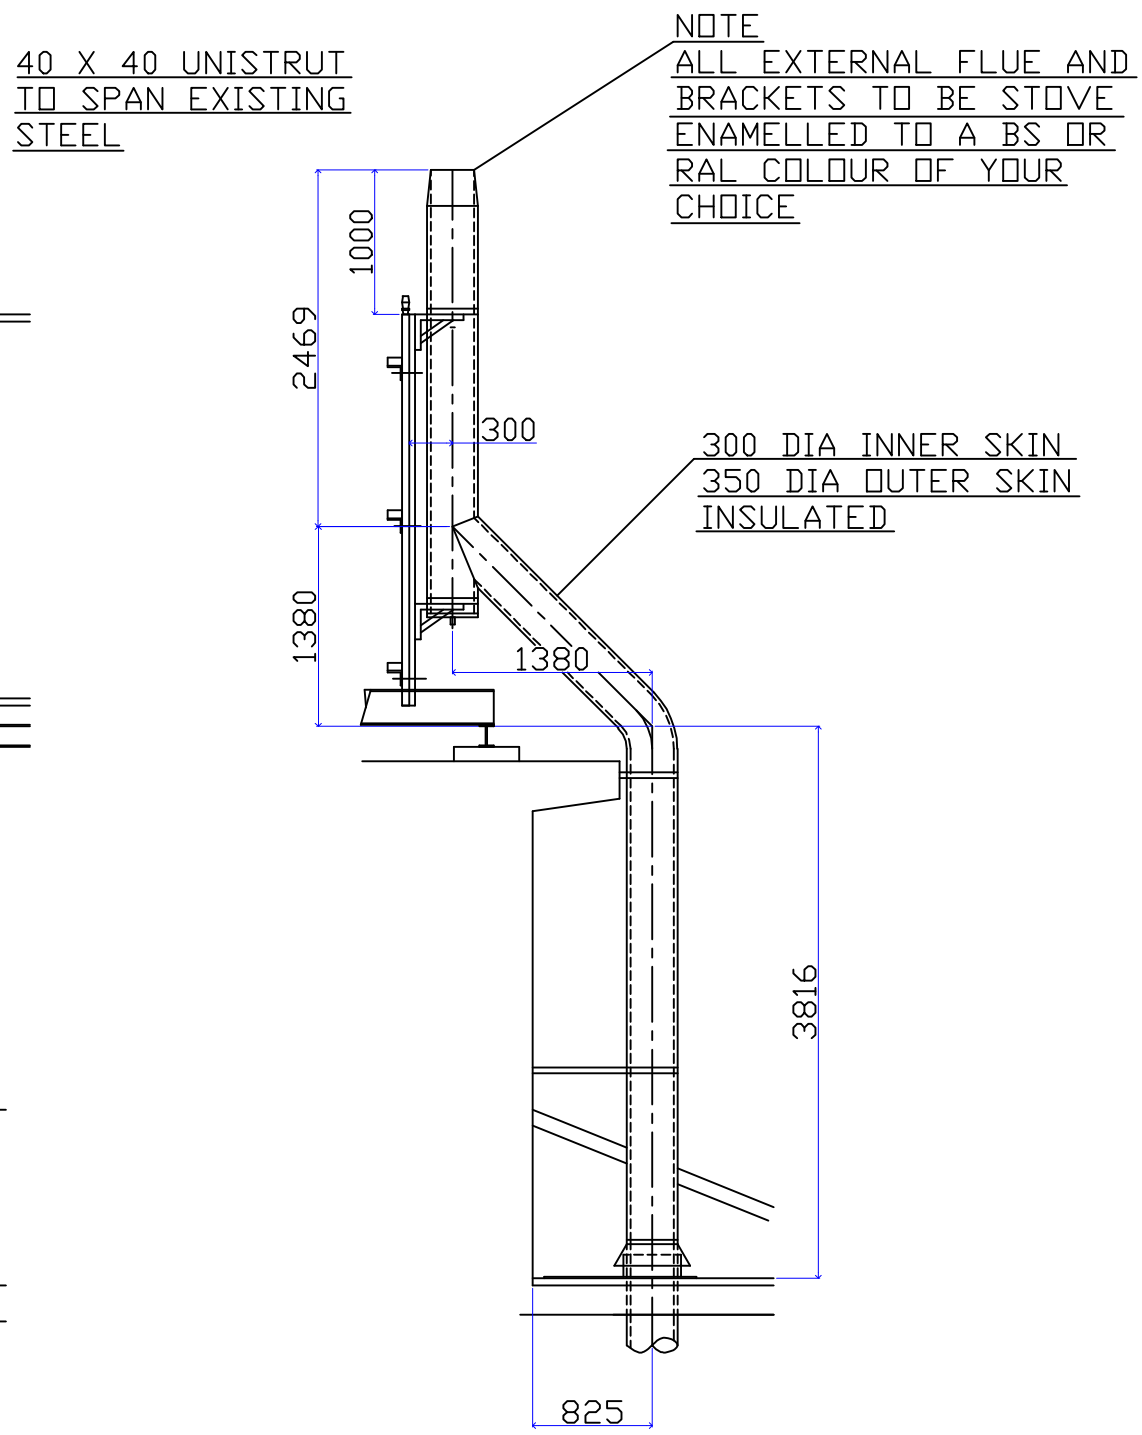

ELEVATION

SHEET 2 OF 2 PROPOSED FLUE SYSTEM

SIGRAM FLUES WILL NOT CARRY OUT ANY BUILDERSWORK / ELECTRICAL WORK OR PROVIDE SCAFFOLDING WITHOUT PRIOR AGREEMENT IN WRITING. BRACKET POSITIONS / SPACINGS SHOWN MAY BE ALTERED TO SUIT SITE CONDITIONS. IT IS IMPERATIVE THAT ANY NEW SERVICES / OBSTRUCTIONS ARE KEPT CLEAR FROM THE FLUE ROUTE SHOWN.

REV	MODIFICATIONS	BY	DATE	CHK'D	DATE

CLIENT DERBYSHIRE COUNTY COUNCIL	DATE 31/08/2010	SCALE 1:50	DRG No 20790a
PROJECT GLOSSOP SWIMMING POOL	DRAWN D.G.W.	Sigram Flue Systems Limited 01613201999	