
ATTIC PLAN & REAR ELEVATION AS PROPOSED 1:50

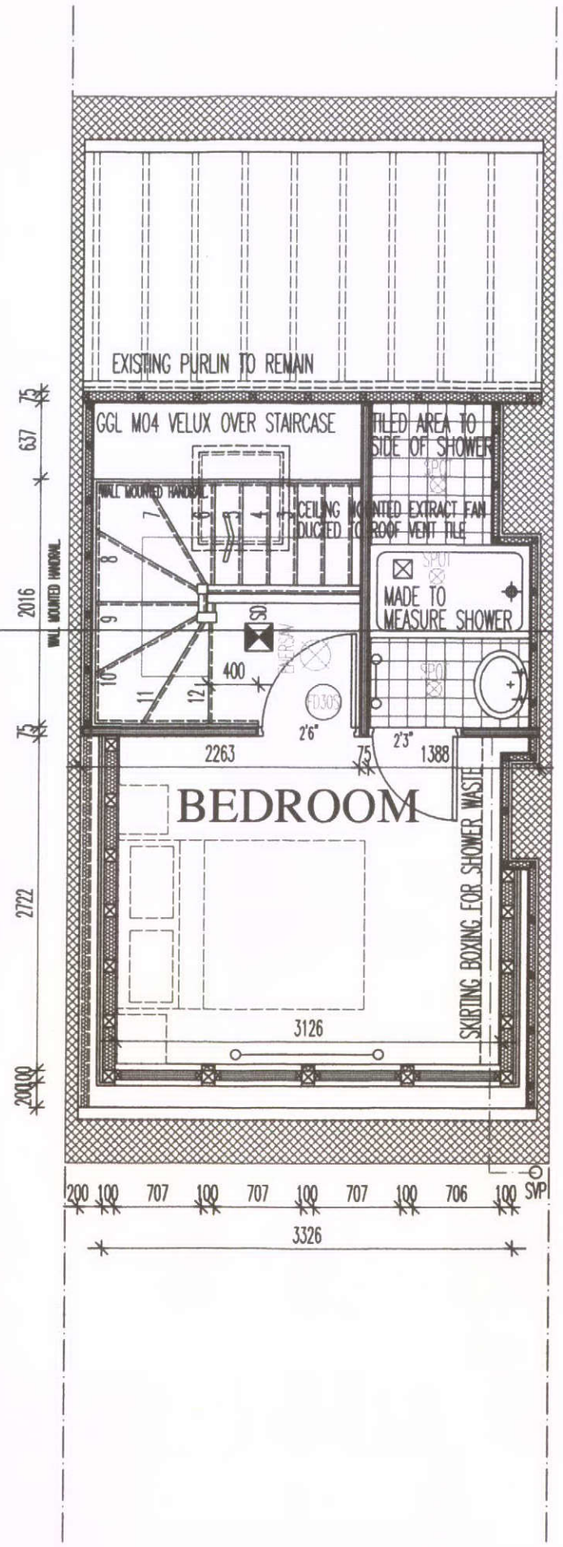


PROPOSAL RELATES TO THE CONVERSION OF THE EXISTING ATTIC TO FORM A DOUBLE BEDROOM WITH EN-SUITE:

NEW 200x50 C24 (450ctrs) GRADE FLOOR JOISTS ARE TO BE PUT IN AT A HEIGHT OF 2215mm ABOVE THE EXISTING FIRST FLOOR - JOISTS ARE TO BE BUILT INTO THE EXISTING WALL AND SEALED AGAINST AIR LEAKAGE AND WRAPPED IN DPM AND HUNG FROM DOUBLE TRIMMERS TO STAIRCASE. ALLOW FOR MID SPAN NOGGINS AND UNDER STUDWORK. JOIST TO BE STRAPPED TO PARTY WALLS OVER THE LAST THREE JOISTS. FLOOR VOID TO BE INSULATED WITH ISOWOOL QUILT AND UNDERDRAWN WITH 15mm FIRELINE BOARD AND SKIM. TAPE AND SEAL ALL JOINTS. FLOOR TO BE FINISHED WITH 22mm T&G CHIPBOARD TO ALLOW FOR FINISH TO CLIENTS REQUIREMENTS.

EXISTING RAFTERS ARE TO BE RETAINED WHILST NEW 150x50 RAFTERS ARE PUT IN PLACE SIDE BY SIDE. ALL NEW TIMBER TO BE C24 GRADE STRUCTURAL. THIS WILL ALLOW FOR THE REPOSITIONING OF THE PURLINS AS SHOWN WITH NEW PURLINS TO BE 250x100 C24 GRADE. ALLOW FOR DOUBLE GIRDER RAFTERS TO ALLOW FOR THE STRUCTURAL SUPPORT OF THE FRAME TO THE DORMER SIDES.
RAFTERS ARE TO BE INSULATED WITH 100mm CELOTEX TO ALLOW FOR 50mm AIR GAP AND THEN UNDERDRAWN WITH 40mm CELOTEX AND PBD AND SKIM. ALLOW FOR CONTINUOUS SOFFIT AND RIDGE VENTILATION (8000mm/2).

DORMER FRAME TO BE 100x50 SW AT 450ctr FRAME TO SIDES WITH 150x100 CEILING JOIST TRIMMER TO FRONT, WITH 150x50 C24 CEILING JOISTS AT 400ctrs WITH FIRRING PIECES OVER TO ALLOW FOR FALL. DORMER SIDES ARE TO BE FULLY INSULATED WITH 100mm CELOTEX AND OVERBOARDED WITH 40mm, FINISH WITH FIRELINEBOARD AS REQUIRED. DORMER CHEEKS ARE TO BE TREATED WITH QUELFIRE FINISH FOR SURFACE SPREAD OF FLAME, FRAME IS TO BE RACKED WITH EXTERNAL GRADE PLYBOARD AND 6mm SUPERLUX FOR FIRE RESISTANCE, AND 2000g DPM AND THEN BATTENED OUT WITH 25mm BATTENS TO TAKE VERTICAL SLATE HANGING TO MATCH THE EXISTING ROOF COVERINGS. WHITE PLASTIC SHIPLAP FINISH TO REAR ROOF OVER IS TO BE FINISHED AS A WARM ROOF CONSTRUCTION WITH 130mm CELOTEX EXTRA-R XR4000 INSULATION AND DPM AND 3 FELT MAKE UP TO FINISH - THIS MUST ALLOW FOR A CLASS 'AA' RATING

WASTE FROM THE SHOWER ROOM IS TO RUN WITHIN A SKIRTING BOXING TO THE EXISTING EXTERNAL SVP. (LAID TO FALL IN ACCORDANCE WITH BUILDING REGS). THE SVP IS TO BE ALTERED TO DISCHARGE 900mm ABOVE OPENABLE WINDOWS IF REQUIRED (- THE NEAREST OPENABLE WINDOW CAN HOWEVER BE A DISTANCE AWAY THAT WILL PROBABLY NOT REQUIRE THIS). ALL WASTE PIPES MUST BE MIN 50mm WITH 75mm SEALED TRAPS

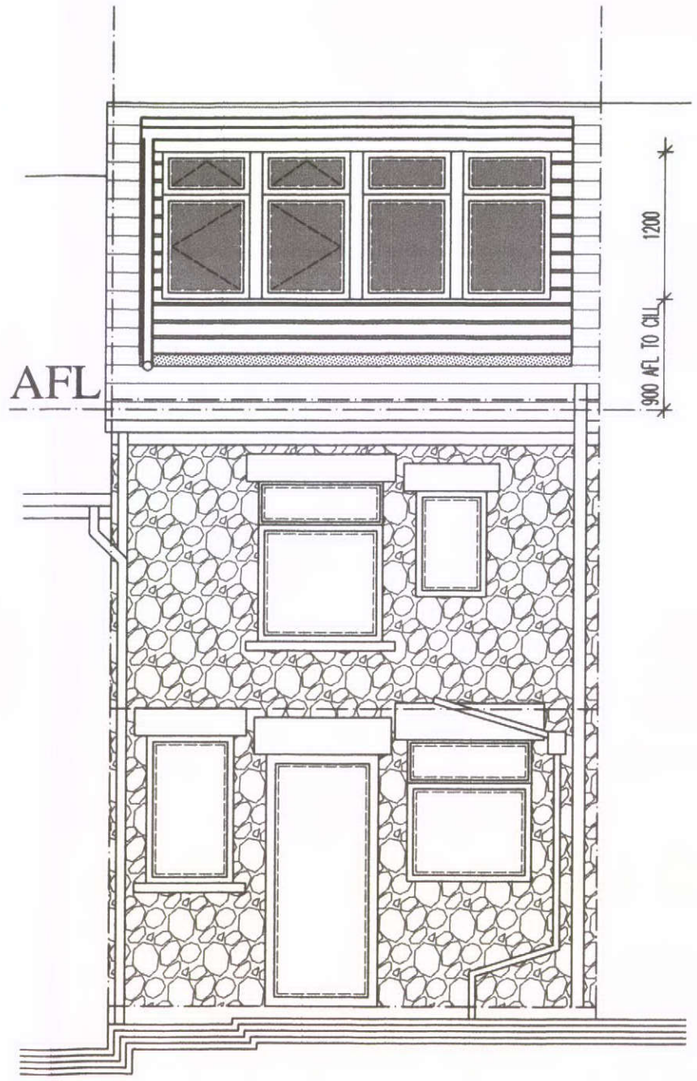

HPK/2011/0058

HIGH PEAK BOROUGH COUNCIL
GIS INPUT STEP
RECEIVED
20 FEB 20
FILE REF
REPLY REQUIRED

124 MACCLESFIELD OLD ROAD

DWG: PROPOSED
124 MACCLESFIELD OLD ROAD
BUXTON

REVISIONS:

1:50	CHECKED:
DATE: OCT 2010	DRAWN:

©THIS DRAWING AND THE BUILDING WORKS DEPICTED ARE THE COPYRIGHT OF AJS ARCHITECTURE AND MAY NOT BE REPRODUCED OR AMENDED EXCEPT BY WRITTEN PERMISSION. NO LIABILITY WILL BE ACCEPTED FOR AMENDMENTS MADE BY OTHER PERSONS. - DO NOT SCALE OFF DRAWING, CONFIRM ALL DIMS ON SITE

A.J.S ARCHITECTURE
32 carr road.
buxton.
derbyshire.
sk17 6wf.
h: 01298 26062
m: 07794 400237



PROPOSED 03

124 MACC OLD RD