
SHOP (appl)


HPK/2012/0566

29 AUG 2012

KEY TO PLAN SYMBOLS AND ABBREVIATIONS

Fire extinguisher Water type Class 'A' fires	B Fire blanket	(DS) Automatic fire detector – smoke	N1 General fire notice	S Smoke seal/intumescent strip	HRL Handrail	Fire resisting door Fire resistance 30 minutes or as indicated
Fire extinguisher Carbon dioxide type Electrical fires	Fire alarm sounder	Fire alarm call point	IP Fire alarm indicator panel	FRG Fire resisting glazing	Stairs: arrow to indicate up direction only	
Fire extinguisher Foam type Class 'B' fires	(DH) Automatic fire detector – heat	Area covered by escape lighting	SC Self-closing device	GRL Guardrail, balustrade or wall	Fire resisting construction Fire resistance 30 minutes or as indicated	

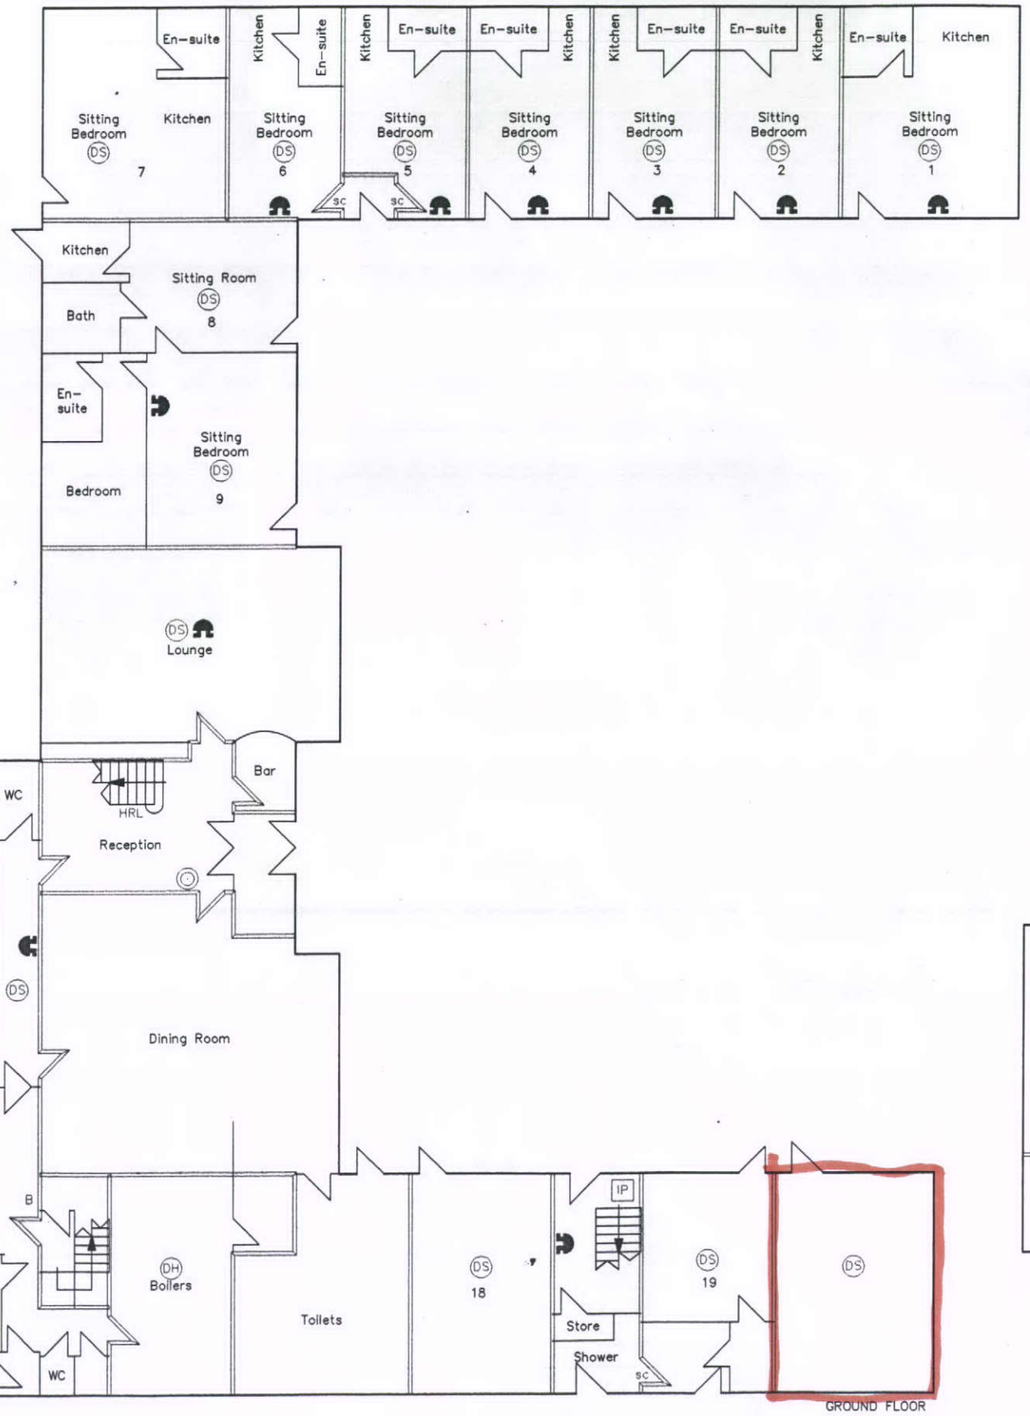

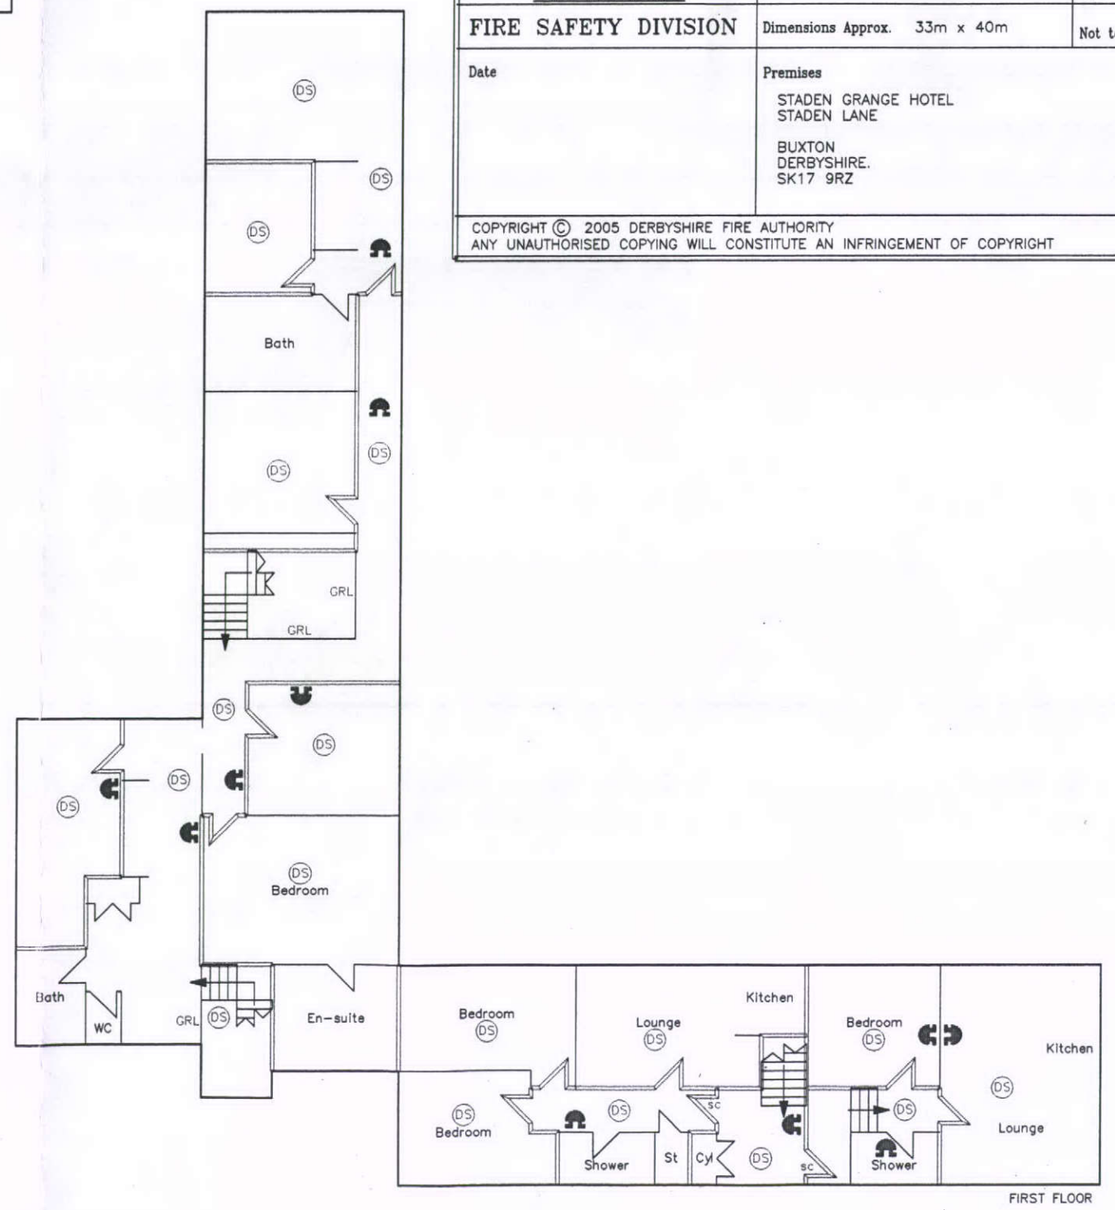

DERBYSHIRE FIRE AUTHORITY

FIRE SAFETY DIVISION

	File No. BUX13231	Plan No. 1/1
	Date Drawn 02.04.2008	LS Ref.
	By PB	Symbols Metric
	Dimensions Approx. 33m x 40m	Not to scale
Date	Premises STADEN GRANGE HOTEL STADEN LANE BUXTON DERBYSHIRE. SK17 9RZ	

COPYRIGHT © 2005 DERBYSHIRE FIRE AUTHORITY
ANY UNAUTHORISED COPYING WILL CONSTITUTE AN INFRINGEMENT OF COPYRIGHT