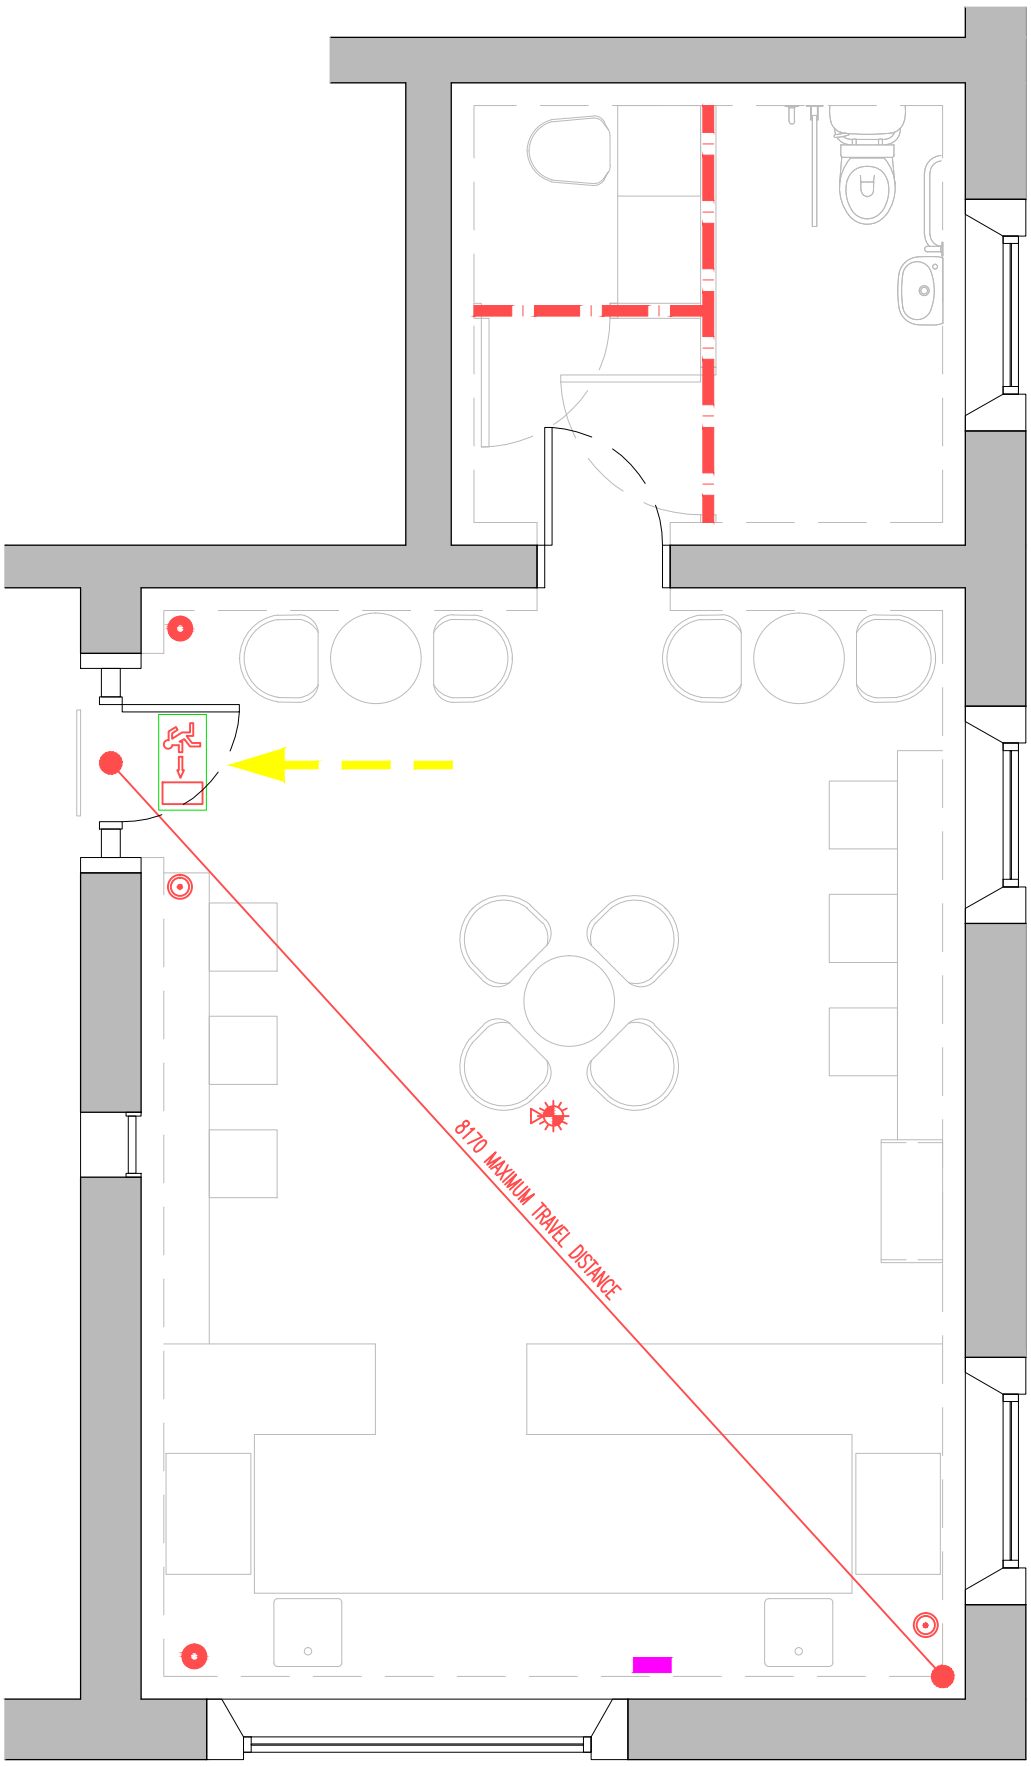


FIRE SAFETY NOTES

EMERGENCY SIGNAGE WILL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH BS5499.

PORTABLE FIRE EXTINGUISHERS WILL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH BS5306.

TOTAL FLOOR AREA = 45SQM
MAXIMUM OCCUPANCY = LESS THAN 60 (45 BASED ON FLOOR AREA)

- 60 MINUTES FIRE RESISTANCE
- ROUTE OF ESCAPE
- ILLUMINATED EMERGENCY EXIT SIGN
- MANUAL CALL POINT
- OPTICAL SMOKE DETECTOR/SOUNDER/VOICE EVAC/BEACON
- FIRE BLANKET
- FIRE EXTINGUISHER

TWIG COFFEE HOUSE GLOSSOP

FIRE STRATEGY PLAN

Drn By: PAE | Date: NOV 2013
Drg No: AUP025 L(00)02 | 1:50@A3