


PROPOSED SECTION A-A' 1:20

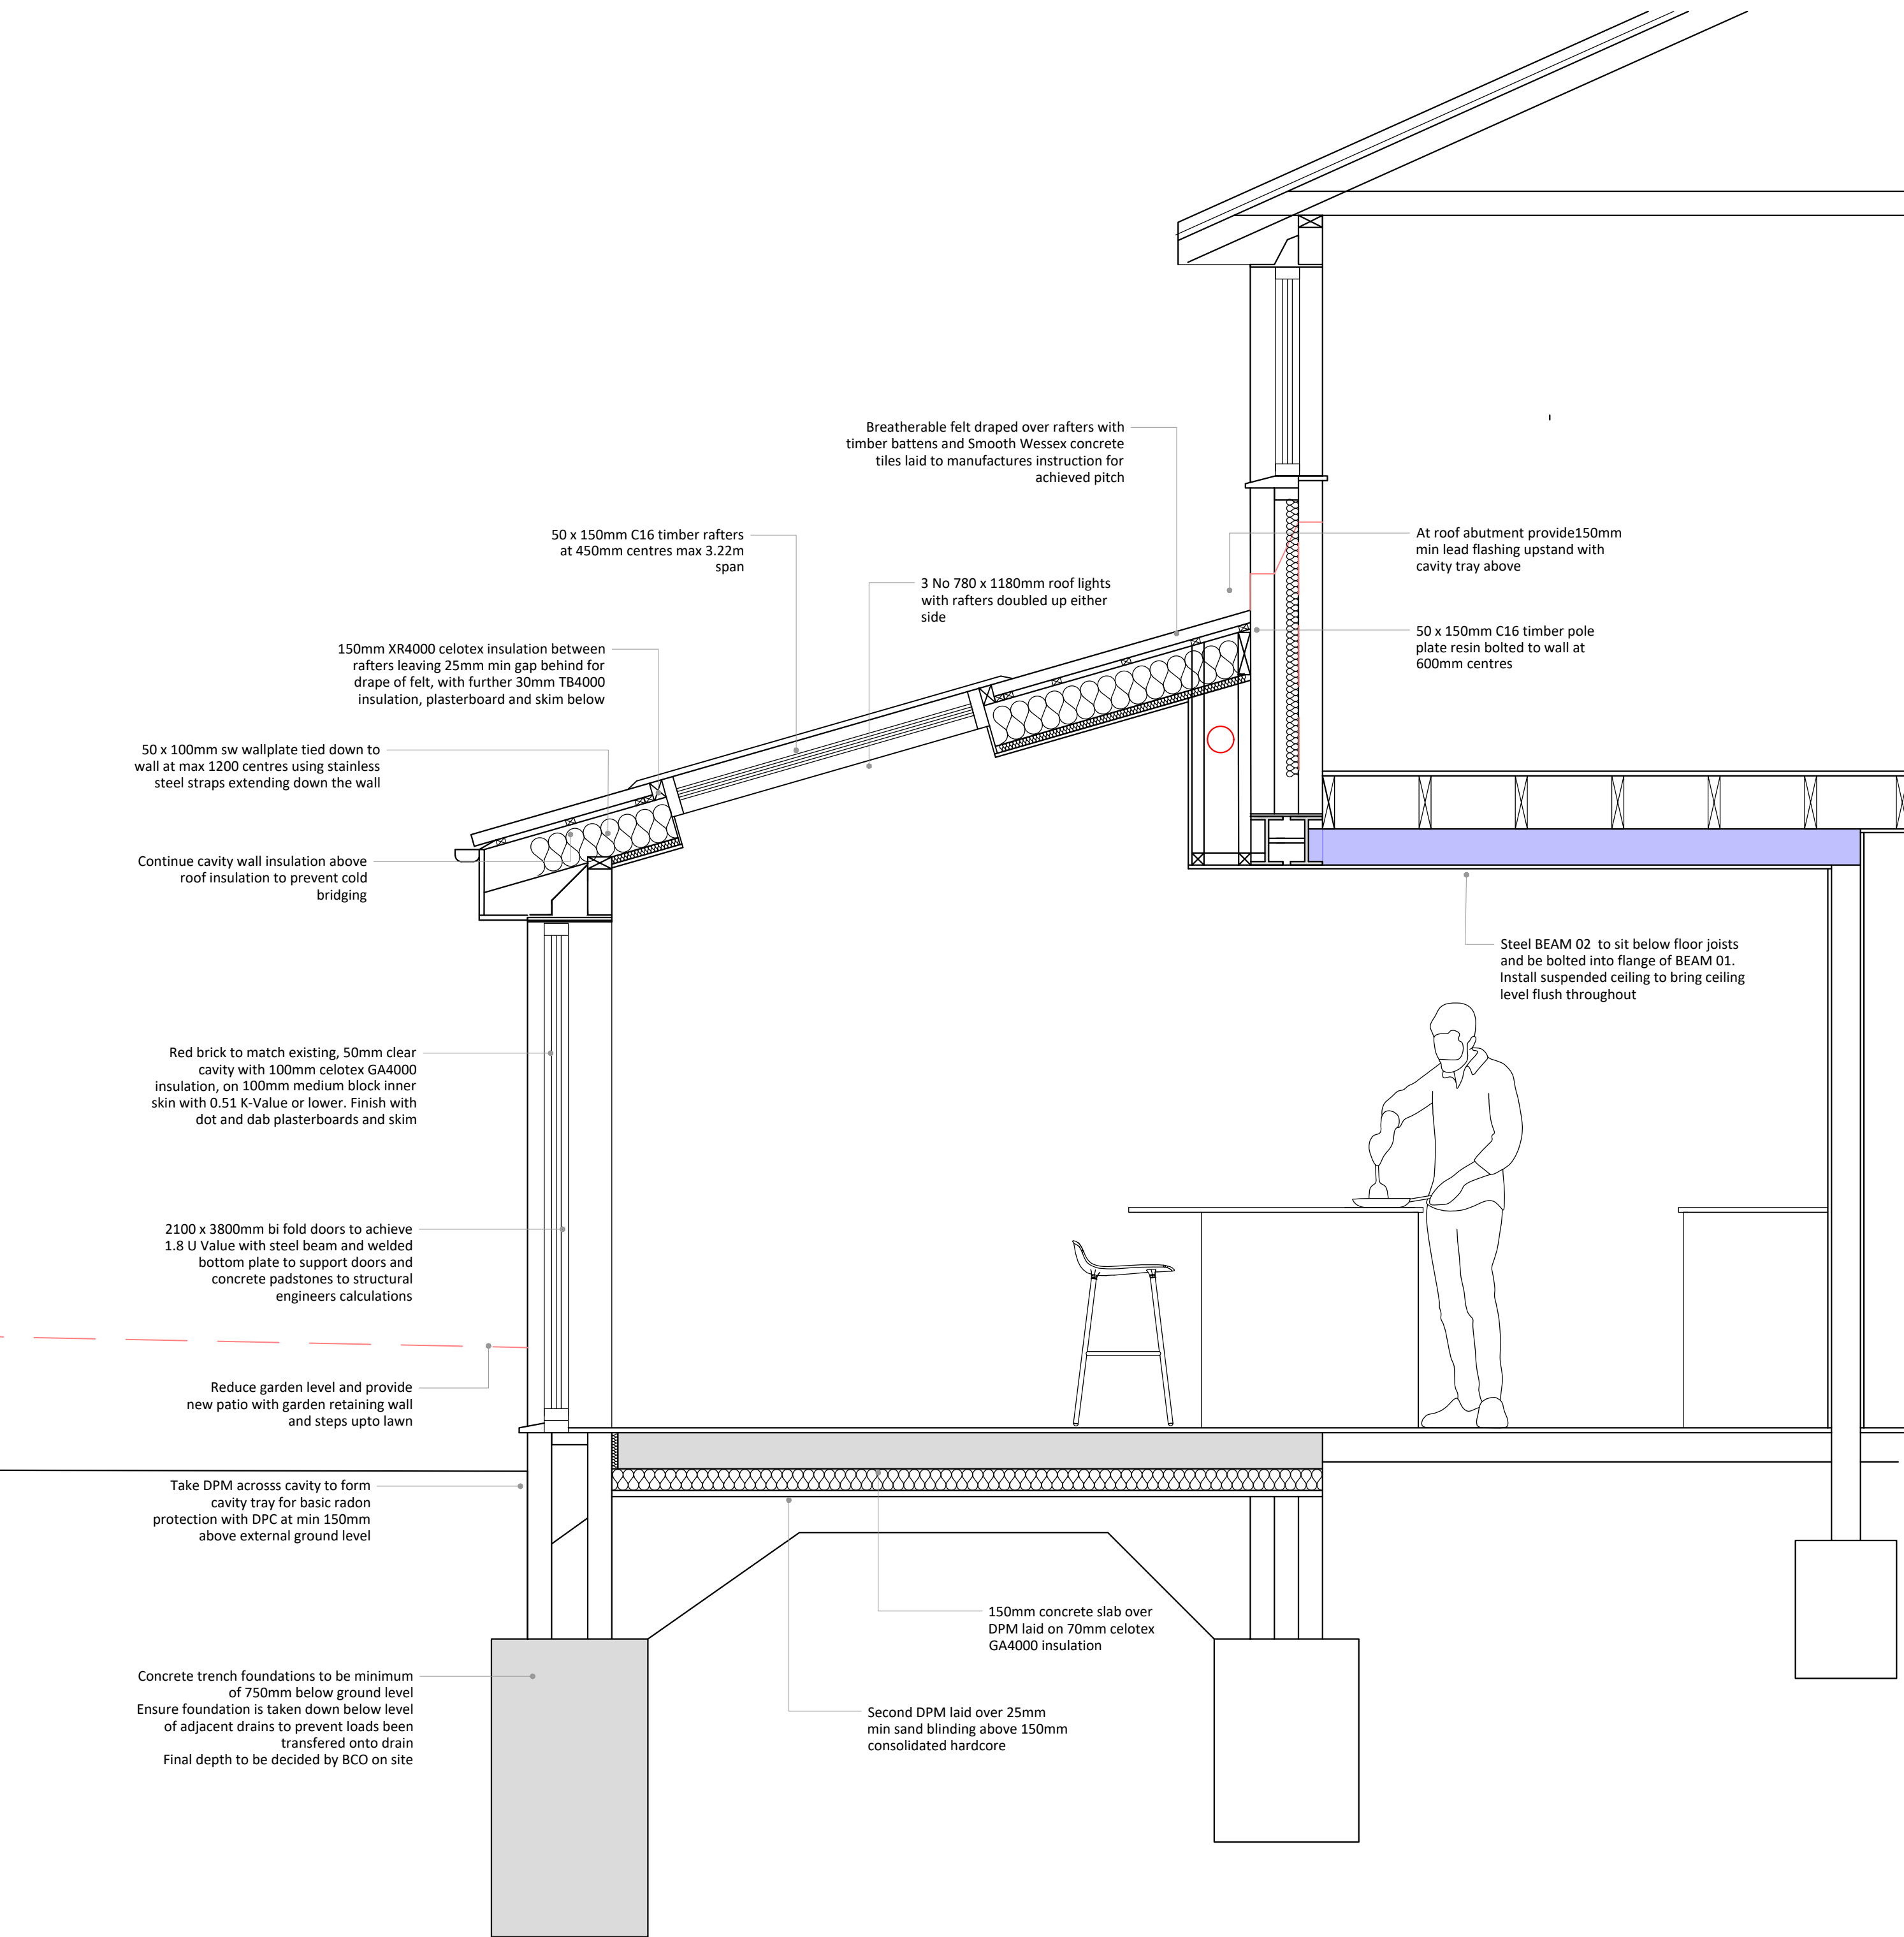

UNVENTED PITCHED ROOF

Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)

To achieve U-value 0.15 W/m²K

Timber roof structures to be designed by an Engineer in accordance with NHBC Technical Requirement R5 Structural Design. Calculations to be based on BS EN 1995-1-1. Roofing tiles to match existing on 25 x 38mm tanalised sw treated battens on minimum 25mm thick treated vertical counter battens with a proprietary eaves carrier system on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 150mm grade C24 rafters at max 400mm centres max span 3.47m. Rafters supported on 100 x 50mm sw wall plates. Insulation to be 150mm Celotex XR4000 between rafters and 30mm TB4000 under. Fix 12.5mm foil backed plasterboard (joints staggered) to the underside of all ceilings using galvanized plasterboard nails. Finish with 5mm skim coat of finishing plaster.

Restraint strapping - Ceiling joists tied to rafters (if raised collar roof consult structural engineer). 100mm x 50mm wall plate strapped down to walls. Ceiling joists and rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1000 x 30 x 5mm galvanized straps or other approved to BSEN 845-1 at 2m centres.

LEAD WORK AND FLASHINGS

All lead flashings, any valleys or soakers to be Code 5 lead and laid according to Lead Development Association. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc. All work to be undertaken in accordance with the Lead Development Association recommendations.

LEAD VALLEYS

Lead-lined valleys to be formed using Code 5 lead sheet. Valley lead and two tiling fillets to be supported on min 19mm thick and 225mm wide marine ply valley boards on either side of the rafters. Lead to be laid in lengths not exceeding 1.5m with min 150mm lap joints and be dressed 200mm under the tiles.

Roofing tiles to be bedded in mortar placed on a tile slip to prevent direct contact. Valley to have a minimum 100mm wide channel (125mm minimum for pitches below 30°).

All work to be in accordance with the roof cladding manufacturers and the Lead Development Association recommendations.

INTERNAL STUD PARTITIONS

100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (eg. 100mm Rockwool or Isowool mineral fibre sound insulation) in all voids the full depth of the stud. Partitions built off doubled up joists where partitions run parallel or provide noggins where at right angles, or built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plaster board with skim plaster finish. Taped and jointed complete with beads and stops.

ELECTRICAL

All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

HEATING

Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.

SMOKE DETECTION

Mains operated linked smoke alarm detection system to BS EN 14604 and BS 5839-6:2019 to at least a Grade D category LD3 standard and to be mains powered with battery back up. Smoke alarms should be sited so that there is a smoke alarm in the circulation space on all levels/ storeys and within 7.5m of the door to every habitable room. If ceiling mounted they should be 300mm from the walls and light fittings. Where the kitchen area is not separated from the stairway or circulation space by a door, there should be an interlinked heat detector in the kitchen.

ESCAPE WINDOWS

Provide emergency egress windows to any newly created first floor habitable rooms and ground floor inner rooms. Windows to have an unobstructed openable area that complies with:

- minimum height of 450mm and minimum width of 450mm.
- minimum area 0.33m².
- the bottom of the openable area should be not more than 1100mm above the floor.

The window should enable the person to reach a place free from danger from fire.

NEW AND REPLACEMENT WINDOWS

New and replacement windows to be double glazed with 16-20mm argon gap and soft coat low-E glass. Window Energy Rating to be Band B or better and to achieve U-value of 1.4 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals.

Windows and door frames to be taped to surrounding openings using air sealing tape.

Windows to be fitted with trickle vents to provide adequate background ventilation in accordance with Approved Document F.

ROOF LIGHTS

Min U-value of 1.6 W/m²K.

Roof-lights to be double glazed with 16mm argon gap and soft low-E glass. Window Energy Rating to be Band C or better. Roof lights to be fitted in accordance with manufacturer's instructions with rafters doubled up to sides and suitable flashings etc.

NEW AND REPLACEMENT DOORS

New and replacement doors to achieve a U-Value of 1.4W/m²K. Glazed areas to be double glazed with 16-20mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K (Part N in Wales) of the current Building Regulations.

Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals.

Windows and door frames to be taped to surrounding openings using air sealing tape.

PURGE VENTILATION

Minimum total area of opening in accordance with Table 1.4 Approved Document F1.

Hinged or pivot windows with an opening angle of 15 to 30 degrees to have an openable area in excess

1/10 of the floor area of the room.

Sash windows, external doors or hinged pivot windows with an opening angle of equal to or greater than 30 degrees to have an openable area in excess of 1/20 of the floor area of the room.

Purge ventilation should be capable of extracting at least 4 air changes per hour per room directly to the outside.

Internal doors should be provided with a 10mm gap below the door to aid air circulation.

BACKGROUND VENTILATION

Controllable background ventilation at least 1700mm above floor level to be provided to habitable rooms and kitchens at a rate of min 10,000mm², and to wet rooms at a rate of min 5000mm²,

Background ventilators to be tested to BS EN 13141-1. Background ventilator equivalent area and operation to be measured and recorded.

C2. CONDENSATION

Walls, floors and roof of the building to be designed and constructed so that their structural and thermal performance will not be adversely affected by interstitial condensation, surface condensation or mould growth. Account to be taken of the building's form and orientation in relation to topography, prevailing winds, sunlight and over-shadowing, and the rate at which humidity is generated.

Materials with the highest vapour resistance should be located on the warm side of a thermal element. VCLs to be provided where necessary.

The junctions between elements are designed to Accredited Construction Details or guidance of BRE IP17/01) and BS 5250:2011+A1:2016 Code of practice for control of condensation in buildings to be followed.

EXTRACT TO BATHROOM, UTILITY ROOM AND KITCHEN

Bathroom to have mechanical vent ducted to external air to provide min 15 litres / sec extraction. Vent to be connected to light switch and to have 15 minute over run if no window in room. To utility room provide mechanical ventilation ducted to external air capable of extracting at a rate of 30 litres per second.

Kitchen to have mechanical ventilation with an extract rating of 60l/sec or 30l/sec if adjacent to hob to external air, sealed to prevent entry of moisture. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

RAINWATER DRAINAGE

New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill. Soakaway to be min of 1 cubic metre capacity (or to depth to Local Authorities approval) with suitable granular fill and with geotextile surround to prevent migration of fines.

If necessary carry out a porosity test to determine design and depth of soakaway.

INSPECTION CHAMBERS

Underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all changes of level, direction, connections and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways.

ABOVE GROUND DRAINAGE

All new above ground drainage and plumbing to comply with BS EN 12056-2 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction.

Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used) Wash basin - 1.7m for 32mm pipe 3m for 40mm pipe, Bath/shower - 3m for 40mm pipe 4m for 50mm pipe. W/c - 6m for 100mm pipe for single WC. All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m. Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting. Waste pipes not to connect on to SVP within 200mm of the WC connection. Supply hot and cold water to all fittings as appropriate.


AUTOMATIC AIR VALVE

Ground floor fittings from WC to be connected to new 110mm UPVC soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting and connected to underground quality drainage encased with pea gravel to a depth of 150mm.

H4 BUILDING OVER OR NEAR PUBLIC SEWERS

The developer is to consult the Local Sewers Undertaker when constructing, extending or underpinning over a sewer or within 3m of the centreline of sewer shown on the sewerage undertakers sewer records and when the following applies:

- The building or extension is to be constructed over a manhole or inspection chamber or other access fitting on a sewer.
- The length of the drain or sewer under the proposed building or extension will exceed 6m.
- The Building or extension is to be constructed over or within 3m of any drain or sewer more than 3m deep or greater than 225m in diameter.

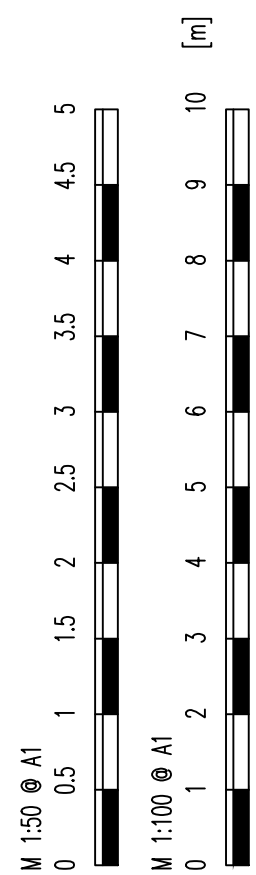

BUILDING REGULATION DRAWINGS

22 Grange Park Avenue
Chapel en le Frith
High Peak
SK23 0HL

Single Storey Rear Extension

Revision	Date
A - Following client meeting	16/08/22

Drawing Ref	Date
22GPA/BR/03/A	1st July 2022

PLANS + DESIGN

Architectural Drawing

18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210
info@plansanddesign.co.uk