



EXISTING PLANS 1:100

GROUND FLOOR

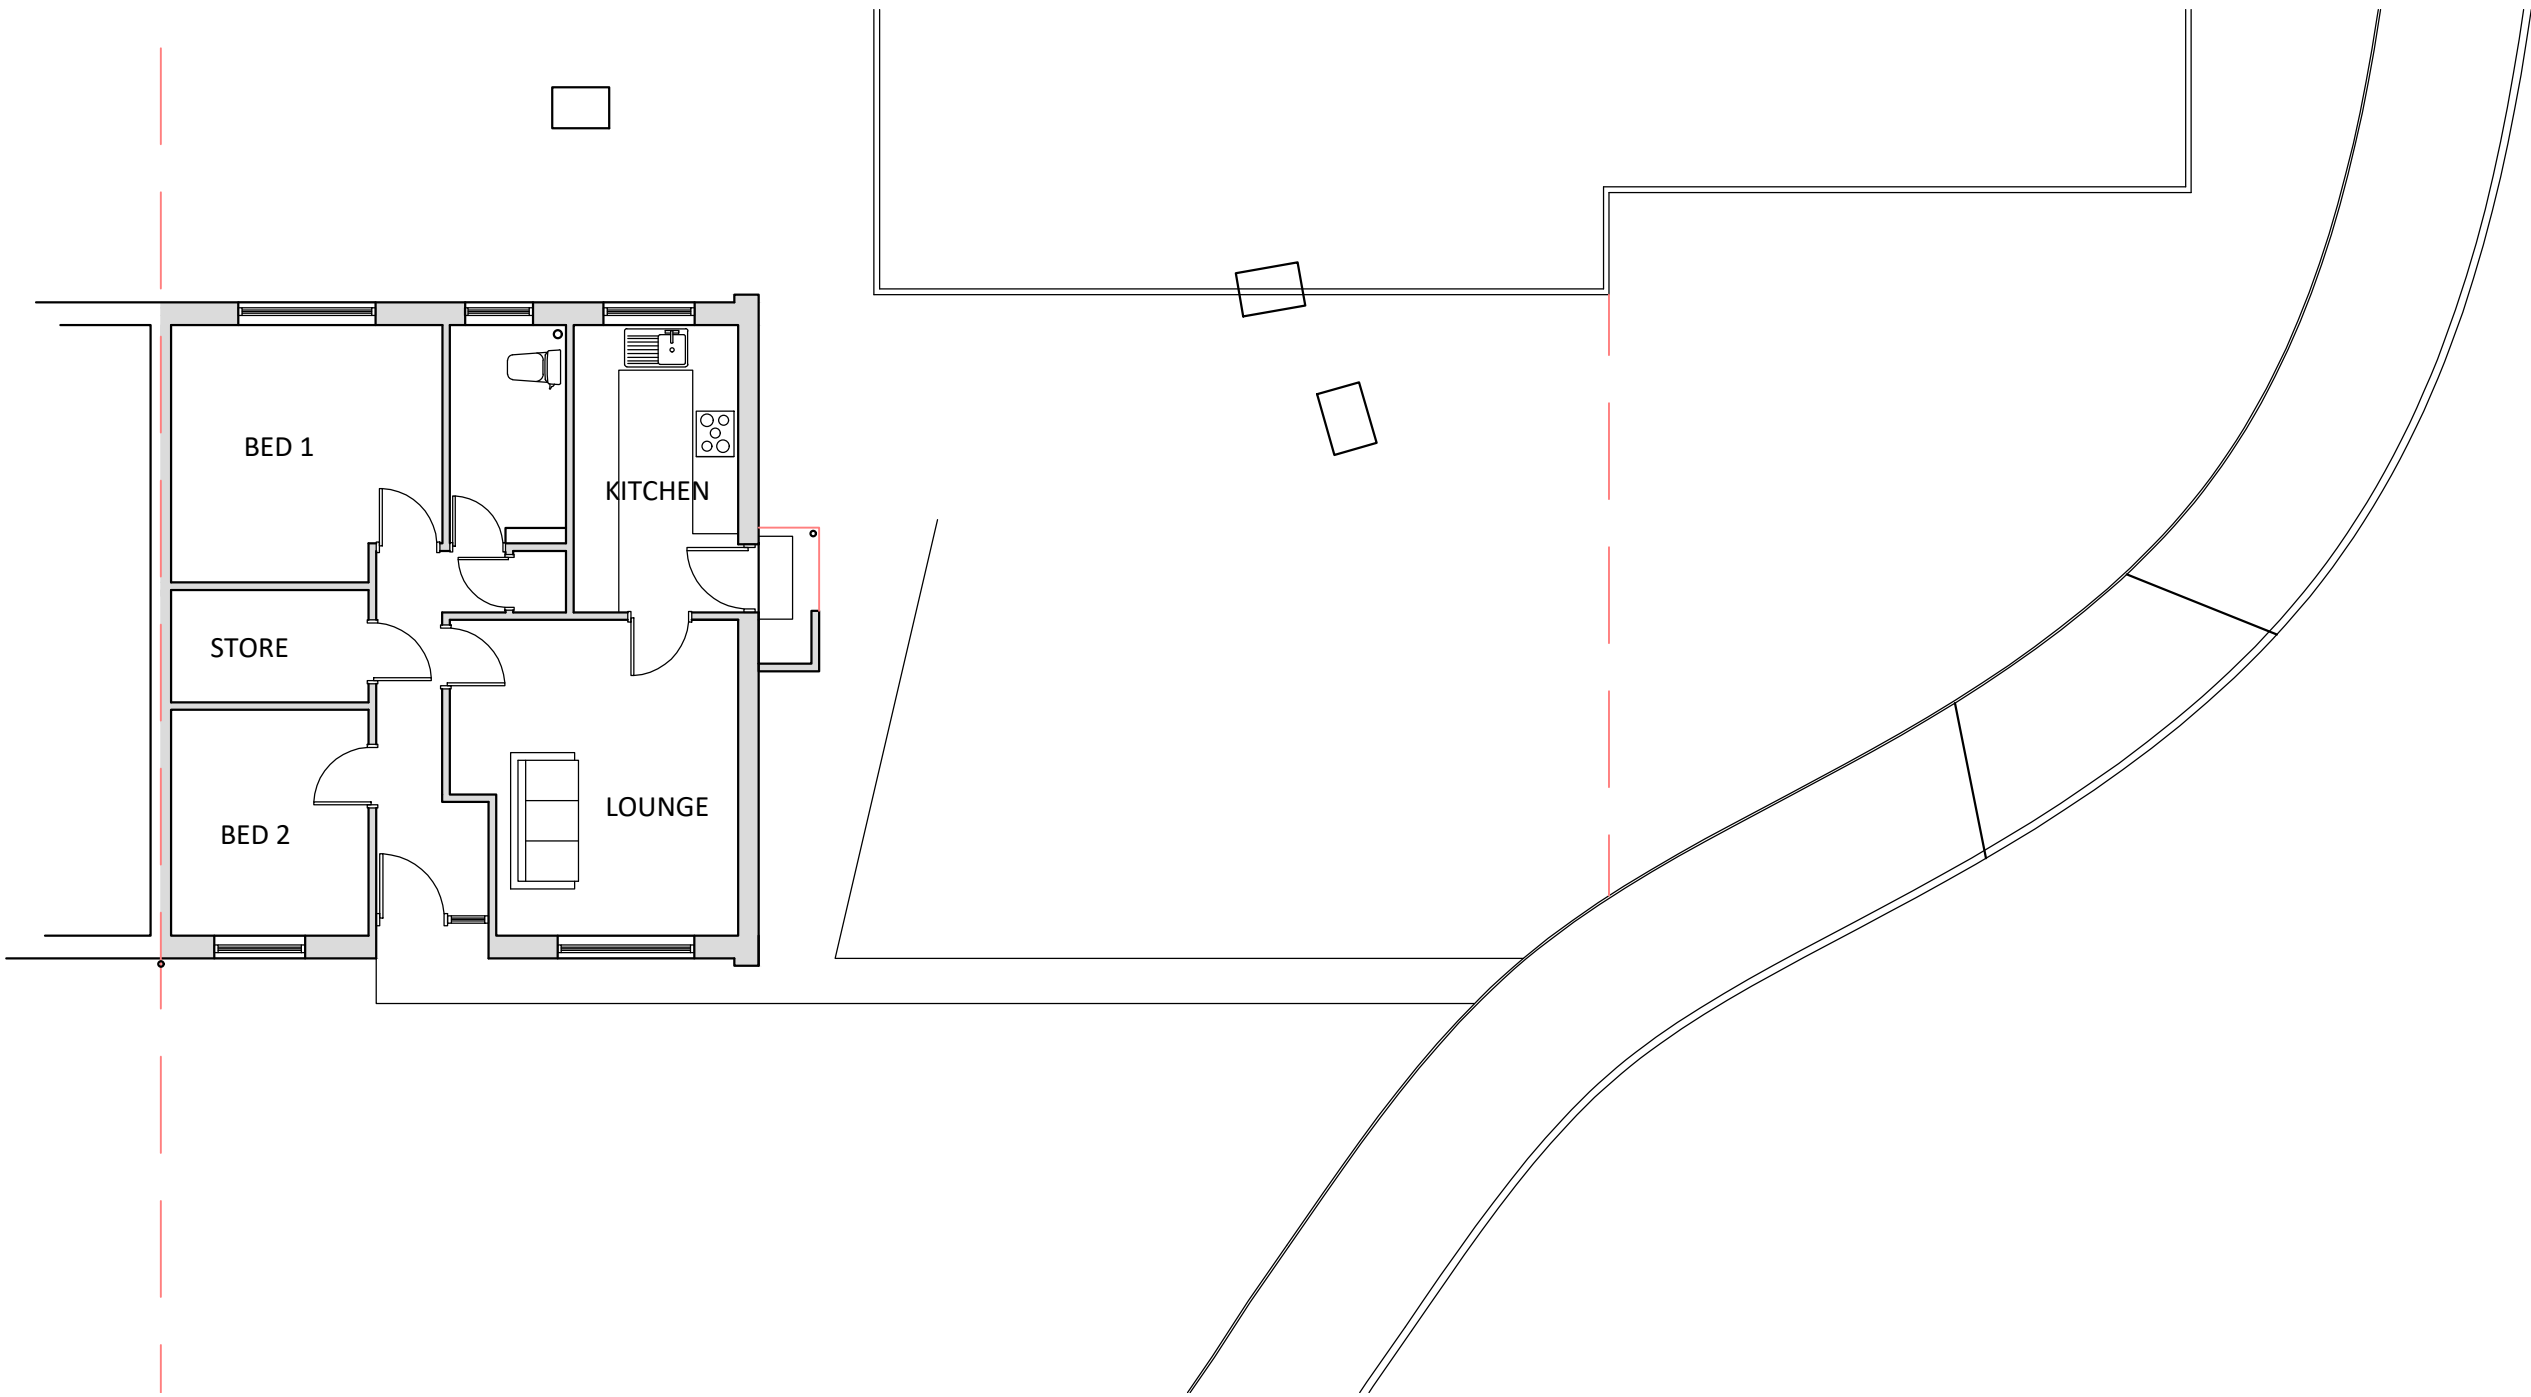


ROOF PLAN

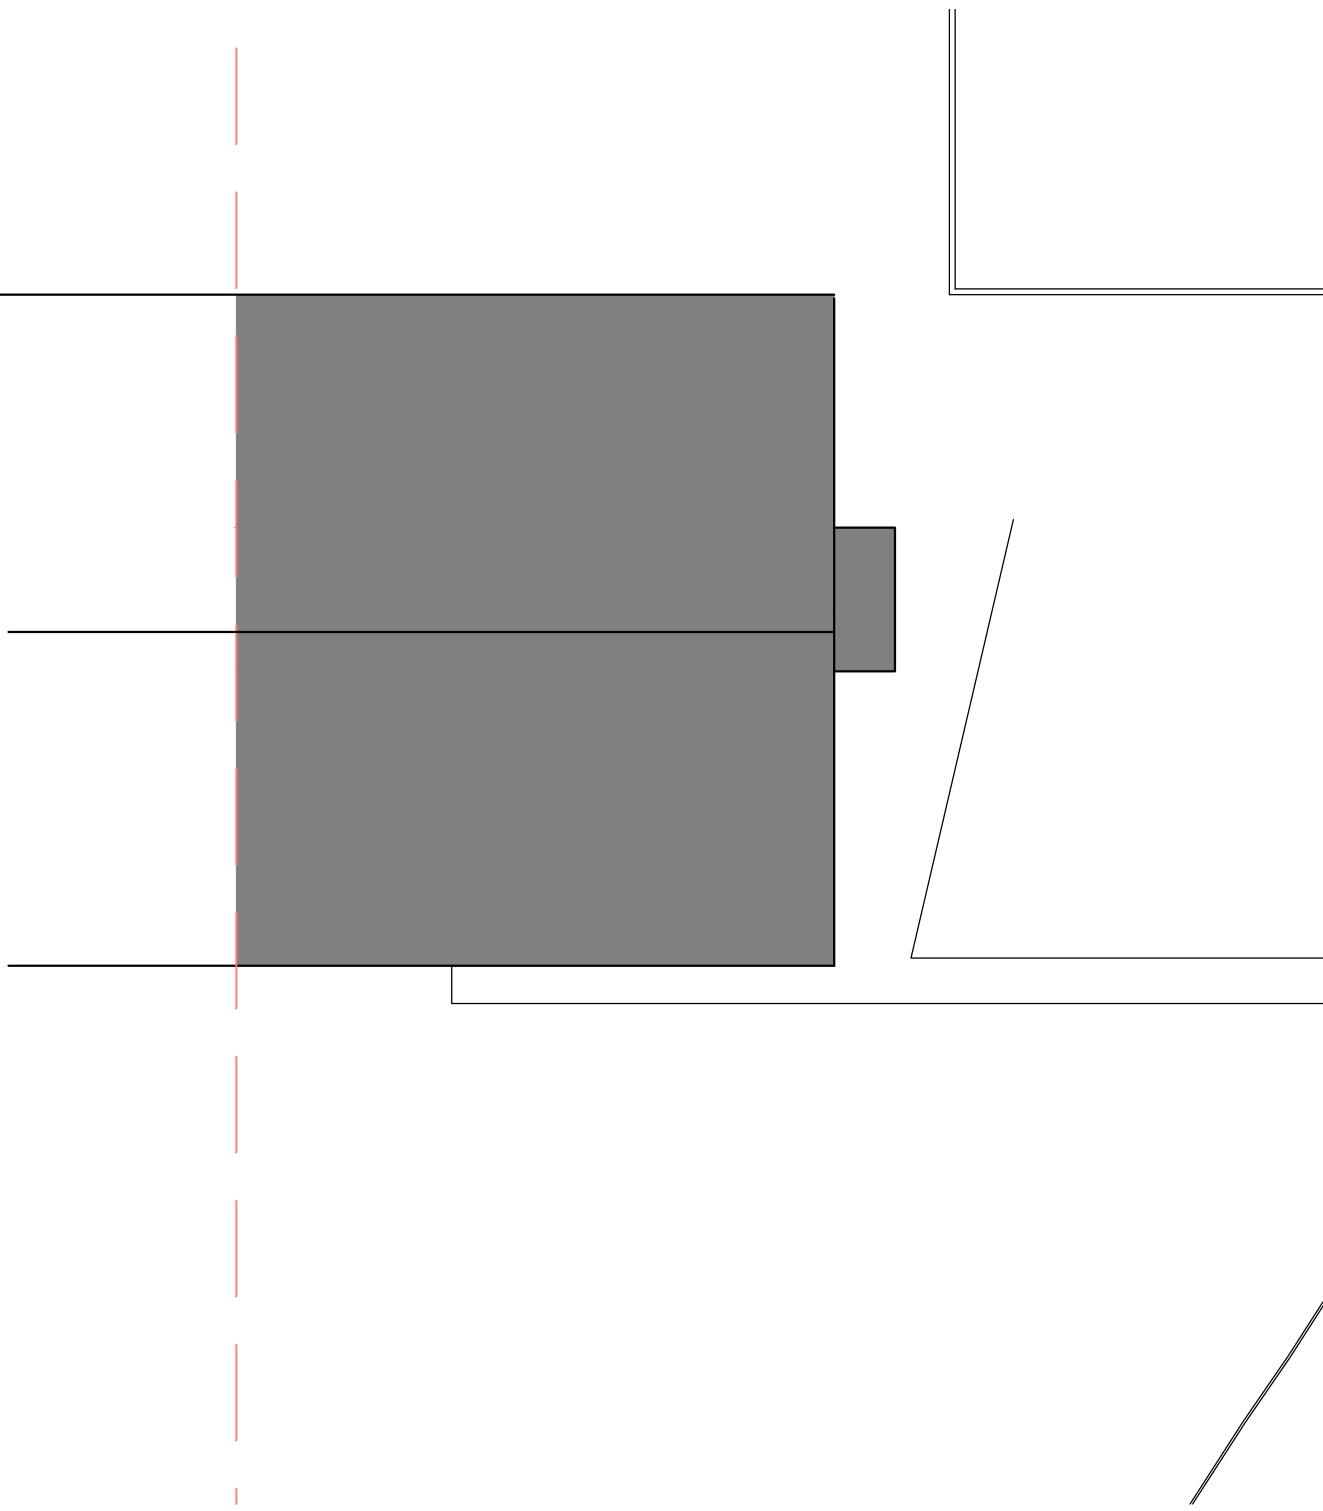


PROPOSED PLANS 1:100

ROOF PLAN

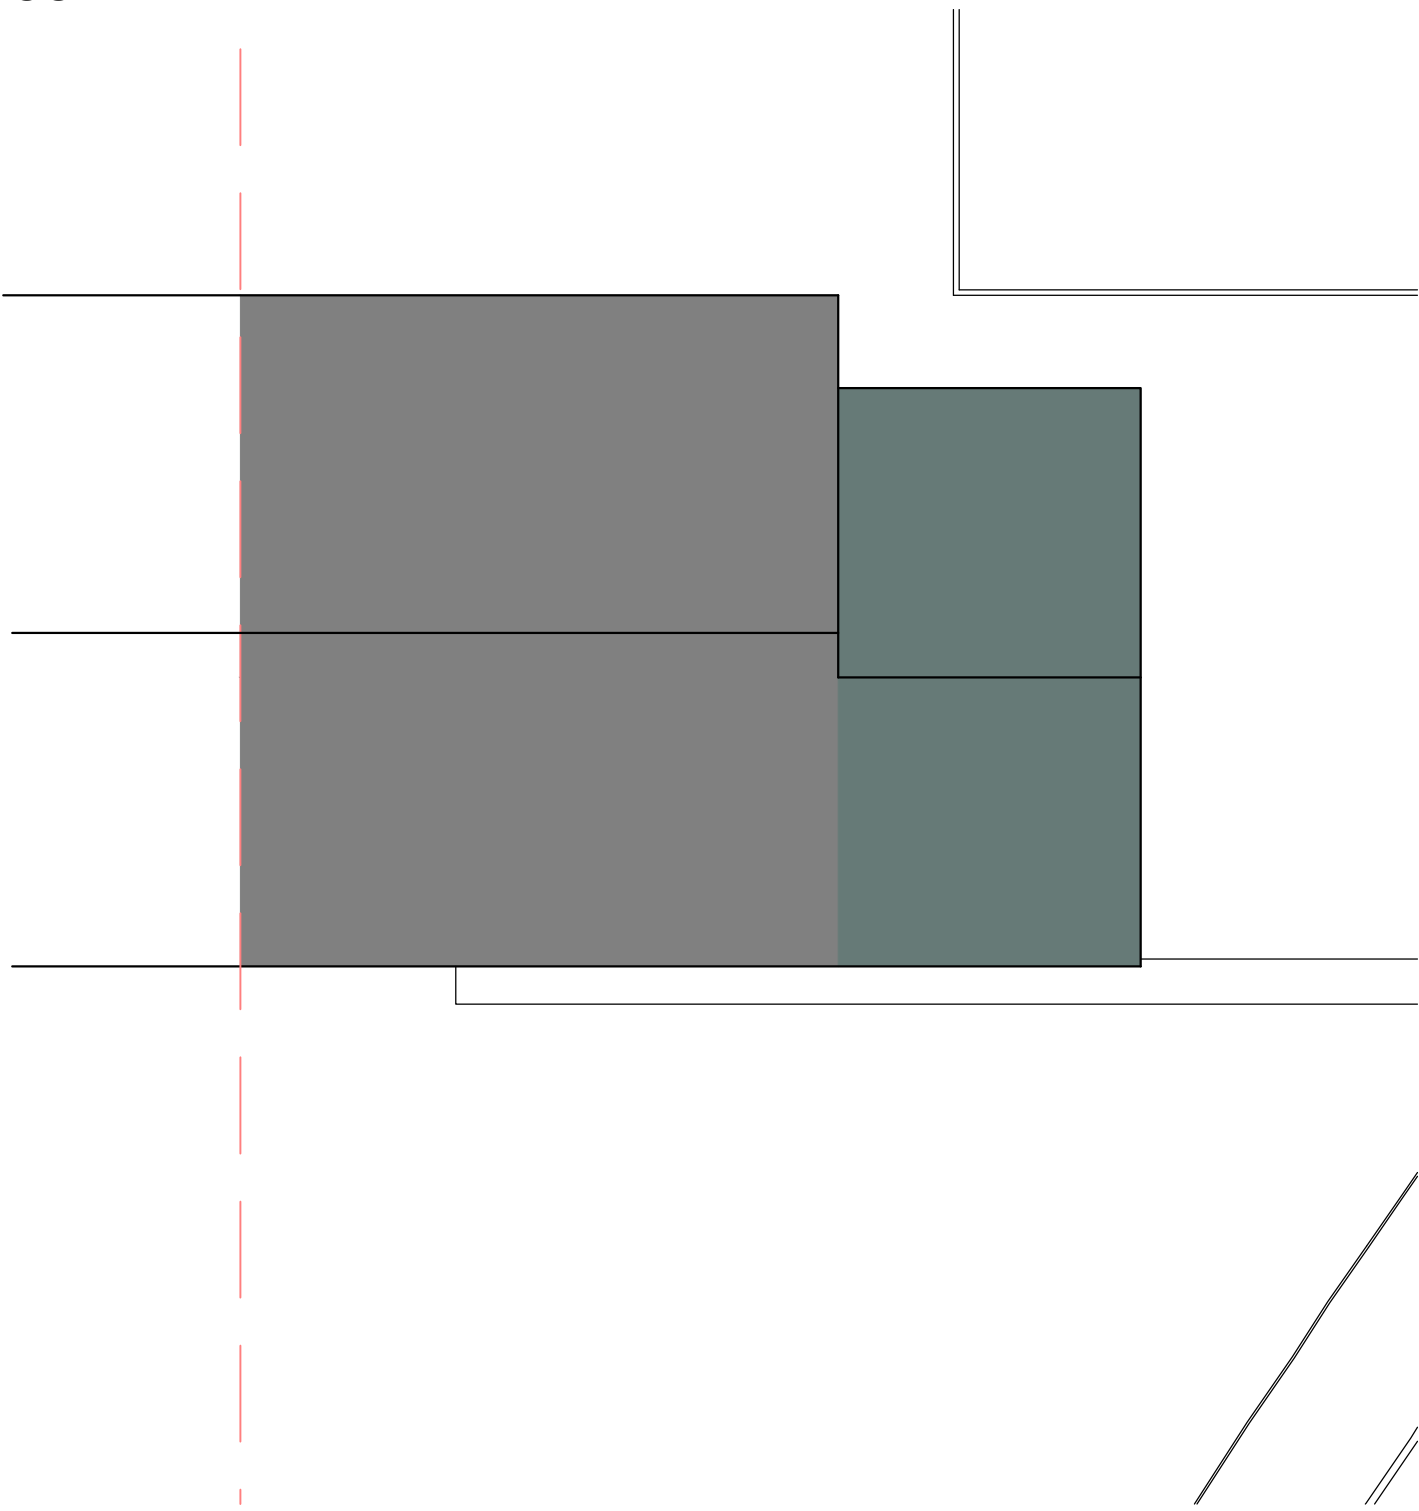

PROPOSED PLANS 1:50

GROUND FLOOR

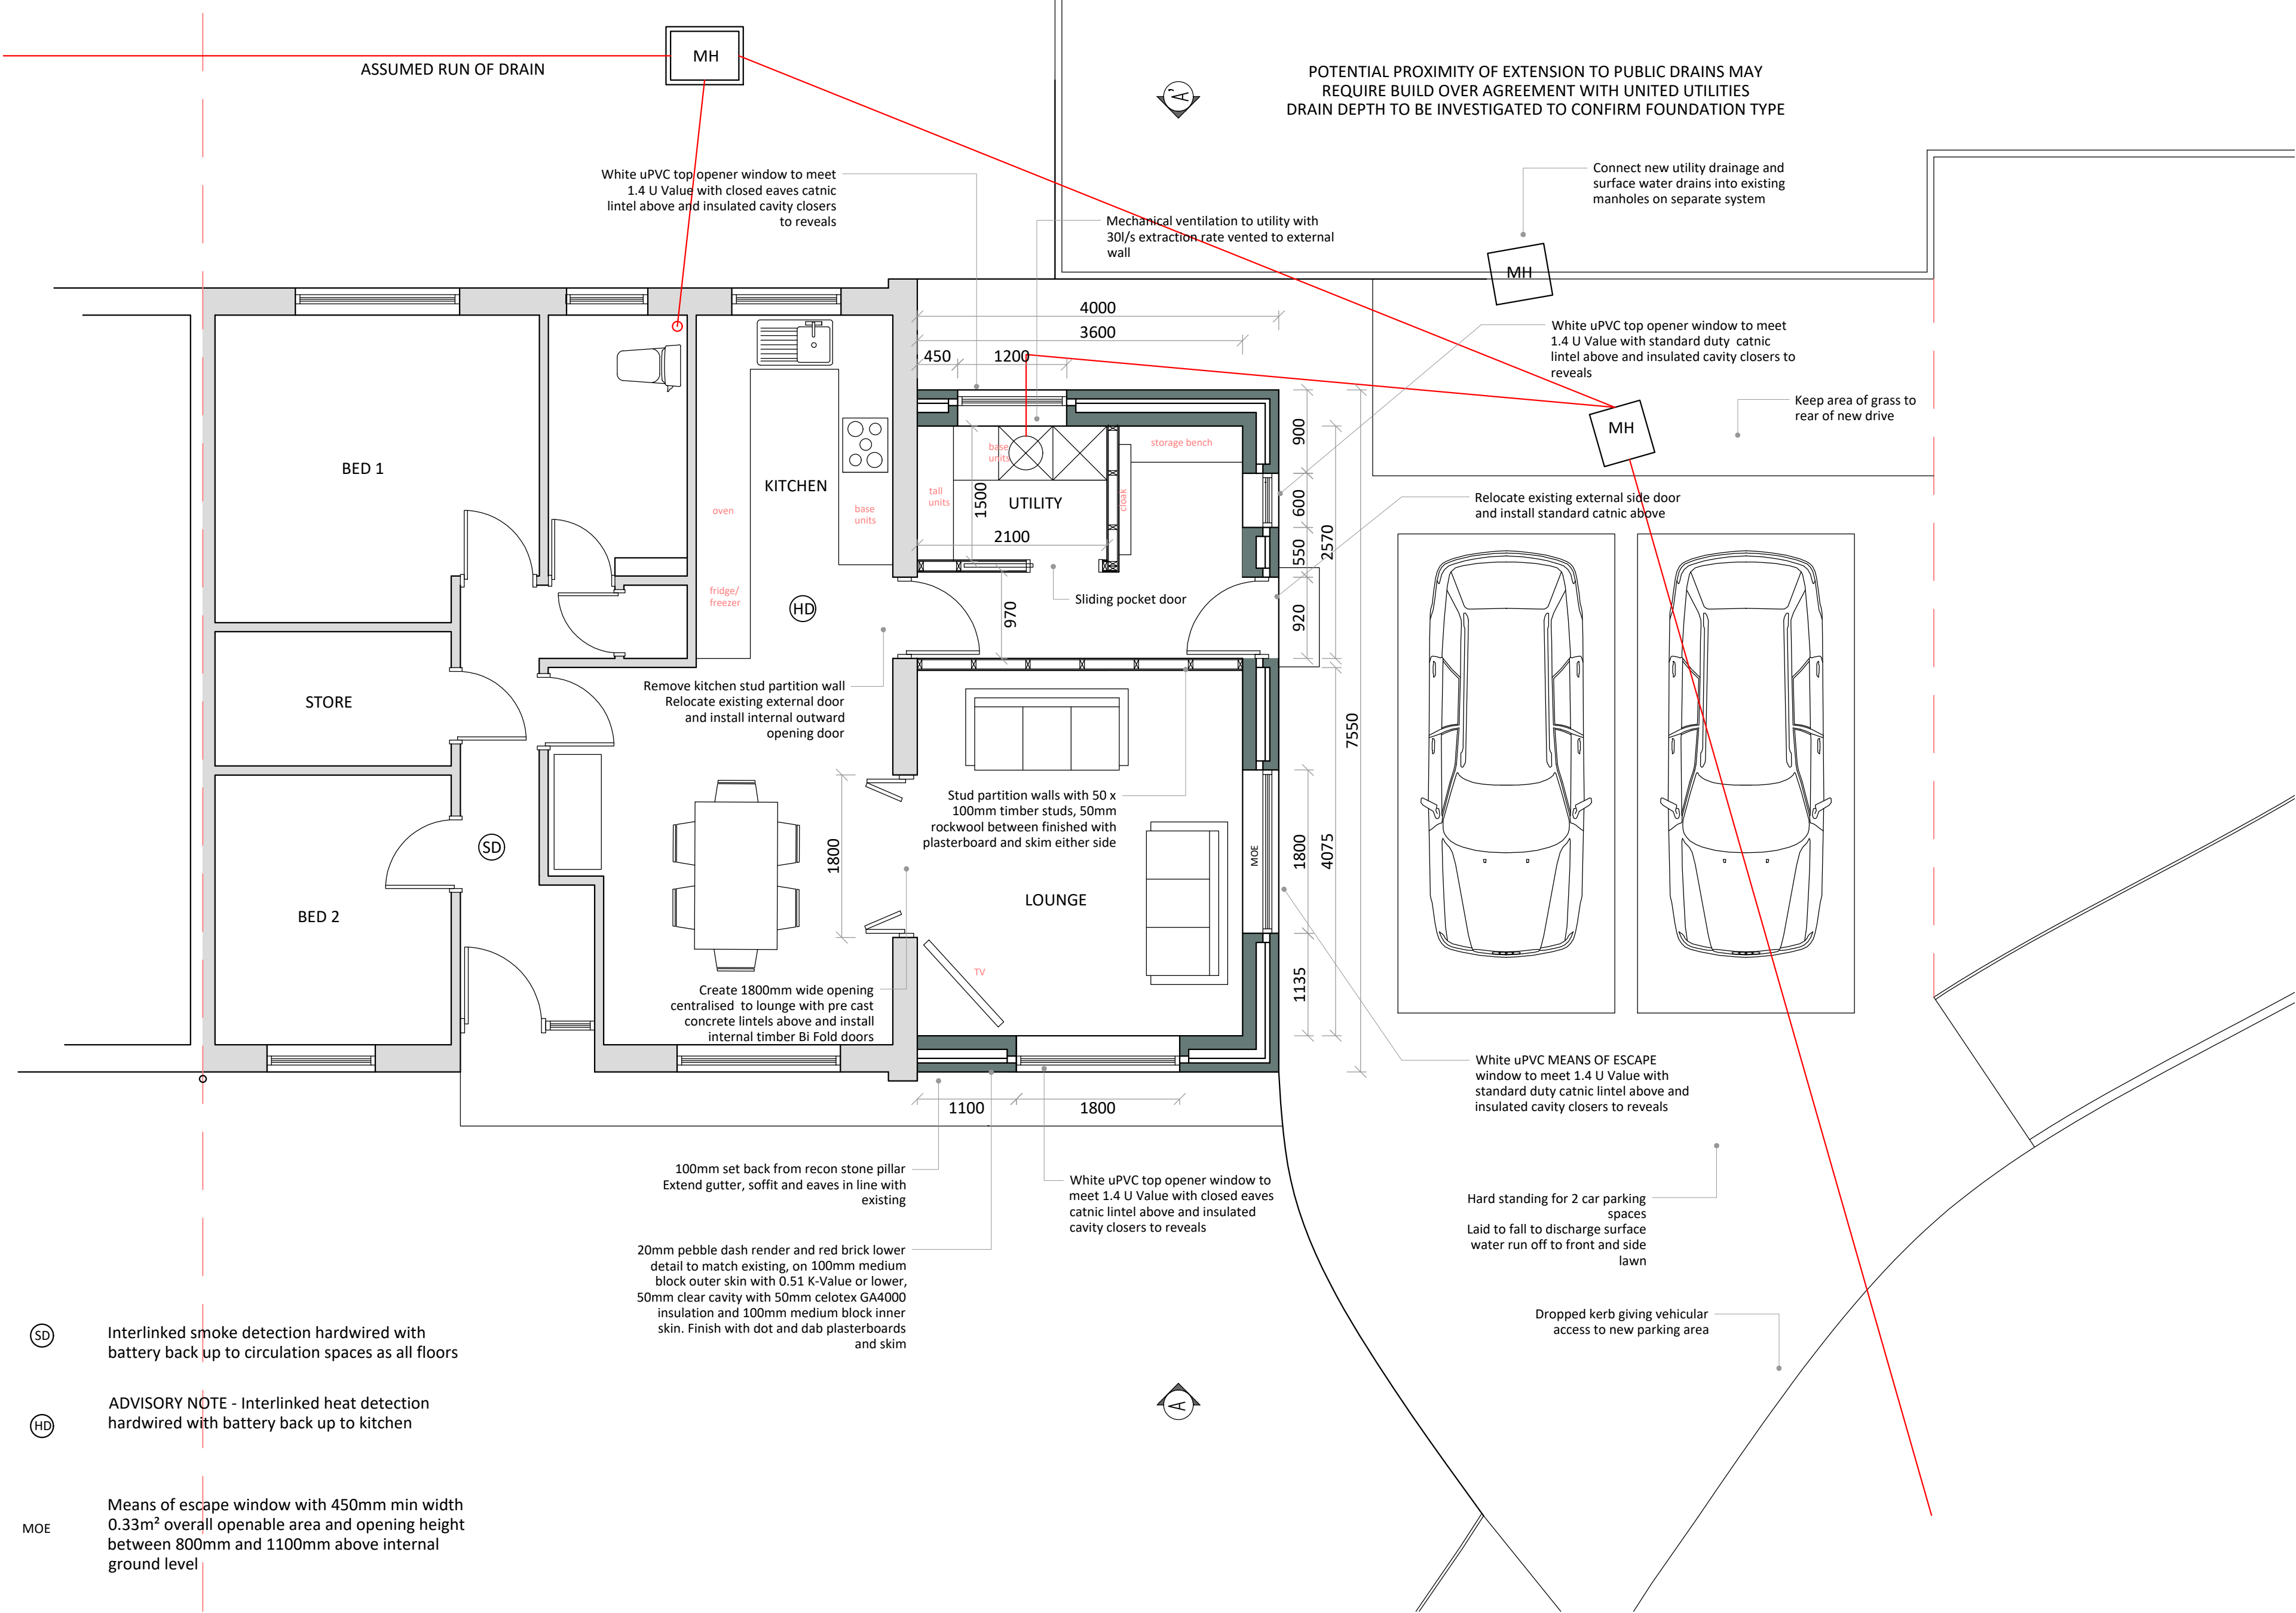

EXISTING TO NEW WALL

Cavities in new wall to be made continuous with existing where possible to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

TRUSSED RAFTER ROOF

To achieve U-value 0.15 W/m²K

Pitched roof to be formed using proprietary prefabricated manufactured trusses. Design of roof trusses to be produced by specialist truss manufacturer to BS EN 595:1995 and submitted to Building Control for approval prior to commencement of work. Trusses to be placed at max 600ctrs in accordance with BS 8103-3:2009 and BS EN 1995-1 on suitable wall plates fixed using proprietary galvanised steel truss clips. All strapping, fixing and bracing to be in accordance with manufacturer's instructions. Mechanically fix trusses to 100 x 50mm sw treated wall plates using galvanized steel truss clips.

Form ceiling using 12.5mm plasterboard and min 3mm thistle multi-finish plaster. Insulation at ceiling level to be two layers of Rockwool insulation to total 300mm laid between over joists (cross direction). Provide polythene vapour barrier between insulation and plasterboard. Ensure opening at eaves level at least equal to continuous strip 25mm wide in two opposite sides to promote cross-ventilation. Mono pitched roofs to have ridge/high level ventilation equivalent to a 5mm gap via proprietary tile vents spaced in accordance with manufacturer's details.

Loft hatches should be suitable designed and installed to ensure optimum air tightness.

LEAD WORK AND FLASHINGS

All lead flashings, any valleys or soakers to be Code 5 lead and laid according to Lead Development Association. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc. All work to be undertaken in accordance with the Lead Development Association recommendations.

INTERNAL STUD PARTITIONS

100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (eg. 100mm Rockwool or Isowool mineral fibre sound insulation) in all voids the full depth of the stud. Partitions built off doubled up joists where partitions run parallel or provide noggins where at right angles, or built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plaster board with skim plaster finish. Taped and jointed complete with beads and stops.

ELECTRICAL

All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

INTERNAL LIGHTING

Install low energy light fittings that only take lamps having a luminous efficiency better than 80 lumens per circuit watt. All fixed to have lighting capacity (lm) 185 x total floor area, to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

HEATING


Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.

The energy performance of the new components to be assessed. The results should be recorded and given to the building owner.

All accessible pipes to be insulated to the standards in Table 4.4 Approved Document L.

SMOKE DETECTION

Mains operated linked smoke alarm detection system to BS EN 14604 and BS 5839-6:2019 to at least a Grade D category LD3 standard and to be mains powered with battery back up. Smoke alarms should be sited so that there is a smoke alarm in the circulation space on all levels/ storeys and within 7.5m of the door to every habitable room. If ceiling mounted they should be 300mm from the walls and light fittings. Where the kitchen area is not separated from the stairway or circulation space by a door, there should be an interlinked heat detector in the kitchen.

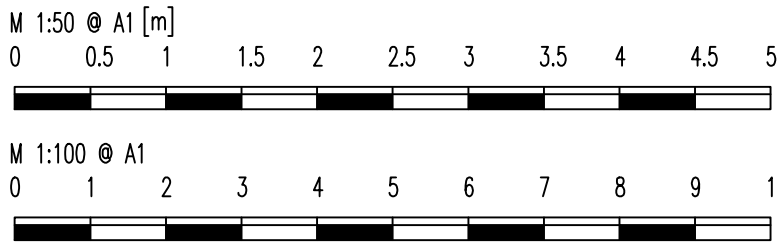

BUILDING REGULATION DRAWINGS

6 Knowles Crescent
Fairfield
Buxton
High Peak
SK17 7LP

Single Storey Side Extension

Revision	Date
Drawing Ref 6KC/BR/02	Date 12th September 2022

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.



18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210

info@plansanddesign.co.uk