



PROPOSED SECTION A-A' 1:20

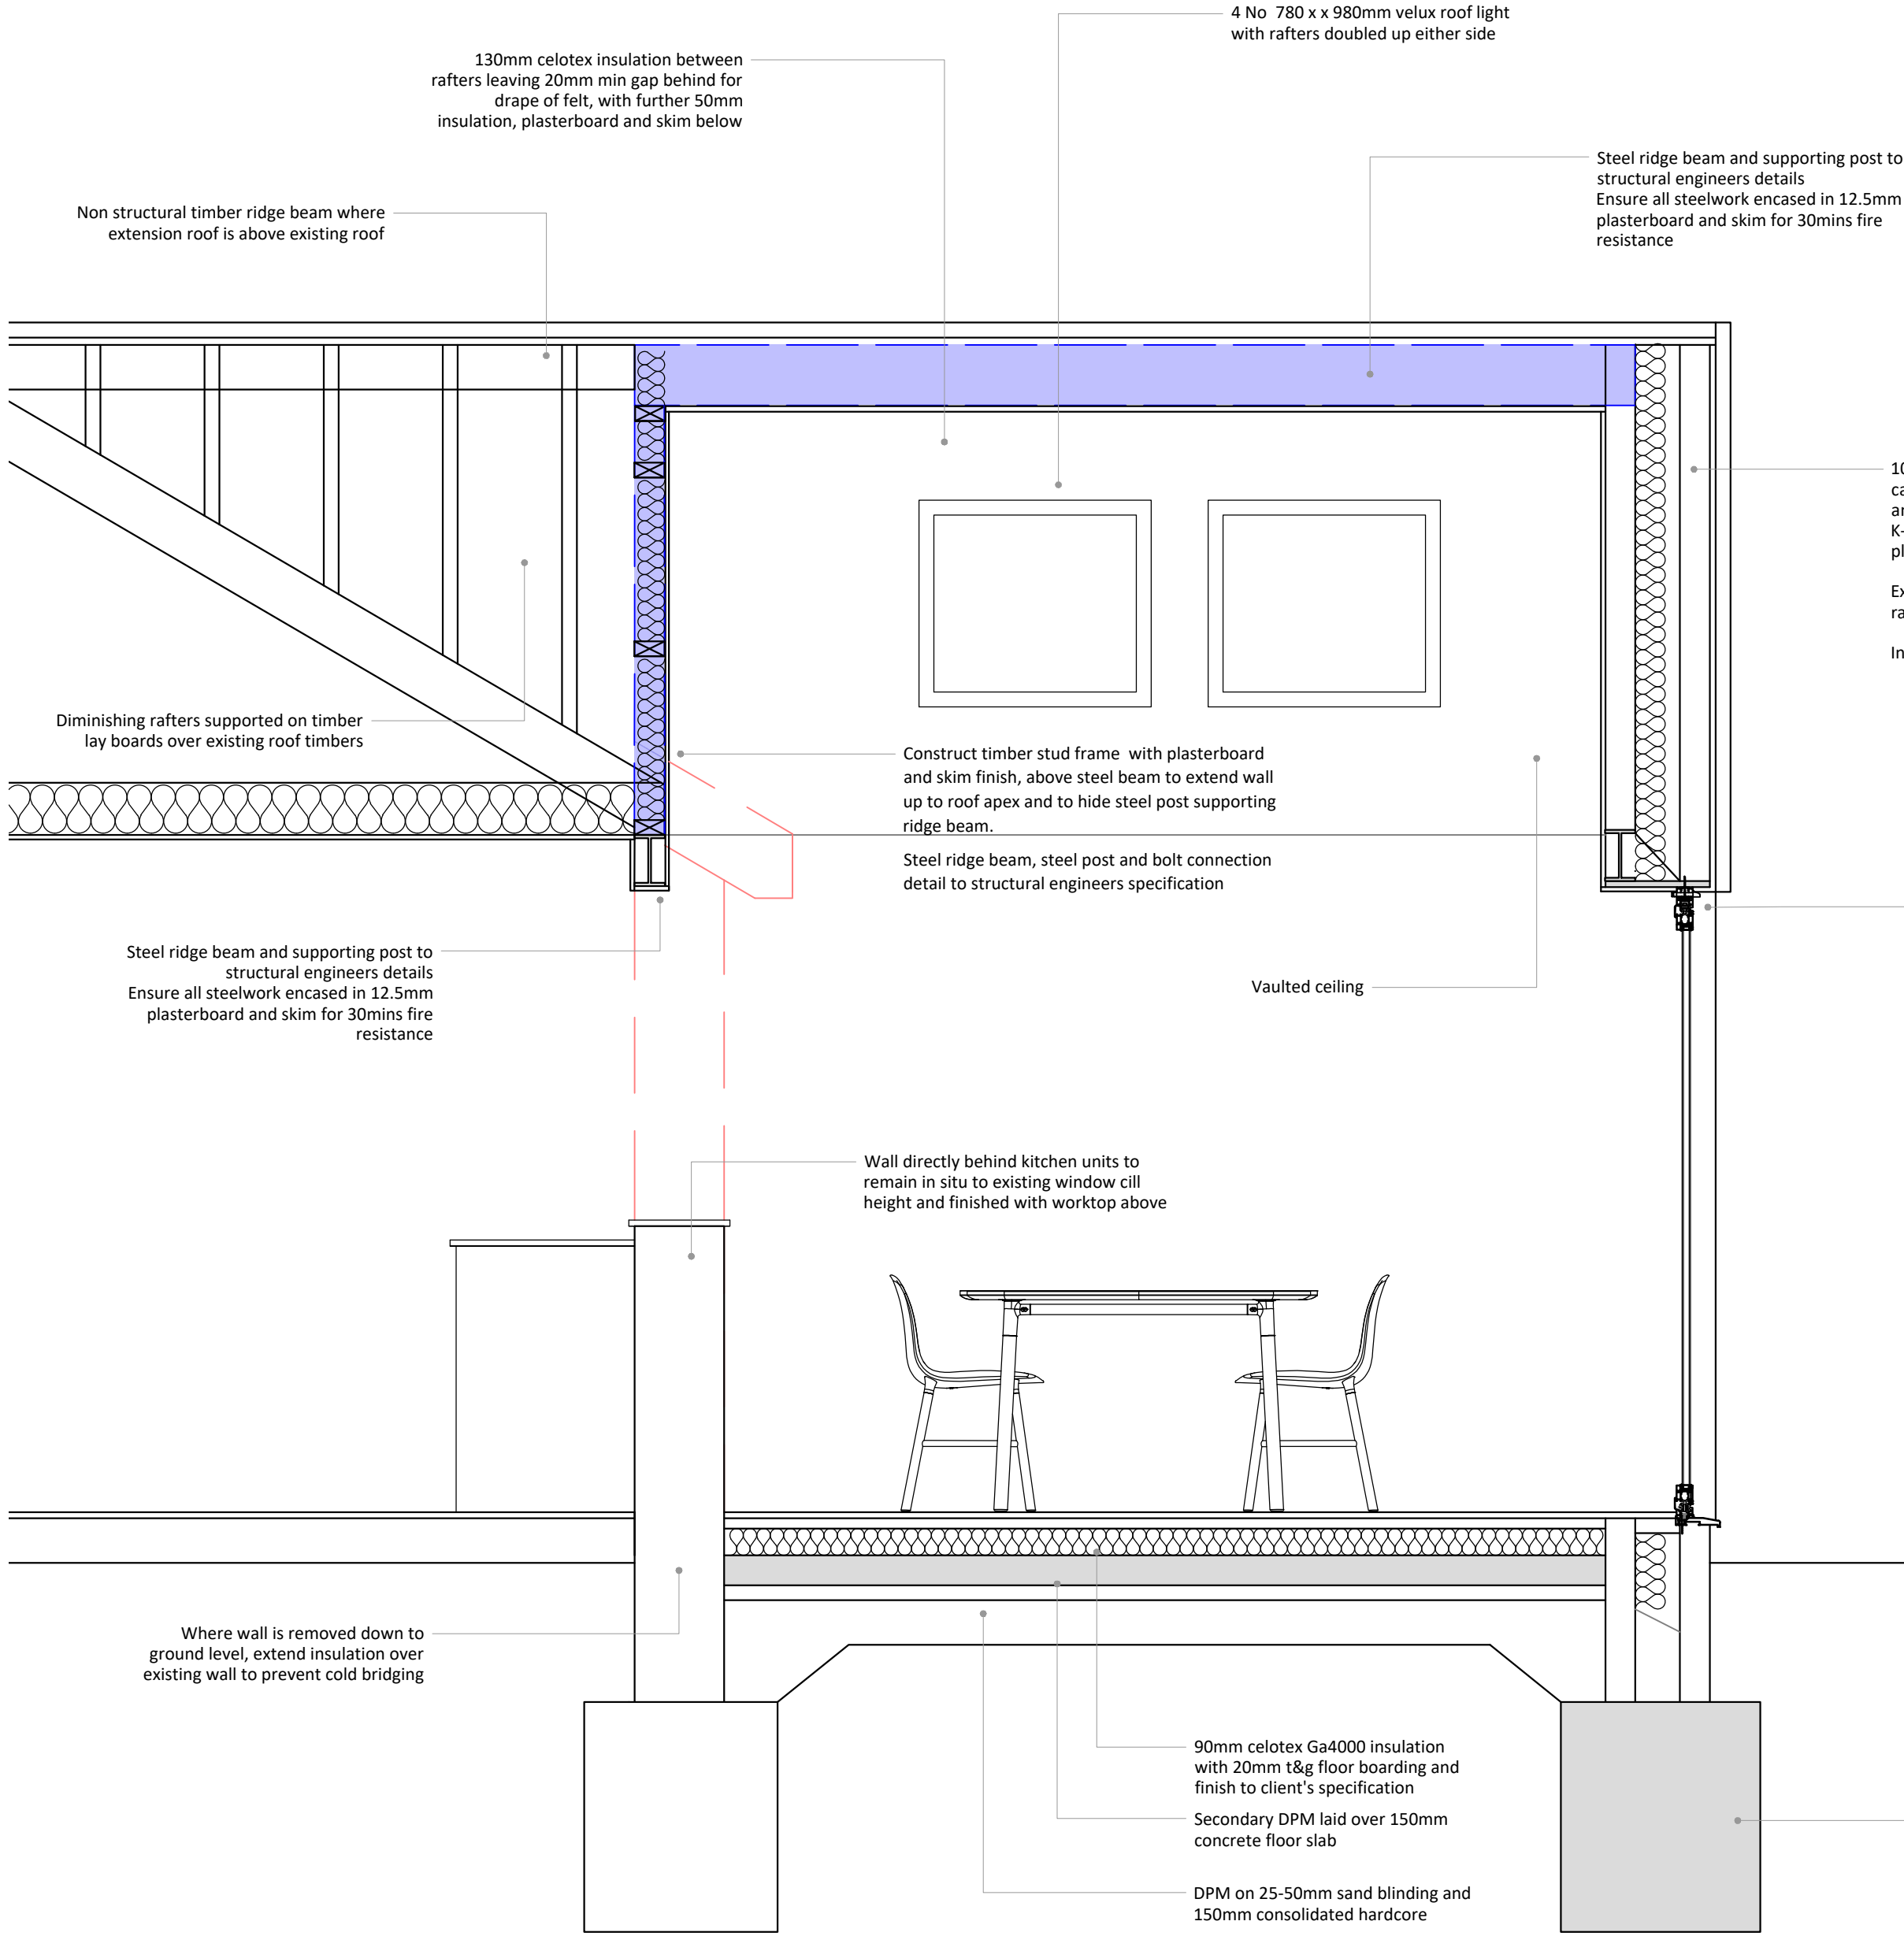

PROPOSED SECTION B-B' 1:20

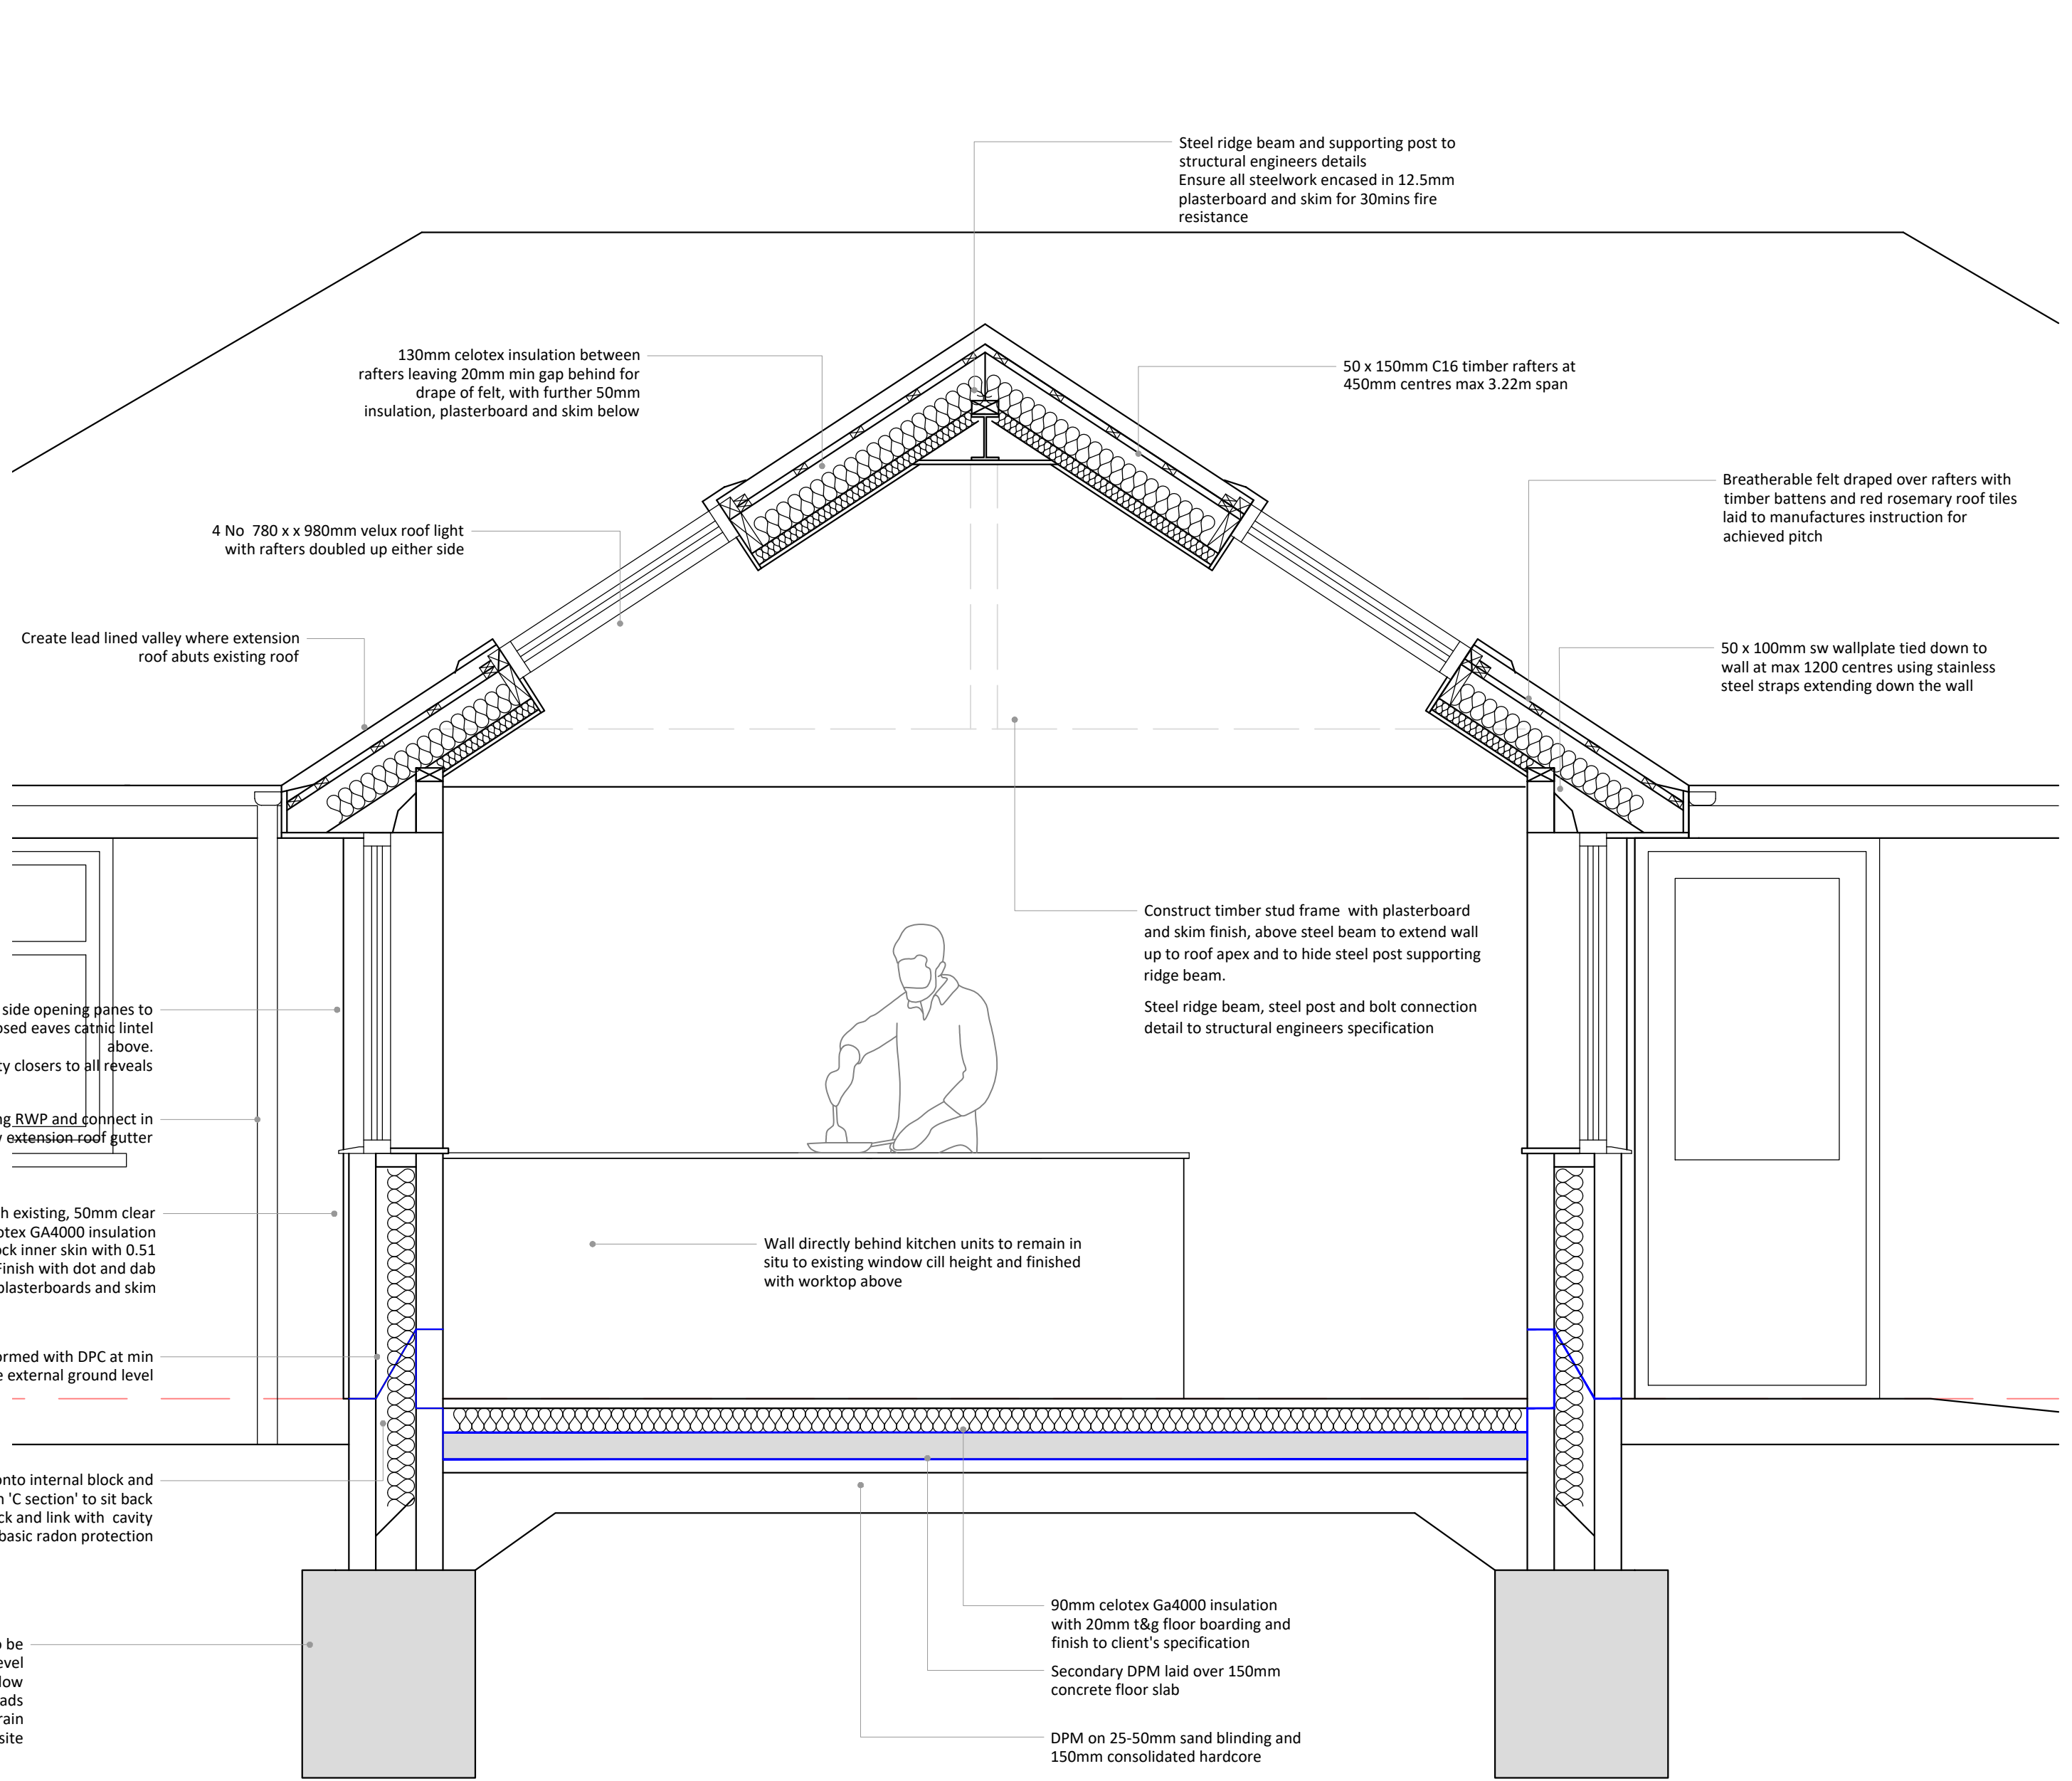

WALLS BELOW GROUND
All new walls below ground to be constructed using blockwork compliant with BS EN 771 and suitable for below ground level or semi engineering brickwork. Walls to be built using 1:4 masonry mortar mix or equal approved specification to BS EN 1996-1-1. Cavities below ground level to be filled with lean mix concrete min 225mm below damp proof course. Or provide lean mix backfill at base of cavity wall (150mm below damp course) laid to fall to weepholes.

PARTIAL FILL CAVITY WALL
To achieve minimum U Value of 0.18 W/m²K
Provide 103mm suitable facing brick. Ensure a 50mm clear residual cavity and provide 100mm Celotex CW4000 insulation fixed to internal leaf constructed of 100mm, 0.45 W/m²K standard block. Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1:6 cement mortar.

DPC
Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins minimum 150mm above external ground level. New DPC to be made continuous with existing DPC's and with floor DPM. Vertical DPC to be installed at all reveals where cavity is closed.

WALL TIES
All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS EN 845

CAVITIES
Provide cavity trays over openings. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPC's around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

EXISTING TO NEW WALL
Cavities in new wall to be made continuous with existing where possible to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

UNVENTED PITCHED ROOF
Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)
To achieve U-value 0.15 W/m²K
Timber roof structures to be designed by an Engineer in accordance with NHBC Technical Requirement R5 Structural Design.
Calculations to be based on BS EN 1995-1-1. Roofing tiles to match existing on 25 x 38mm tanalised sw treated battens on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 150mm grade C16 rafters at max 450mm centres max span 3.29m. Rafters supported on 100 x 50mm treated sw wall plates. Allow min 20mm air space to allow for drap of breathable felt. Insulation to be 130mm Celotex XR4000 between rafters and 50mm GA4000 under. Fix 12.5mm foil backed plasterboard (joints staggered) to the underside of all ceilings using galvanized plasterboard nails. Finish with 5mm skim coat of finishing plaster.

Restraint strapping - Ceiling joists tied to rafters (if raised collar roof consult structural engineer). 100mm x 50mm wall plate strapped down to walls. Ceiling joists and rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1000 x 30 x 5mm galvanized straps or other approved to BSEN 845-1 at 2m centres.

LEAD WORK AND FLASHINGS
All lead flashings, any valleys or soakers to be Code 5 lead and laid according to Lead Development Association. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc. All work to be undertaken in accordance with the Lead Development Association recommendations.

ELECTRICAL
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

INTERNAL LIGHTING
Install low energy light fittings that only take lamps having a luminous efficiency better than 80 lumens per circuit watt. All fixed to have lighting capacity (lm) 185 x total floor area, to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

HEATING
Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations. The energy performance of the new components to be assessed. The results should be recorded and given to the building owner.

All accessible pipes to be insulated to the standards in Table 4.4 Approved Document L.

ROOF LIGHTS
Min U-value of 1.6 W/m²K.
Roof-lights to be double glazed with 16mm argon gap and soft low-E glass. Window Energy Rating to be Band C or better. Roof lights to be fitted in accordance with manufacturer's instructions with rafters doubled up to sides and suitable flashings etc.

NEW AND REPLACEMENT WINDOWS
New and replacement windows to be double glazed with 16-20mm argon gap and soft coat low-E glass. Window Energy Rating to be Band B or better and to achieve U-value of 1.4 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals. Windows and door frames to be taped to surrounding openings using air sealing tape. Windows to be fitted with trickle vents to provide adequate background ventilation in accordance with Approved Document F.

NEW AND REPLACEMENT DOORS
New and replacement doors to achieve a U-Value of 1.4W/m²K. Glazed areas to be double glazed with 16-20mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K (Part N in Wales) of the current Building Regulations. Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals. Windows and door frames to be taped to surrounding openings using air sealing tape.

PURGE VENTILATION
Minimum total area of opening in accordance with Table 1.4 Approved Document F1.
Hinged or pivot windows with an opening angle of 15 to 30 degrees to have an openable area in excess 1/10 of the floor area of the room.
Sash windows, external doors or hinged pivot windows with an opening angle of equal to or greater than 30 degrees to have an openable area in excess of 1/20 of the floor area of the room.

Purge ventilation should be capable of extracting at least 4 air changes per hour per room directly to the outside. Internal doors should be provided with a 10mm gap below the door to aid air circulation.

EXTRACT TO KITCHEN
Kitchen to have mechanical ventilation with an extract rating of 60l/sec or 30l/sec if adjacent to hob to external air, sealed to prevent entry of moisture. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. Cooker hoods to BS EN 13141-3. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

C2. CONDENSATION
Walls, floors and roof of the building to be designed and constructed so that their structural and thermal performance will not be adversely affected by interstitial condensation, surface condensation or mould growth. Account to be taken of the building's form and orientation in relation to topography, prevailing winds, sunlight and over-shadowing, and the rate at which humidity is generated. Materials with the highest vapour resistance should be located on the warm side of a thermal element. VCLs to be provided where necessary. The junctions between elements are designed to Accredited Construction Details or guidance of BRE IP17/01 and BS 5250:2011+A1:2016 Code of practice for control of condensation in buildings to be followed.

RAINWATER DRAINAGE
New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill. Soakaway to be min of 1 cubic metre capacity (or to depth to Local Authorities approval) with suitable granular fill and with geotextile surround to prevent migration of fines. If necessary carry out a porosity test to determine design and depth of soakaway.

BUILDING REGULATION DRAWINGS

5a Rowton Grange Road
Chapel en le Frith
High Peak
SK23 0LA

Single Storey Side Extension

Revision	Date
A - Kitchen wall to remain to cill height	13.10.22

Drawing Ref
5aRGR/BR/04/A

Date
5th October 2022

PLANS + DESIGN
Architectural Drawing

18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG
07912 845 210
info@plansanddesign.co.uk

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAFTER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.

