


EXISTING ELEVATIONS 1:100


NORTH



EAST

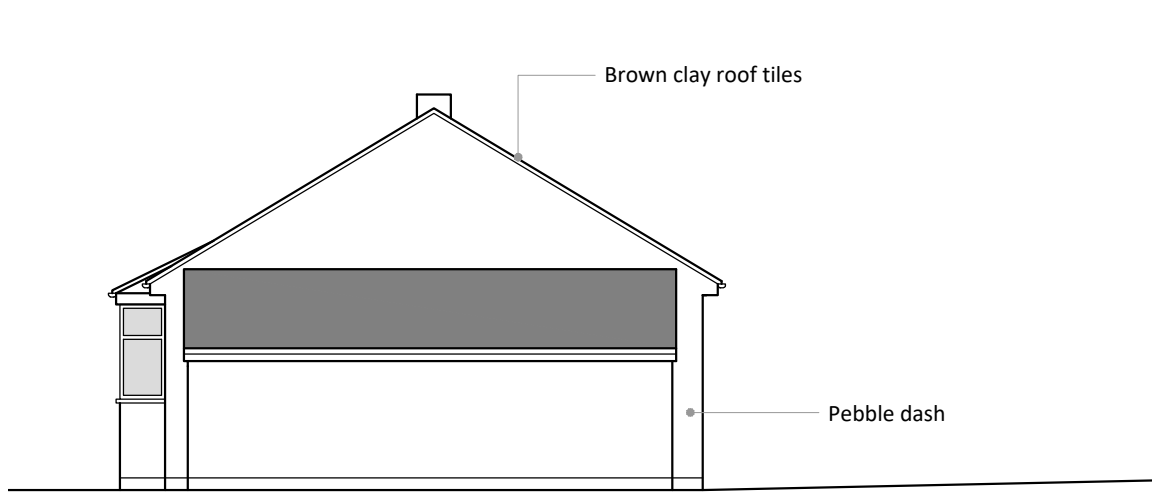

SOUTH

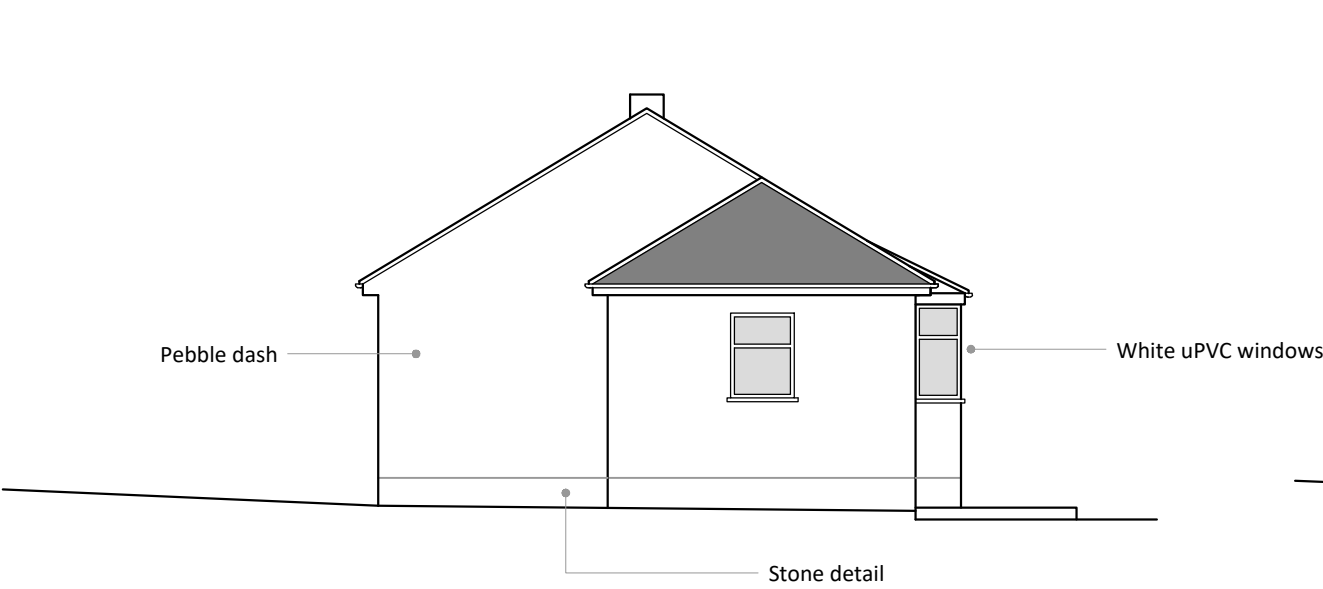


WEST



PROPOSED ELEVATIONS 1:100


NORTH

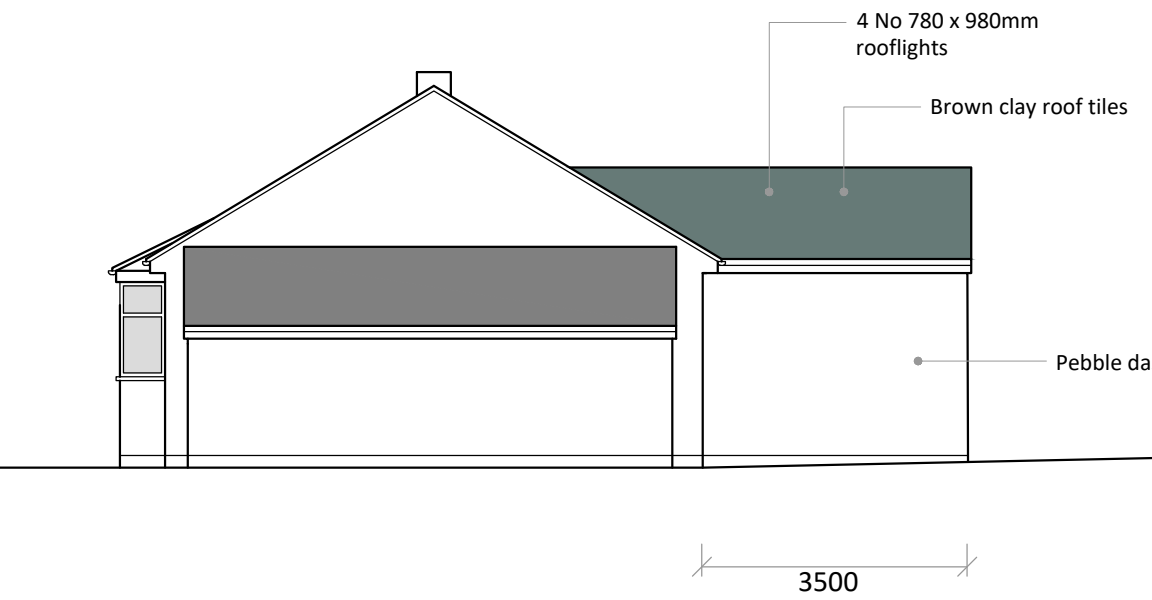


EAST



SOUTH

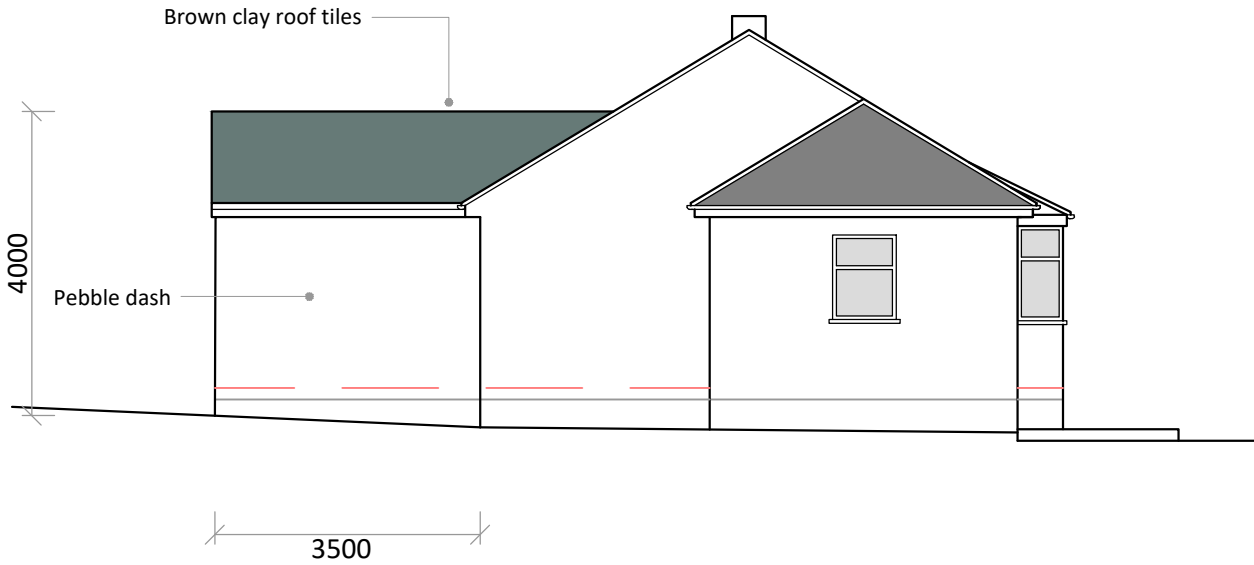


WEST

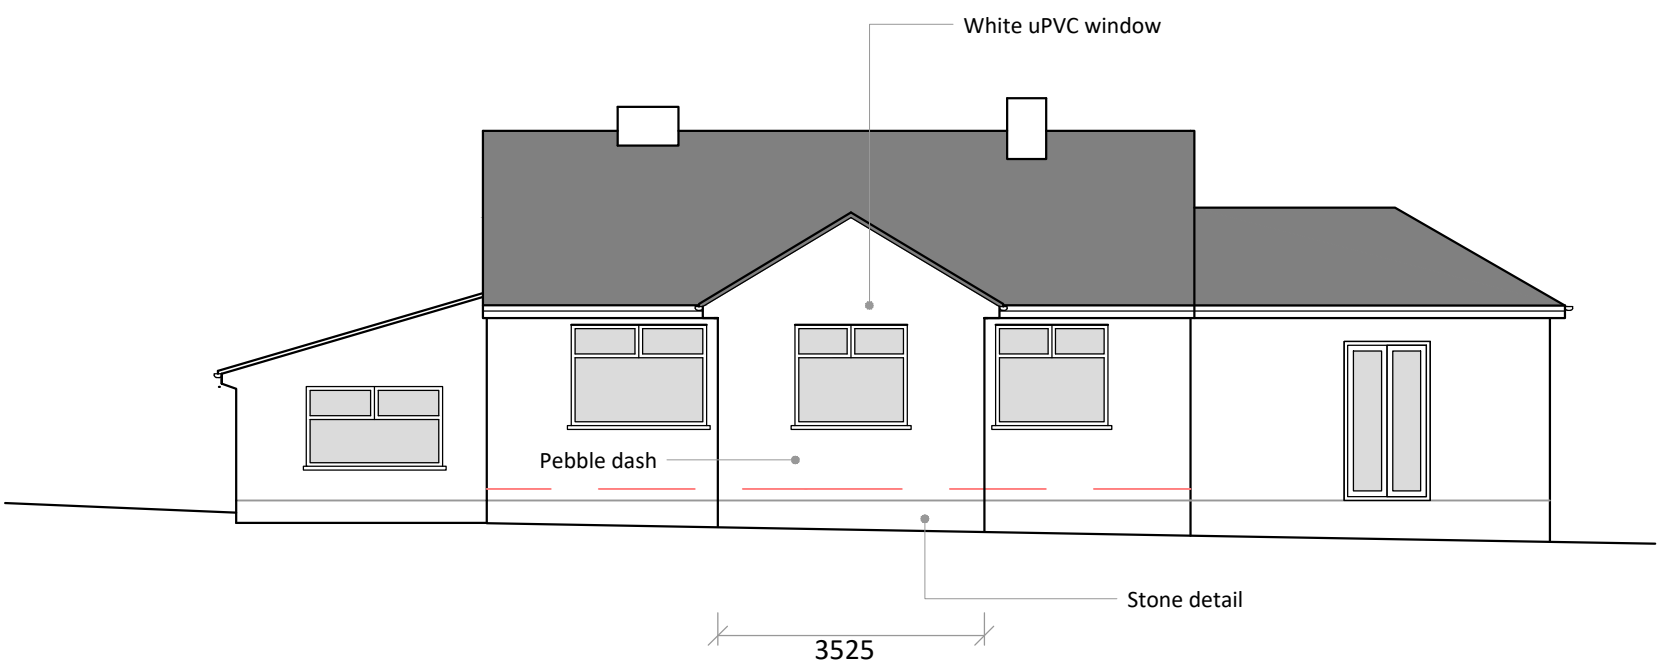

LOCATION PLAN 1:1250



SITE PLAN 1:200

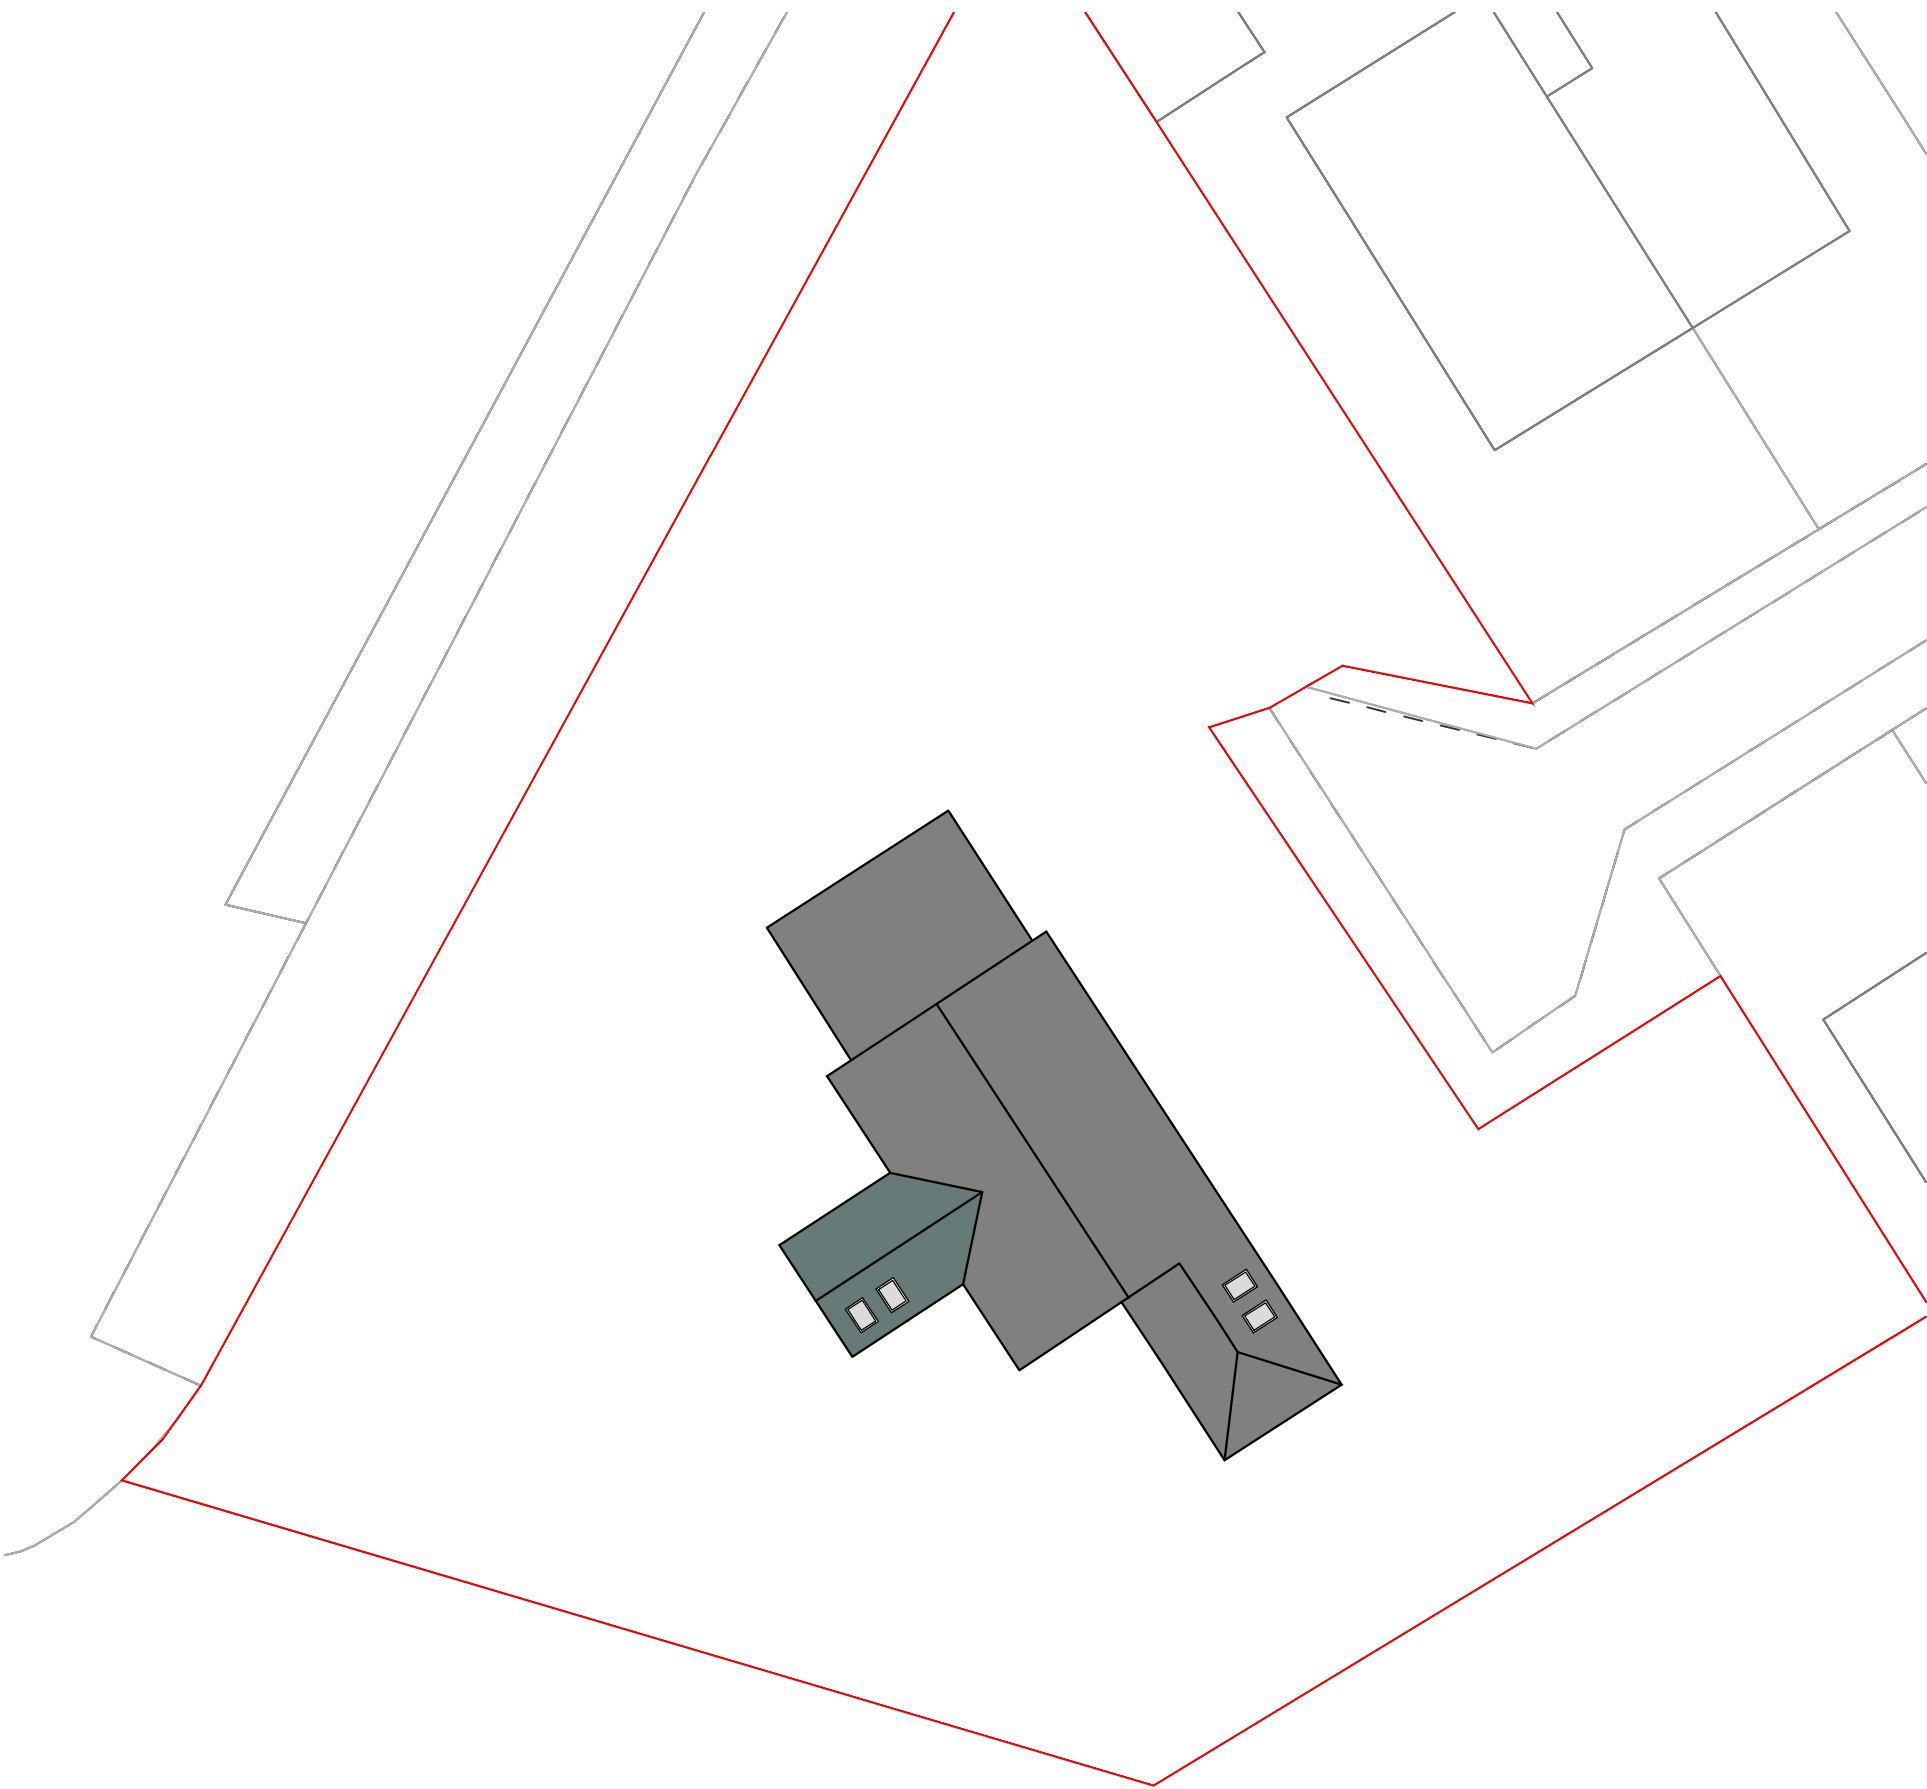

PLANNING NOTE - SINGLE STOREY EXTENSION

An extension or addition to your house is considered to be permitted development, not requiring an application for planning permission, provided certain limits and conditions are met.

- No more than half the area of land around the "original house" would be covered by additions or other buildings. Sheds and other outbuildings must be included when calculating the 50 per cent limit.
- No extension forward of the principal elevation or side elevation fronting a highway. 5. Materials to be similar in appearance to the existing house.
- Side extensions to be single storey. Width of side extension must not have a width greater than half the width of the original house.
- Side extensions to have a maximum height of four metres and width no more than half that of the original house.
- If the extension is within 2m of a boundary, maximum eaves height should be no higher than 3m to be permitted development.
- Single-storey rear extensions must not extend beyond the rear wall of the original house by more than 4m if a detached house; or more than 3m for any other house. Where not on designated land (Article 2(3)) or a Site of Special Scientific Interest, this limit is increased to 8m if a detached house; or 6m for any other house.
- Maximum height of a single-storey rear extension of 4m.
- Maximum eaves and ridge height of extension no higher than existing house.

THERMAL BRIDGING

Care shall be taken to limit the occurrence of thermal bridging in the insulation layers caused by gaps within the thermal element, (i.e. around windows and door openings). Reasonable provision shall also be made to ensure the extension is constructed to minimise unwanted air leakage through the new building fabric.

MATERIALS AND WORKMANSHIP

All works are to be carried out in a workmanlike manner. All materials and workmanship must comply with Regulation 7 of the Building Regulations, all relevant British Standards, European Standards, Agreement Certificates, Product Certification of Schemes (Kite Marks) etc. Products conforming to a European technical standard or harmonised European product should have a CE marking.

SITE PREPARATION

Ground to be prepared for new works by removing all unsuitable material, vegetable matter and tree or shrub roots to a suitable depth to prevent future growth. Seal up, cap off, disconnect and remove existing redundant services as necessary. Reasonable precautions must also be taken to avoid danger to health and safety caused by contaminants and ground gases e.g. landfill gases, radon, vapours etc. on or in the ground covered, or to be covered by the building.

EXISTING STRUCTURE

Existing structure including foundations, beams, walls and lintels carrying new and altered loads are to be exposed and checked for adequacy prior to commencement of work and as required by the Building Control Officer.

BEAMS

Supply and install new structural elements such as new beams, roof structure, floor structure, bearings, and padstones in accordance with the Structural Engineer's calculations and details. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire 5 or similar intumescent paint to provide 1/2 hour fire resistance as agreed with Building Control. All fire protection to be installed as detailed by specialist manufacturer.

LINTELS

- For uniformly distributed loads and standard 2 storey domestic loadings only. Lintel widths are to be equal to wall thickness. All lintels over 750mm sized internal door openings to be 65mm deep pre-stressed concrete plank lintels. 150mm deep lintels are to be used for 900mm sized internal door openings. Lintels to have a minimum bearing of 150mm on each end. Any existing lintels carrying additional loads are to be exposed for inspection at commencement of work on site. All pre-stressed concrete lintels to be designed and manufactured in accordance with BS EN 1992-1-1, with a concrete strength of 50 or 40 N/mm² and incorporating steel strands to BS 5896 to support loadings assessed to BS 5977 Part 1.

For other structural openings provide proprietary insulated steel lintels suitable for spans and loadings in compliance with Approved Document A and lintel manufacturer's standard tables. Stop ends, DPC trays and weep holes to be provided above all externally located lintels.

Independent lintels to have an insulated cavity closure between the inner and outer lintel. Common leaf lintels base plates should not be continuous and the lintel core to be insulated.

TRENCH FOUNDATION

Provide 750mm x 600mm trench fill foundations, concrete mix to conform to BS EN 206 and BS 8500-2. All foundations to be a minimum of 1000mm below ground level, exact depth to be agreed on site with Building Control Officer to suit site conditions. All constructed in accordance with 2010 Building Regulations A1/2 and BS 8004 Code of Practice for Foundations. Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions or difference in soil type be found or any major tree roots in excavations, the Building Control Officer is to be contacted and the advice of a structural engineer should be sought.

TIMBER SUSPENDED FLOOR

To meet min U value required of 0.18 W/m²K. gk not more than 0.5

Ground preparation - Remove top soil and vegetation, apply total weed killer and 150mm min thick sand blinded hardcore, then either –

- Provide concrete ground cover of at least 100mm thick or
- Prepare the ground to an even surface and lay a ground cover of concrete at least 50mm thick, on a damp-proof membrane of at least 1200 gauge polyethylene, laid on a bed of fine blinding material.

Floor construction - min 20mm tongue and groove softwood boards or moisture resistant particle/chipboard grade type C4 to BS EN 312:2010 as required. Lay with staggered joints on 47mm x 170mm C24 grade soft wood joists at maximum 400mm centres, max span 3.77m. Joists to be supported off proprietary galvanized joist hangers built into new masonry walls or fixed to treated timber wall plates resin bolted to walls at 600mm centres. If required, floor joists also to be supported on 100mm x 50mm treated wall plates and DPC fixed to masonry honeycombed sleeper walls built on thickened oversite concrete. Joists to be infilled with 130mm Celotex XR4000 insulation between joists fixed with Celotex clips.

BUILDING REGULATION DRAWINGS

9 Ferndale Avenue
Peak Dale
Buxton
High Peak
SK17 8AZ

Single Storey Rear Extension

Revision	Date
Drawing Ref 9FA/BR/01	Date 20th February 2023

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.



18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210

info@plansanddesign.co.uk