

EXISTING PLANS 1:100

GROUND FLOOR

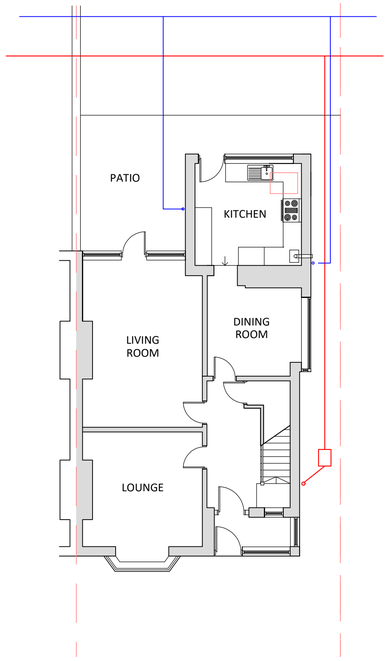

ROOF PLAN

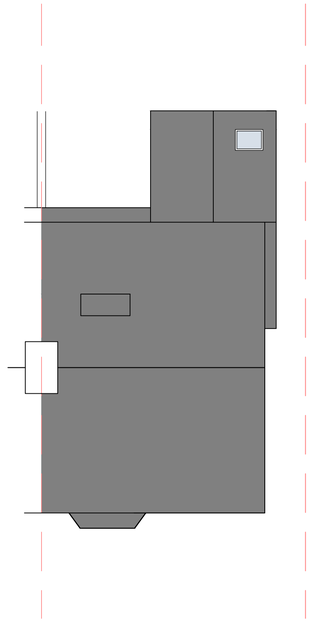



PROPOSED PLANS 1:100

ROOF PLAN



PROPOSED PLAN 1:50

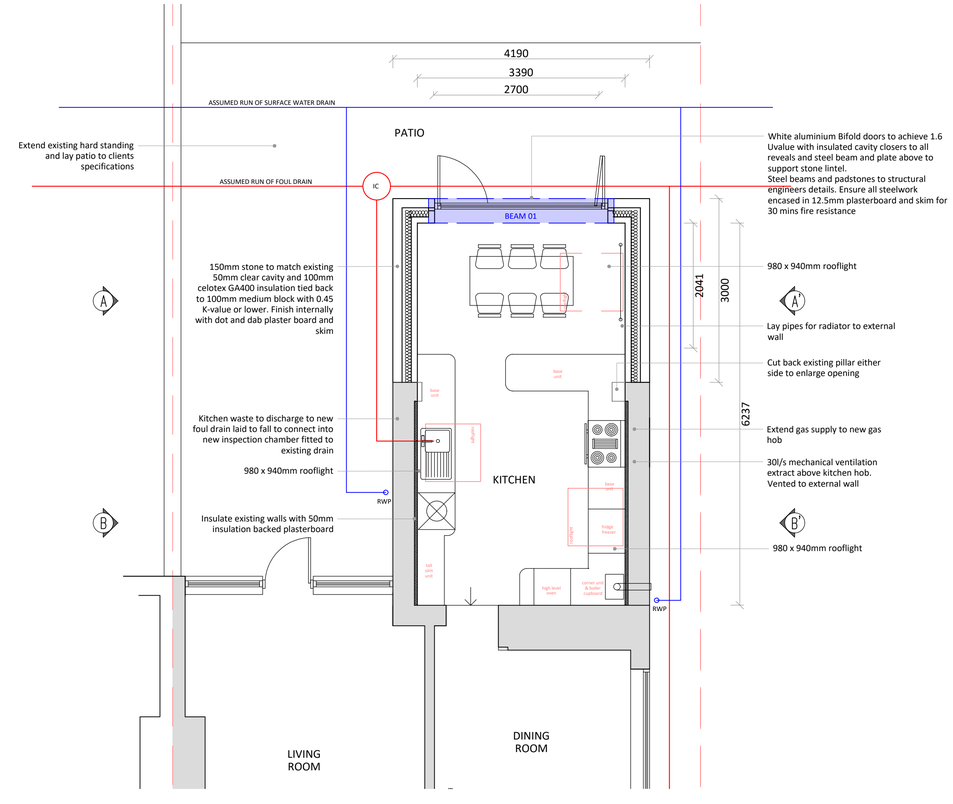

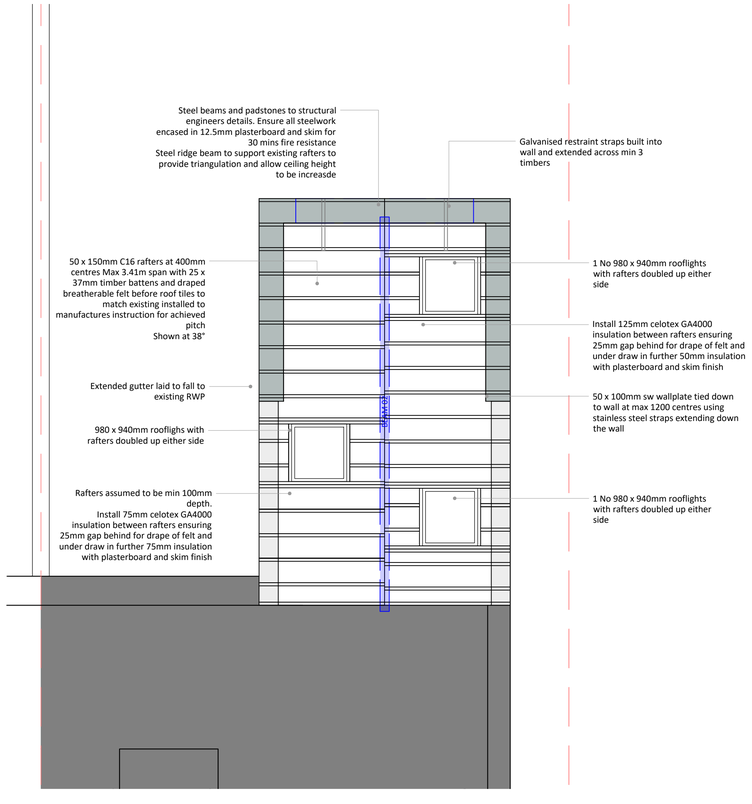

ELECTRICAL

All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a Competent Person registered under a Competent Person Self Certification Scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

INTERNAL LIGHTING

Install low energy light fittings that only take lamps having a luminous efficiency better than 80 lumens per circuit watt. All fixed to have lighting capacity (lm) 185 x total floor area, to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

HEATING

Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.

The energy performance of the new components to be assessed. The results should be recorded and given to the building owner.All accessible pipes to be insulated to the standards in Table 4.4 Approved Document L.

ROOF LIGHTS

Min U-value of 2.2 W/m²K.

Roof-lights to be double glazed with16mm argon gap and soft low-E glass. Roof lights to be fitted in accordance with manufacturer's instructions, with rafters doubled up to sides and suitable flashings provided.

NEW AND REPLACEMENT WINDOWS

New and replacement windows to be double glazed with 16-20mm argon gap and soft coat low-E glass. Window Energy Rating to be Band B or better and to achieve U-value of 1.4 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals.

Windows and door frames to be taped to surrounding openings using air sealing tape.

Windows to be fitted with trickle vents to provide adequate background ventilation in accordance with Approved Document F.

NEW AND REPLACEMENT DOORS

New and replacement doors to achieve a U-Value of 1.4W/m²K. Glazed areas to be double glazed with 16-20mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K of the current Building Regulations. Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals. Windows and door frames to be taped to surrounding openings using air sealing tape.

EXTRACT TO KITCHEN

Kitchen to have mechanical ventilation with an extract rating of 60 l/s, or 30 l/s if adjacent to hob to external air. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. Cooker hoods to BS EN 13141-3. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

BACKGROUND VENTILATION

Controllable background ventilation at least 1700mm above floor level to be provided to habitable rooms and kitchens at a rate of min 8,000mm², and to bathrooms at a rate of min 4000mm²,

Total number of ventilators installed in a dwellings habitable rooms to be at least 4 ventilators for one bedroom dwellings and 5 ventilators for dwellings with more than one bedroom.

Background ventilators to be tested to BS EN 13141-1.

Background ventilator equivalent area and operation to be measured and recorded.

Noise attenuating background ventilators should be fitted to facades with sustained loud noise.

Where the extension connects to in an existing room and as a result the existing room is left with no windows or background ventilation less than 5000mm², then the new room background ventilation to be at least 10,000mm² equivalent area.

Where the extension connects to in an existing room and as a result the existing room is left with background ventilation at least 5000mm², then both the following is to be provided:

- Background ventilators of at least 12,000mm² equivalent area should be provided between the two rooms.
- Background ventilators of at least 12,000mm² equivalent area between the additional room and the outside.

PURGE VENTILATION

Minimum total area of opening in accordance with Table 1.4 Approved Document F1. Hinged or pivot windows with an opening angle of 15 to 30 degrees to have an openable area in excess 1/10 of the floor area of the room. External doors and sash, hinged or pivot windows with an opening angle of equal to or greater than 30 degrees to have an openable area in excess of 1/20 of the floor area of the room. Purge ventilation should be capable of extracting at least 4 air changes per hour per room directly to the outside. Internal doors should be provided with a 10mm gap below the door to aid air circulation.

C2. CONDENSATION

Walls, floors and roof of the building to be designed and constructed so that their structural and thermal performance will not be adversely affected by interstitial condensation, surface condensation or mould growth. Account to be taken of the building's form and orientation in relation to topography, prevailing winds, sunlight and over-shadowing, and the rate at which humidity is generated. Materials with the highest vapour resistance should be located on the warm side of a thermal element. VCLs to be provided where necessary. The junctions between elements are designed to Accredited Construction Details or guidance of BRE IP17/01] and BS 5250:2021 Management of moisture in buildings to be followed.

ABOVE GROUND DRAINAGE

All new above ground drainage and plumbing to comply with BS EN 12056-2 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti-vac bottle traps and rodding eyes to be provided at changes of direction. Size of wastes pipes and max length of branch connections (if max length is exceeded then anti-vac traps to be used).

Wash basin - 1.7m for 32mm pipe 3m for 40mm pipe.

Bath/shower - 3m for 40mm pipe 4m for 50mm pipe.

WC - 6m for 100mm pipe for single WC.

All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m. Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting. Waste pipes not to connect on to SVP within 200mm of the WC connection. Supply hot and cold water to all fittings as appropriate.

PIPEWORK THROUGH WALLS

Where new pipework passes through external walls the pipework is to be provided with 'rocker pipes' at a distance of 150mm either side of the wall face. The 'rocker pipes' must have flexible joints and be a maximum length of 600mm. Alternatively provide 75mm deep pre-cast concrete plank lintels over drain to form an opening in the wall which gives 50mm space all round pipe. Mask the opening both sides with rigid sheet material and compressible sealant to prevent entry of fill or vermin.

BUILDING REGULATION DRAWINGS

43 Buxton Road
Chinley
High Peak
SK23 6DJ

Single Storey Rear Extension

Revision	Date
A - Rooflights	19.03.24

Drawing Ref	Date
43BR/BR/02/A	6th March 2024

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECCTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.

PLANS + DESIGN
Architectural Drawing

18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210

info@plansanddesign.co.uk