


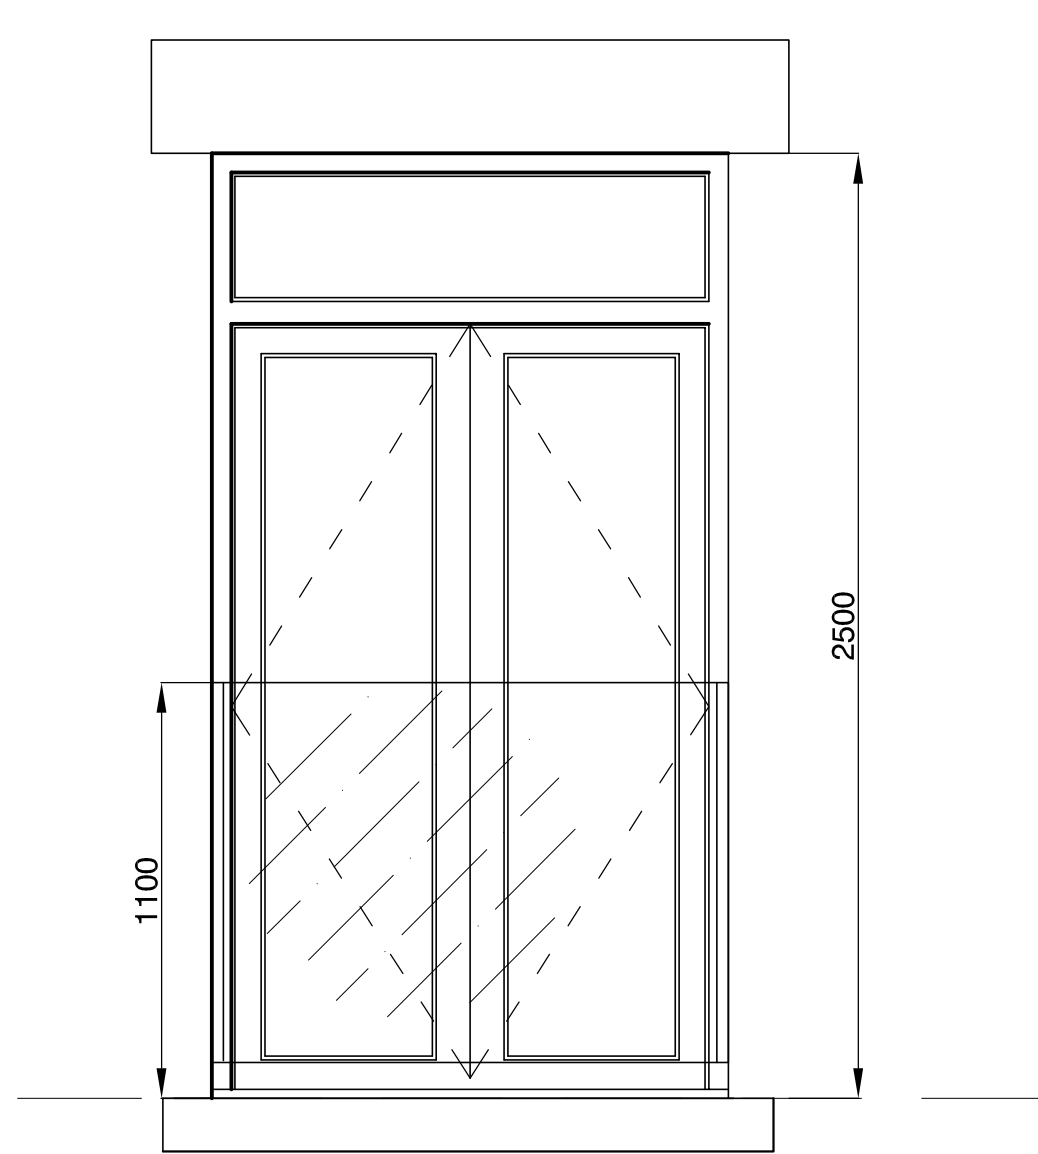


EXISTING WINDOW OPENING - CILL DROPPED TO FORM DOORWAY OPENING. EXISTING CILL RE-USED.


TRIPLE GLAZED DOORS, OPENING INWARDS, WITH FIXED WINDOW ABOVE.

GLAZED GUARDING WITH NO HANDRAIL. FIXED TO THE SIDES ONLY.

DG.01 Scale 1:20

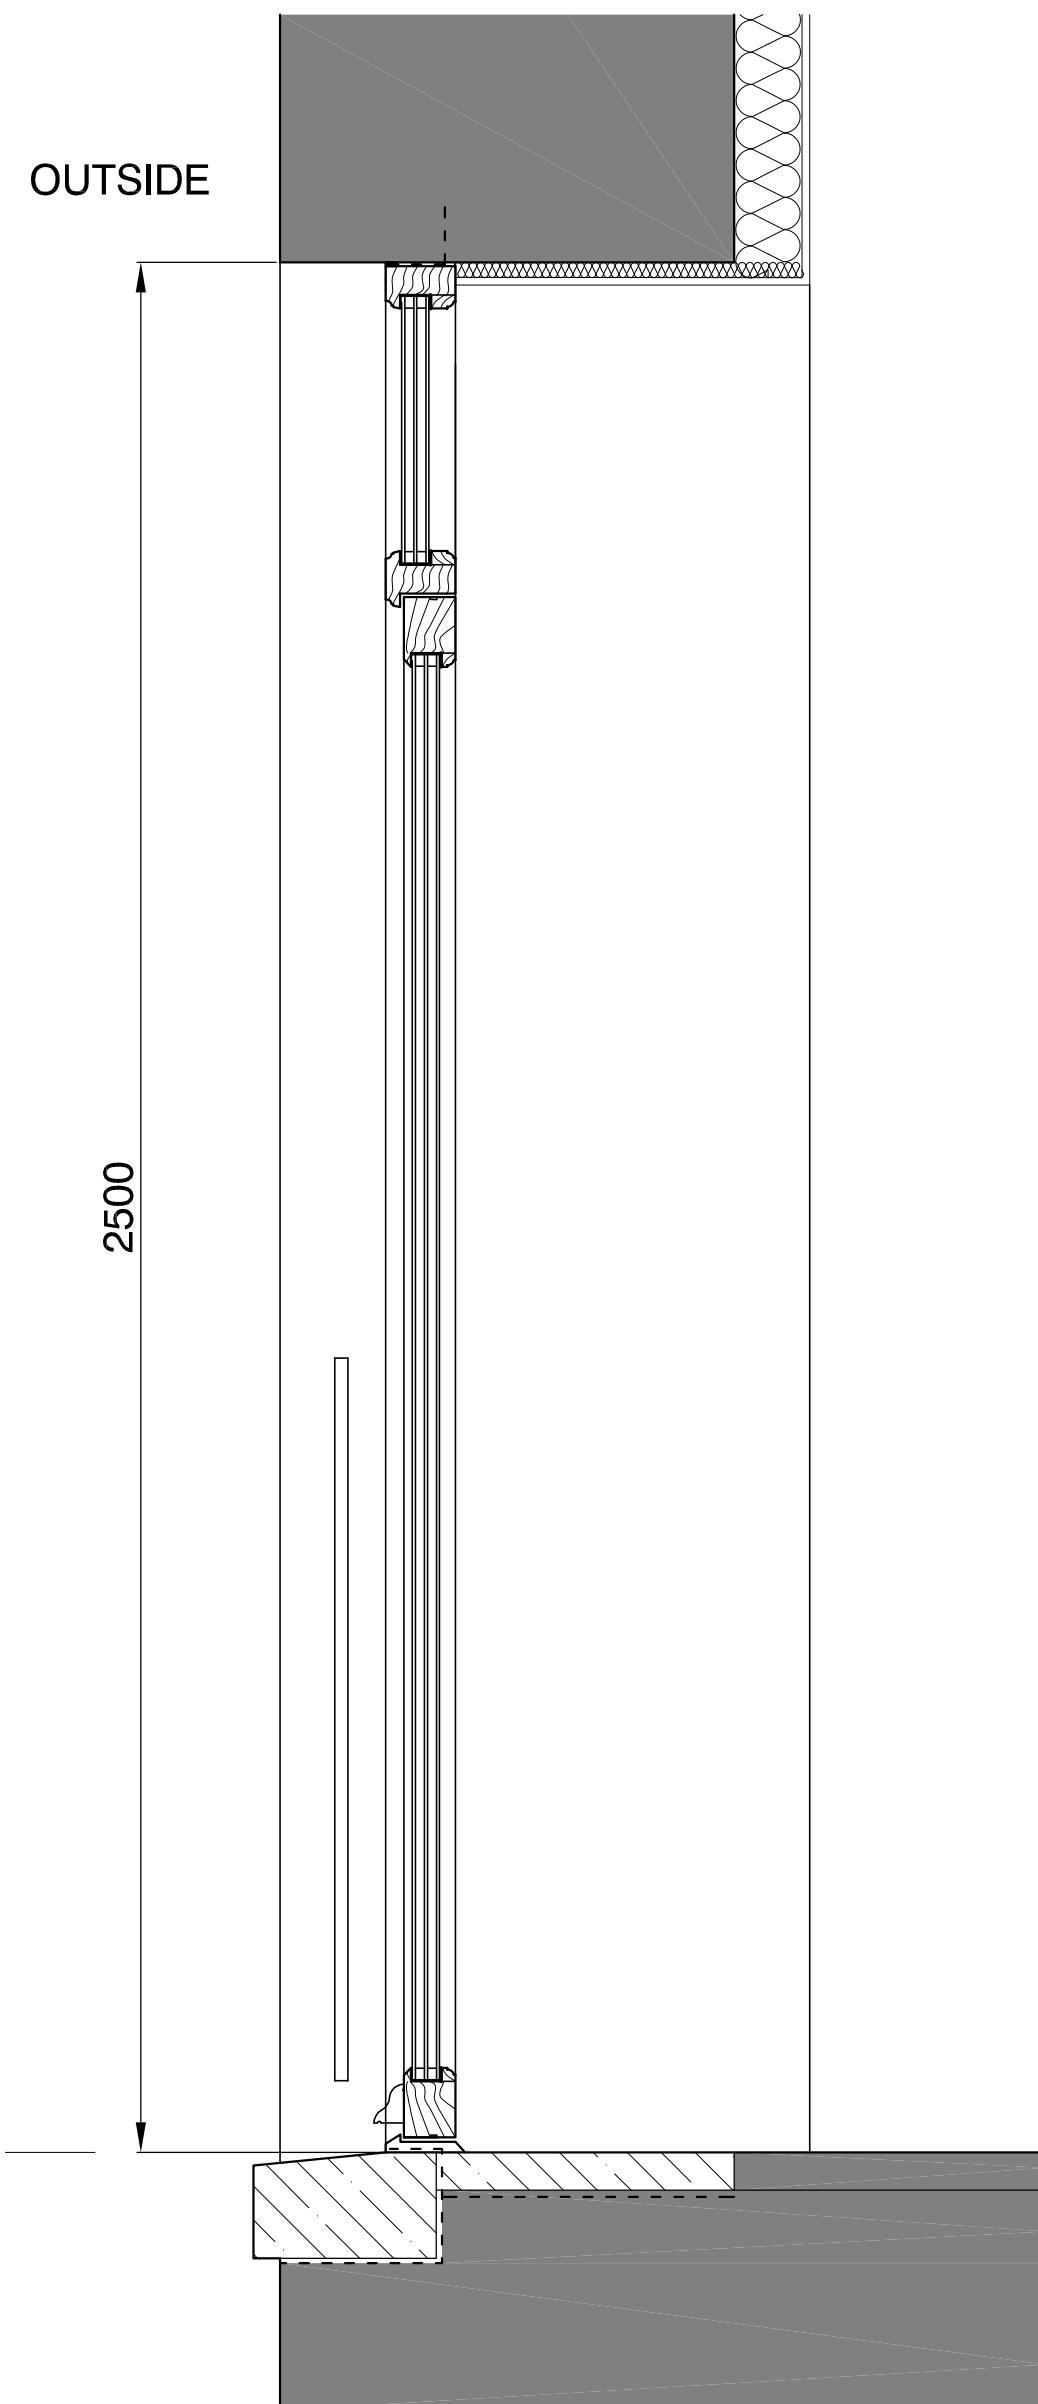


DG.01 Section Scale 1:10

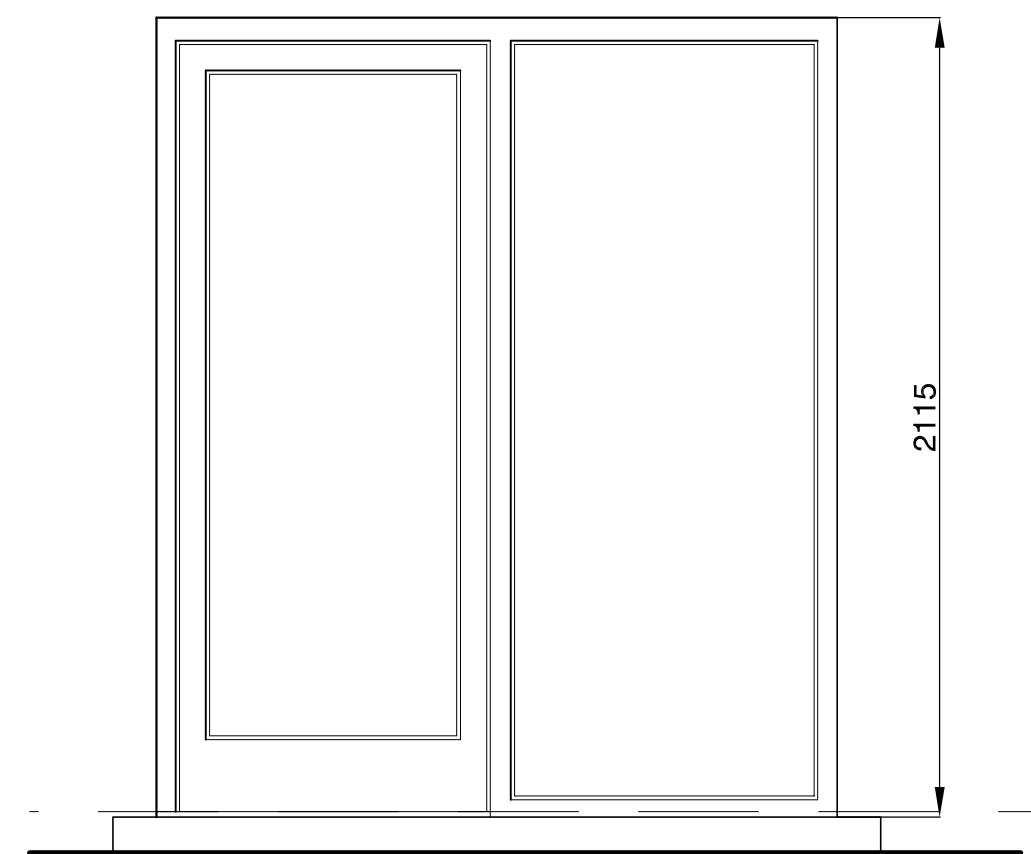


PAINTED TIMBER TRIPLE GLAZED DOOR AND SIDE SCREEN IN NEW OPENING TO EXTENSION WALL.

838MM DOOR LEAF


DG.02 Scale 1:20

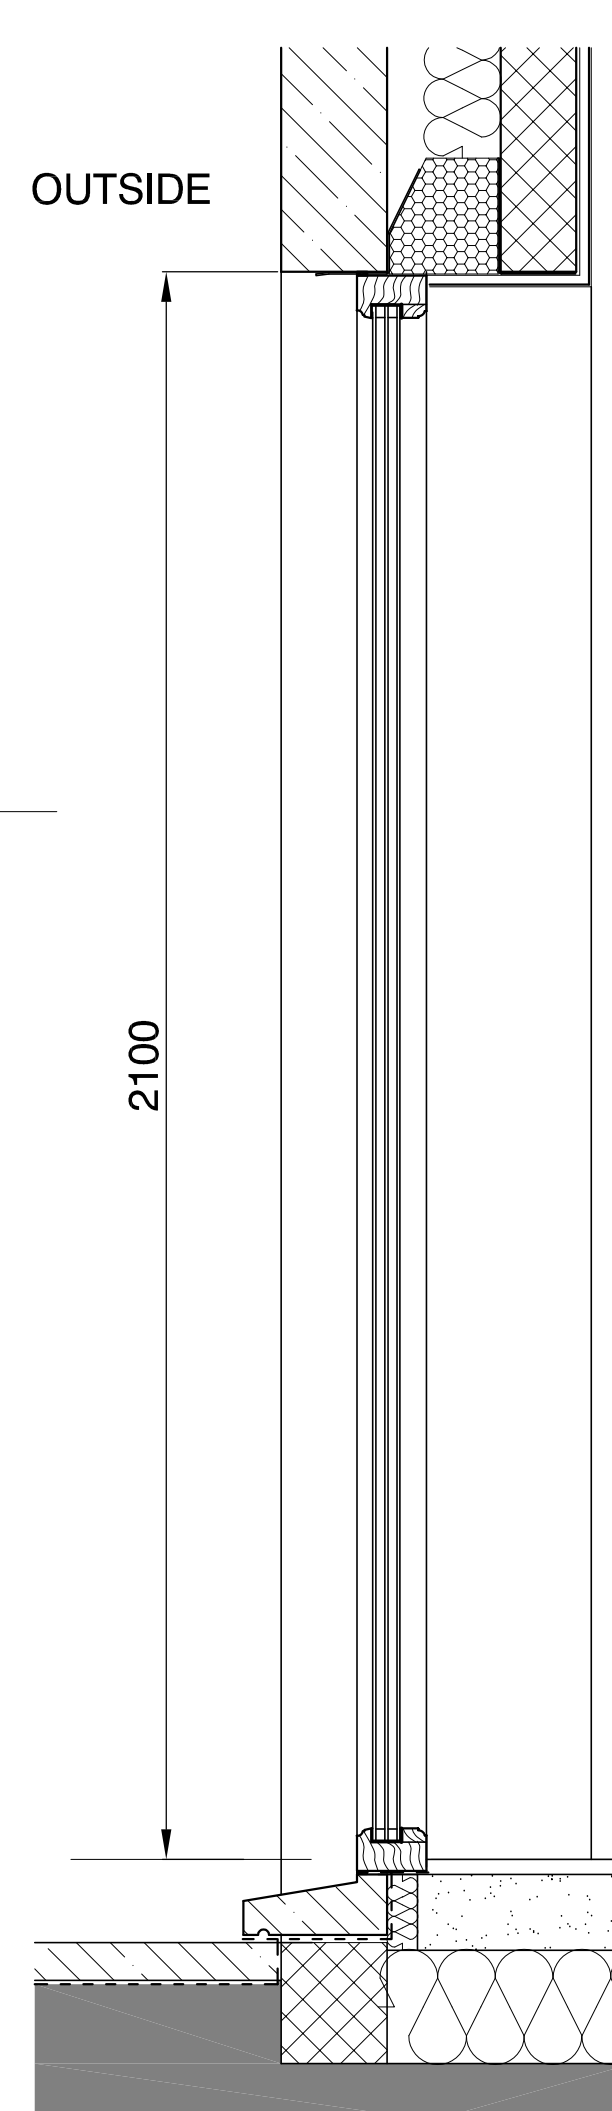

DG.02 Section Scale 1:10

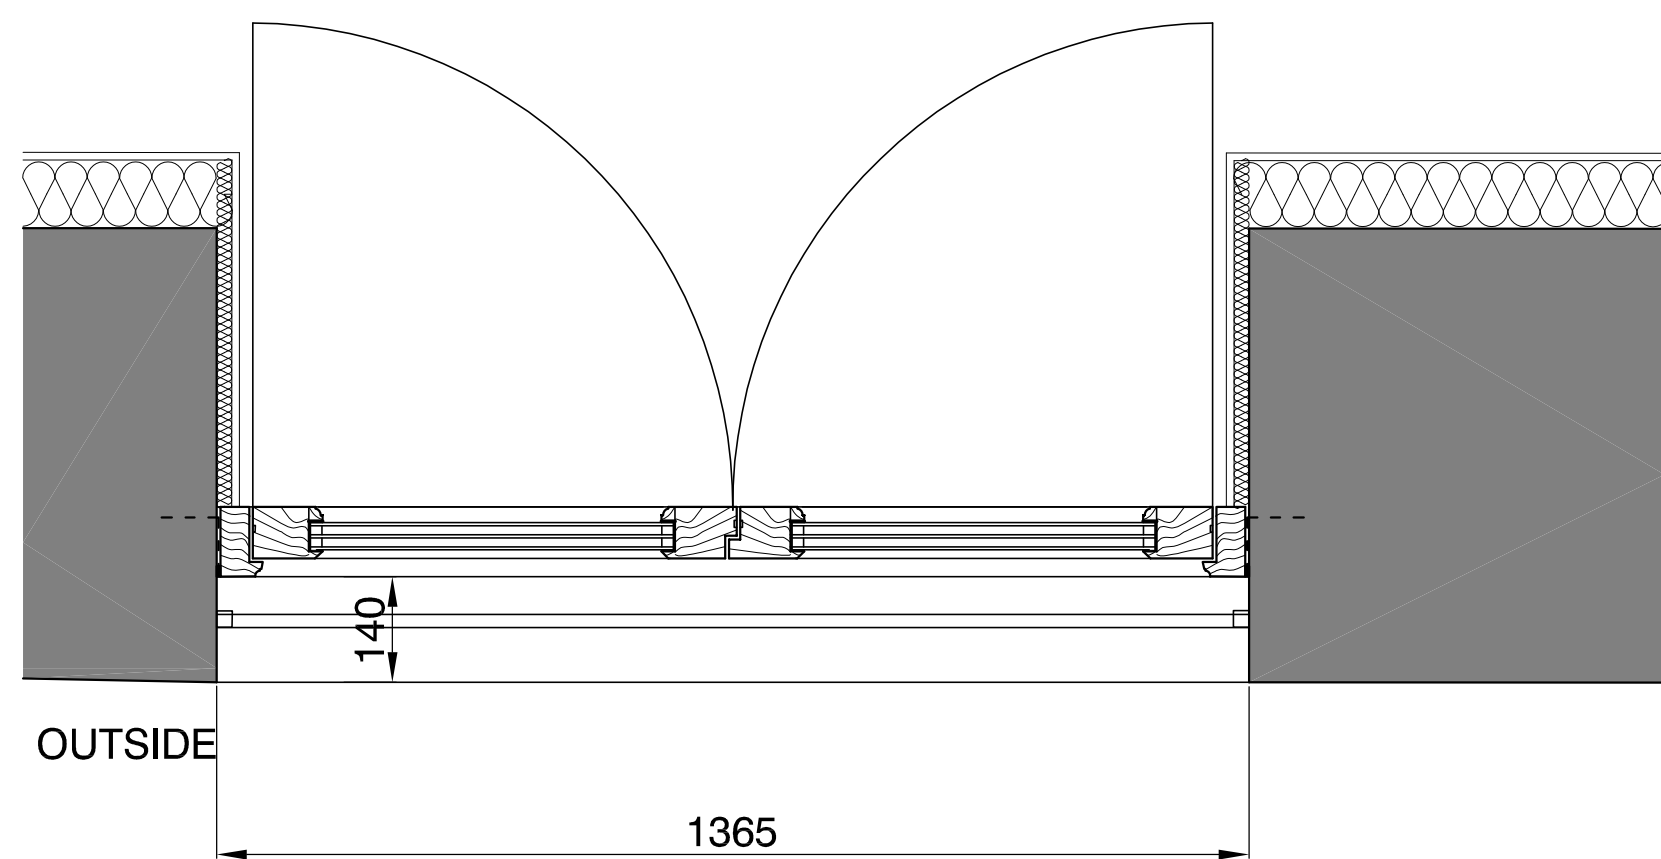

DG.01 Plan Scale 1:10

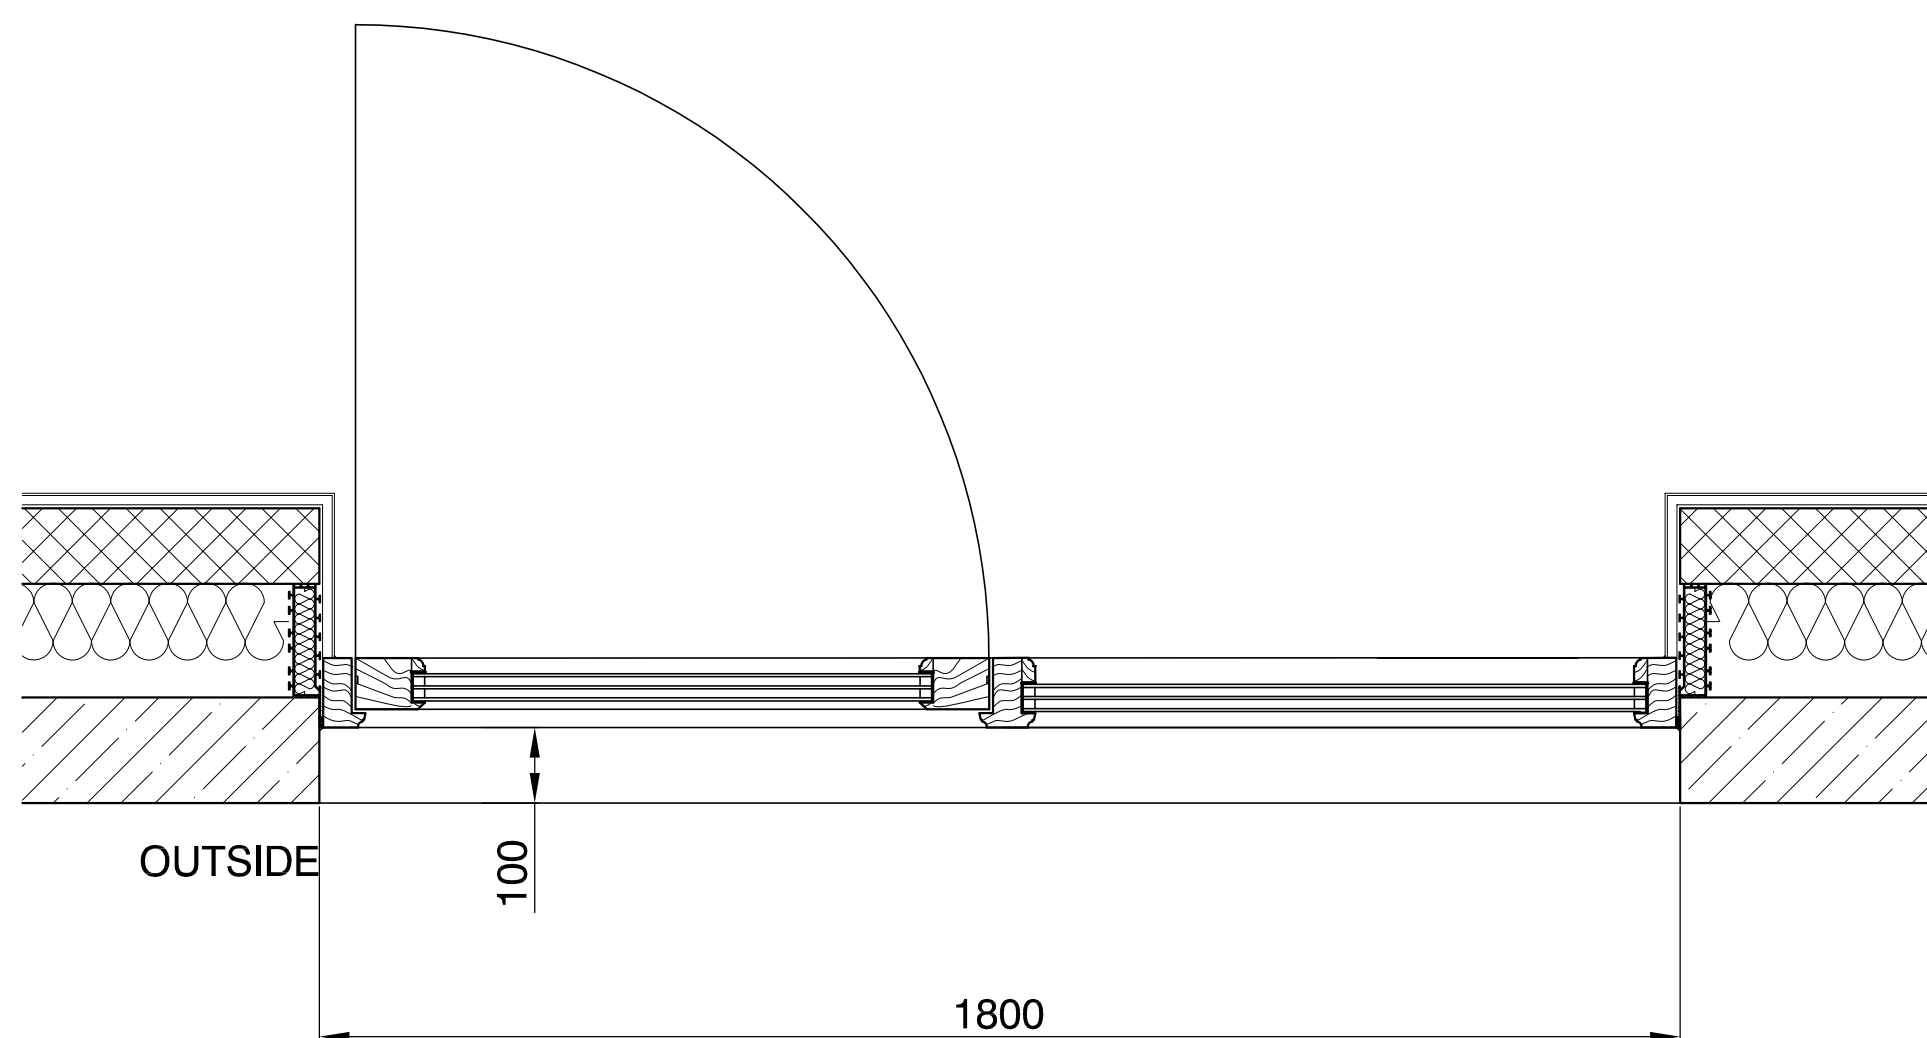

DG.02 Plan Scale 1:10

GENERAL NOTES:

All structural openings to be checked by manufacturer prior to manufacture.

Doors to have stormproof hinges and weatherseals. Weatherproof threshold to manufacturer detail. Metal threshold strips to be thermally broken.

No trickle vents to doors unless it is found there is insufficient background ventilation from windows.

Glazing to be triple glazed to achieve a minimum of 1.2W/m2k.

All windows and doors to be high performance Accoya / hardwood, primed in the factory. If full factory glazed allow finish of 3 coats microporus paint. Black colour to doors and windows.

At existing walls, bituminous felt dpc to heads, jambs and cills of all external openings (min 150 girth) pinned forward to all window and door openings. 40mm cork insulation at DPC. Existing window head / lintel retained at DG.01. Internally, woodfibre insulation with lime plaster.

In new masonry cavity walls, Thermabate insulated cavity closer with integral dpc. Thermally broken Catnic or similar lintel.

No mastic sealant - use iso chemie breathable sealing tape all around opening. Exact detail tbc once opening up work carried out.

DPC to wrap around stone heads, cills and jambs. Ensure all cills fall away from the window. Window / door frame to be set back min 100mm or to match existing.

Toughened safety glazing to all glazing in windows/ doors below 800mm above floor level and all doors with adjacent windows below 1500mm above FFL. 6.4mm laminated glass to new doors.

All windows and doors within 2m vertically of an accessible surface are to comply with PAS 24:2016, Part Q Building Regulations for security. For bespoke timber doorsets, refer to Part Q, Appendix B. Full point locking sytem with deadbolts.

Detail and weathersealing to be advised by window manufacturer and detail agreed with Conservation officer.

Glazed guarding to DG.01 to be toughened and laminated min 17.5mm thick clear glass. Black aluminium frame at the sides, fixings into the stone side reveals or door frame.
<https://www.julietbalcony.co.uk/glass-juliet-balcony/hilton-aluminium-glass-juliet-balcony/>