


Notes

All dimensions are to be checked on site prior to construction, manufacture of any components and ordering of materials and equipment.

Any discrepancies are to be reported to the architect for clarification.

All materials and workmanship to be in accordance with the current British Standards and codes of practice.

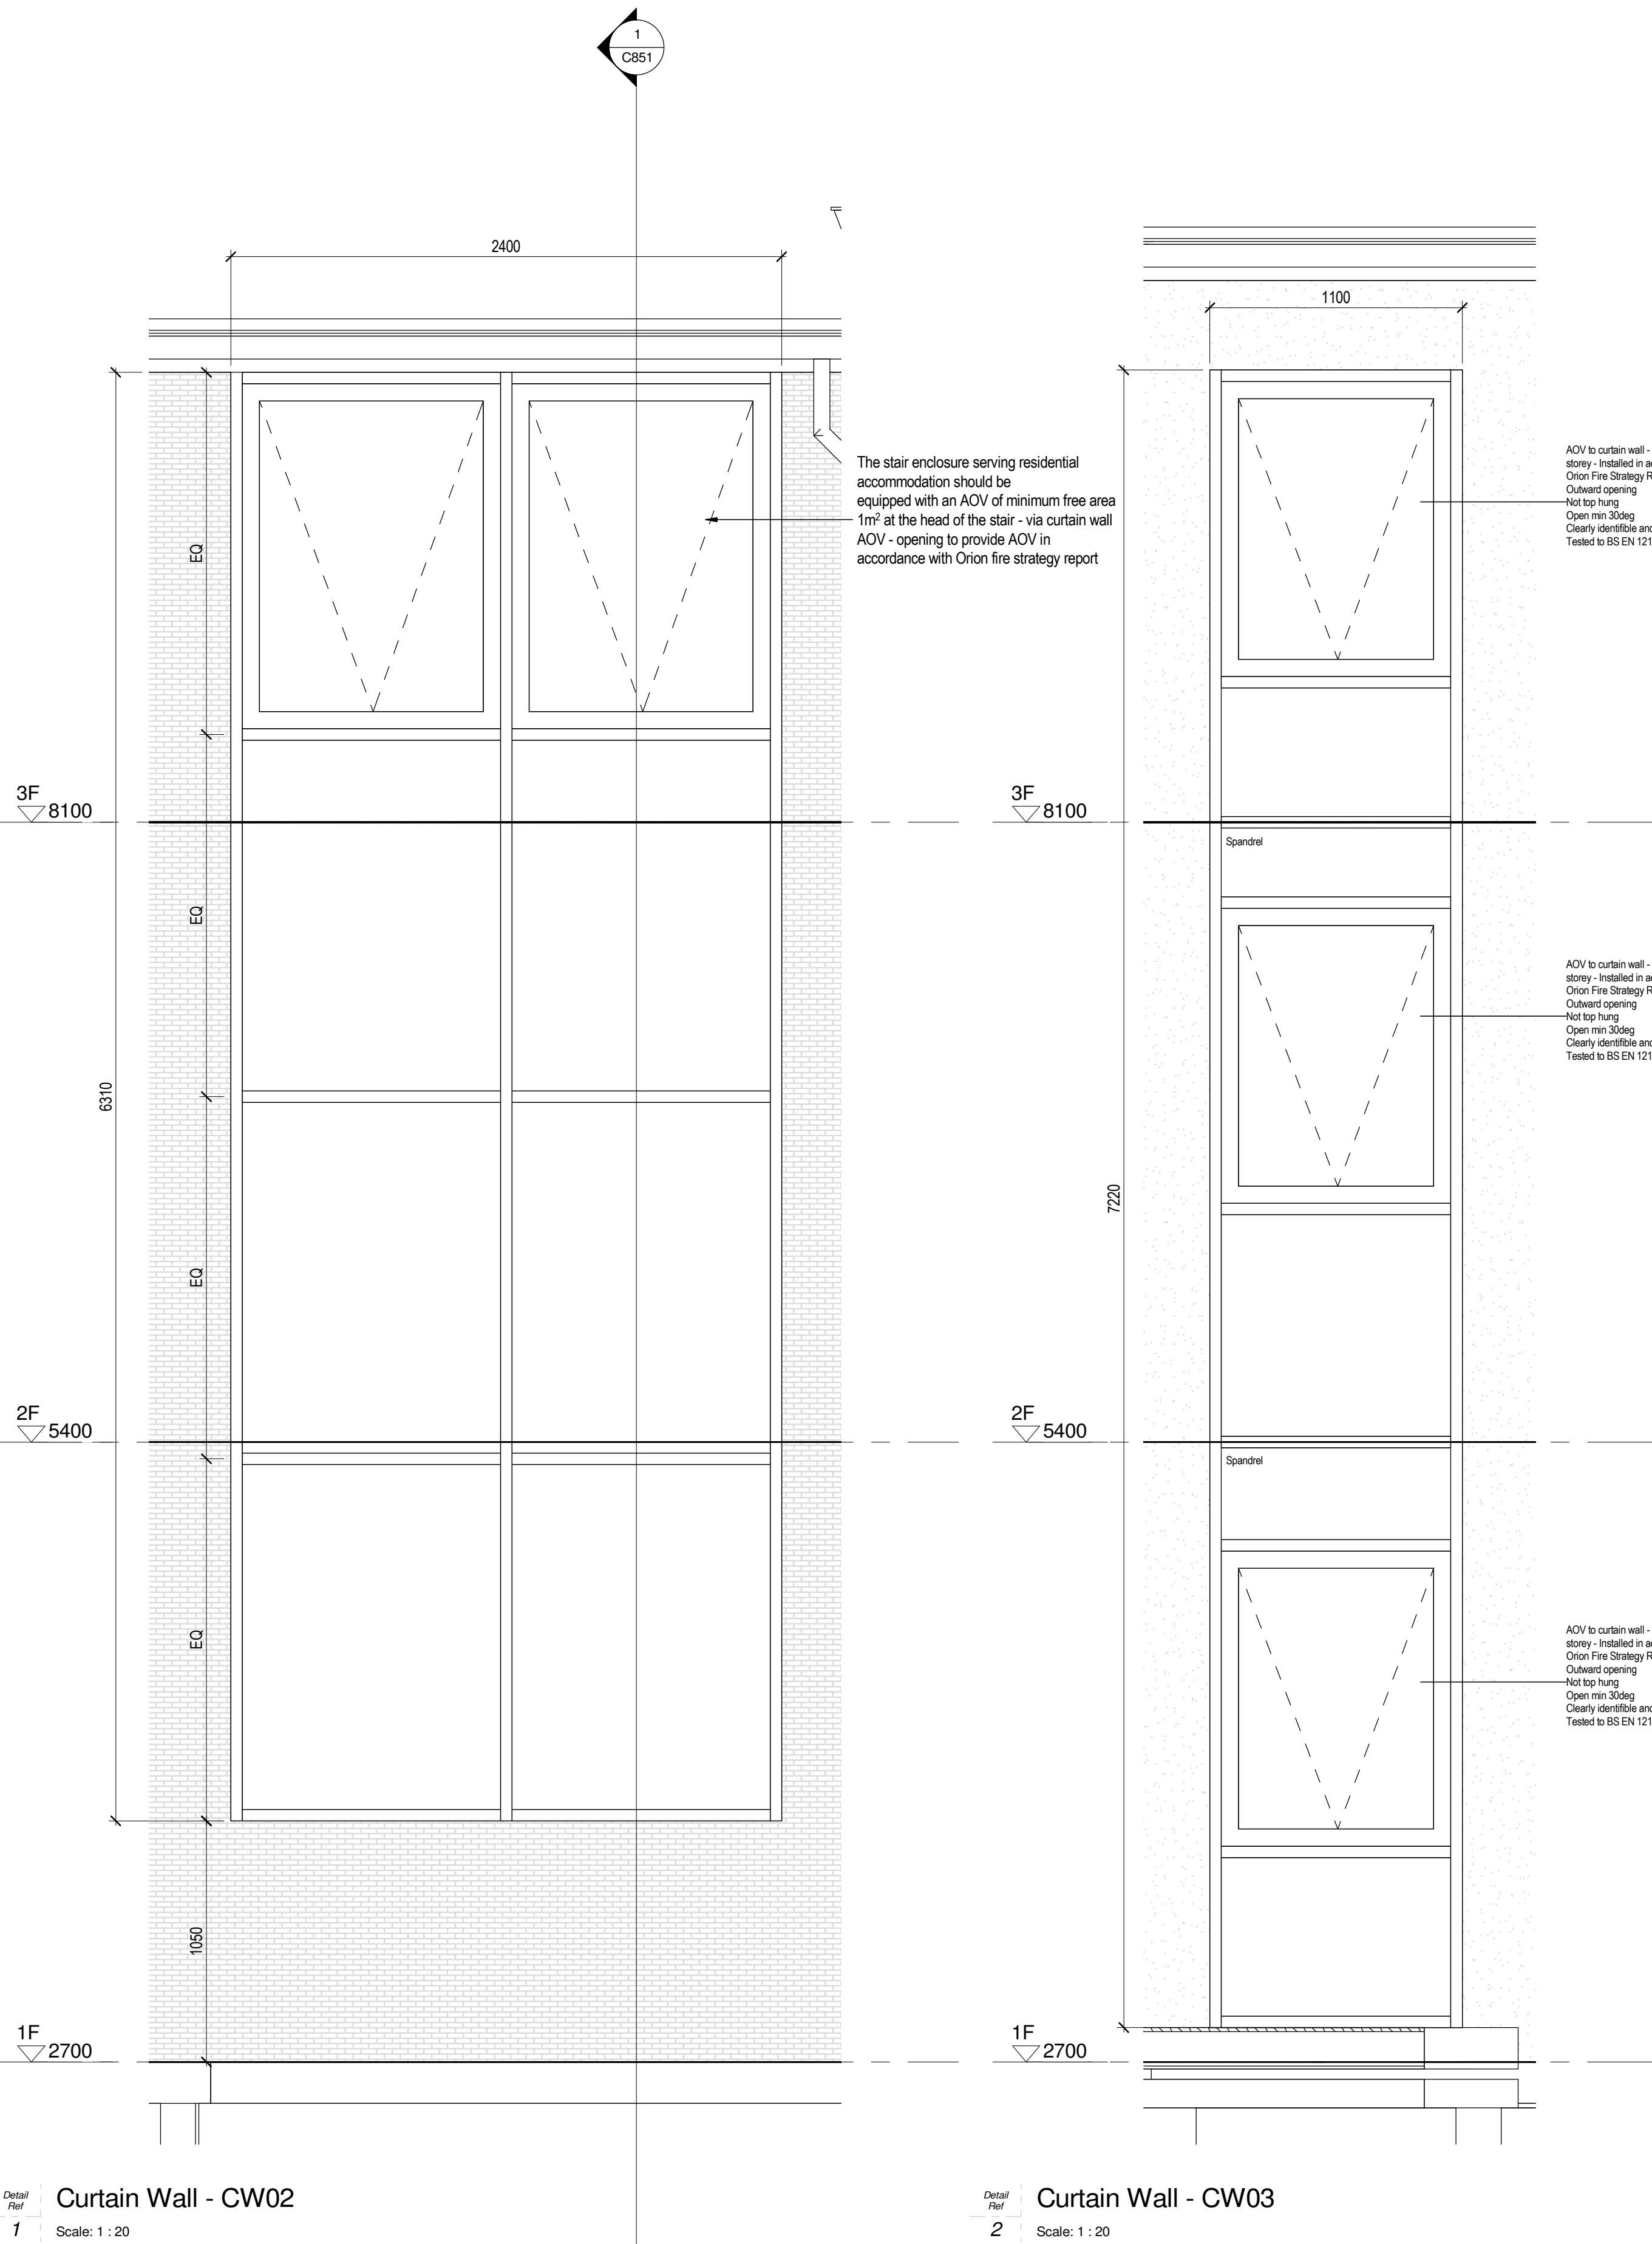

Window Notes:

Curtain walling installed in accordance with suppliers details. NEW FITTINGS WINDOWS TO ACHIEVE U-Value 1.4 W/m²/K

*TBC WITH BUILDING CONTROL AND ENERGY ASSESSOR

HINGES ON OPENINGS TO BE SLIDING FRICTION TYPE, TOP/SIDE HUNG/SASH AS REQUIRED. PROVIDE FROSTED GLASS TO ANY SANITARY ACCOMMODATION.

SAFETY GLASS

ALL SAFETY GLASS TO BE IN ACCORDANCE WITH BS 6206 AND APPROVED DOCUMENT PART K.

ALL AREAS OF GLAZING BELOW 800 MM ABOVE FINISHED FLOOR LEVEL, 1500 MM ABOVE THE SAME LEVEL IN A DOOR OR SIDE PANEL CLOSE TO EITHER EDGE OF A DOOR (300 MM.), SHALL BE CONSIDERED AS CRITICAL LOCATIONS AND SHALL BE GLAZED WITH 6.4 MM LAMINATED SAFETY GLASS. LAMINATED GLASS MUST BE TO BS EN 12600. ALL IN ACCORDANCE WITH APPROVED DOCUMENT PART K.

CONTRACTOR TO INSTALL INTERNAL BARRIER GUARDING TO ALL WINDOWS WITH A CILL BELOW 800MM. GUARDING TO BE IN ACCORDANCE WITH APPROVED DOCUMENT PART K.

GENERAL

SITE DIMENSIONS TO BE TAKEN PRIOR TO MANUFACTURE OF ANY COMPONENTS. MANUFACTURER TO ALLOW FOR ALL REQUIRED TOLERANCES.

U-VALUE PERFORMANCE TO BE IN ACCORDANCE WITH APPROVED DOCUMENT PART L: TABLE 4.2: LIMITING U-VALUES FOR NEW FABRIC ELEMENTS IN EXISTING DWELLINGS = 1.4 W/m² K.

GLAZING TO BE 24MM CLEAR INSULATING DOUBLE GLAZED UNIT TO MANUFACTURER'S SPECIFICATION TO ACHIEVE RELEVANT U-VALUE. OUTER PANE TO BE A MINIMUM OF 6MM CLEAR TOUGHENED SAFETY GLASS, INNER PANE TO BE A MINIMUM OF 6.4MM SOFT COT LOW-E LAMINATED SAFETY GLASS.

WINDOWS TO BE TESTED TO BS 6375-1: 2004 PERFORMANCE OF WINDOWS AND DOORS AND BS 6375-2: 1987 OPERATION AND STRENGTH OF PERFORMANCE.

WINDOWS TO HAVE BRITISH STANDARDS INSTITUTION KITEMARK TO BS 644.

PROVIDE SUITABLE MASTIC SEALANT AROUND FRAMES EXTERNALLY.

B

07.09.23

SHD

Revised to include key for planning

A

21.06.23

SHD

For information

Rev

Date

Drawn By

Comments

Client

Owner

Project

Grove Hotel, Buxton

Drawing

Proposed Curtain Walling

Revision

Purpose

B

For information

Drawing Number

P852

Job No.

SHD/BX-GH-01

Scale

As indicated

Date

June 2023

Suitability

Suitability

Drawn By

SHD

