



EXISTING PLANS 1:100


GROUND FLOOR

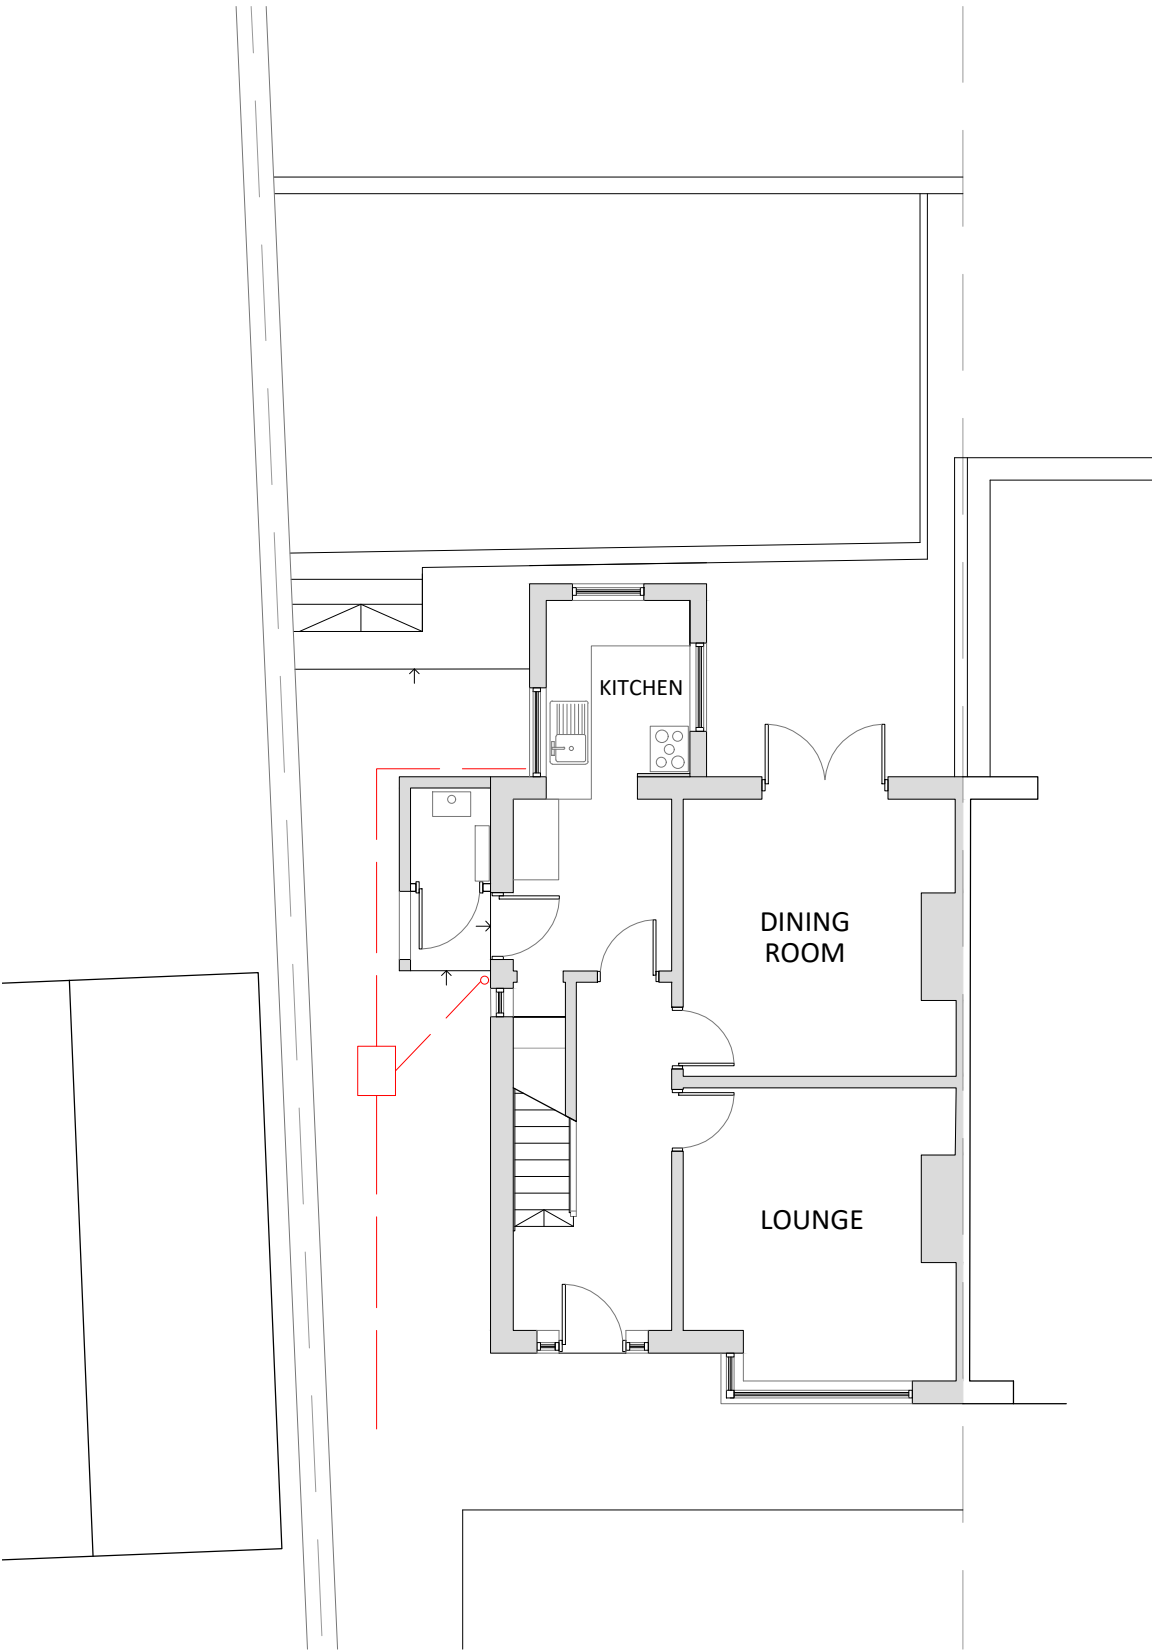

FIRST FLOOR

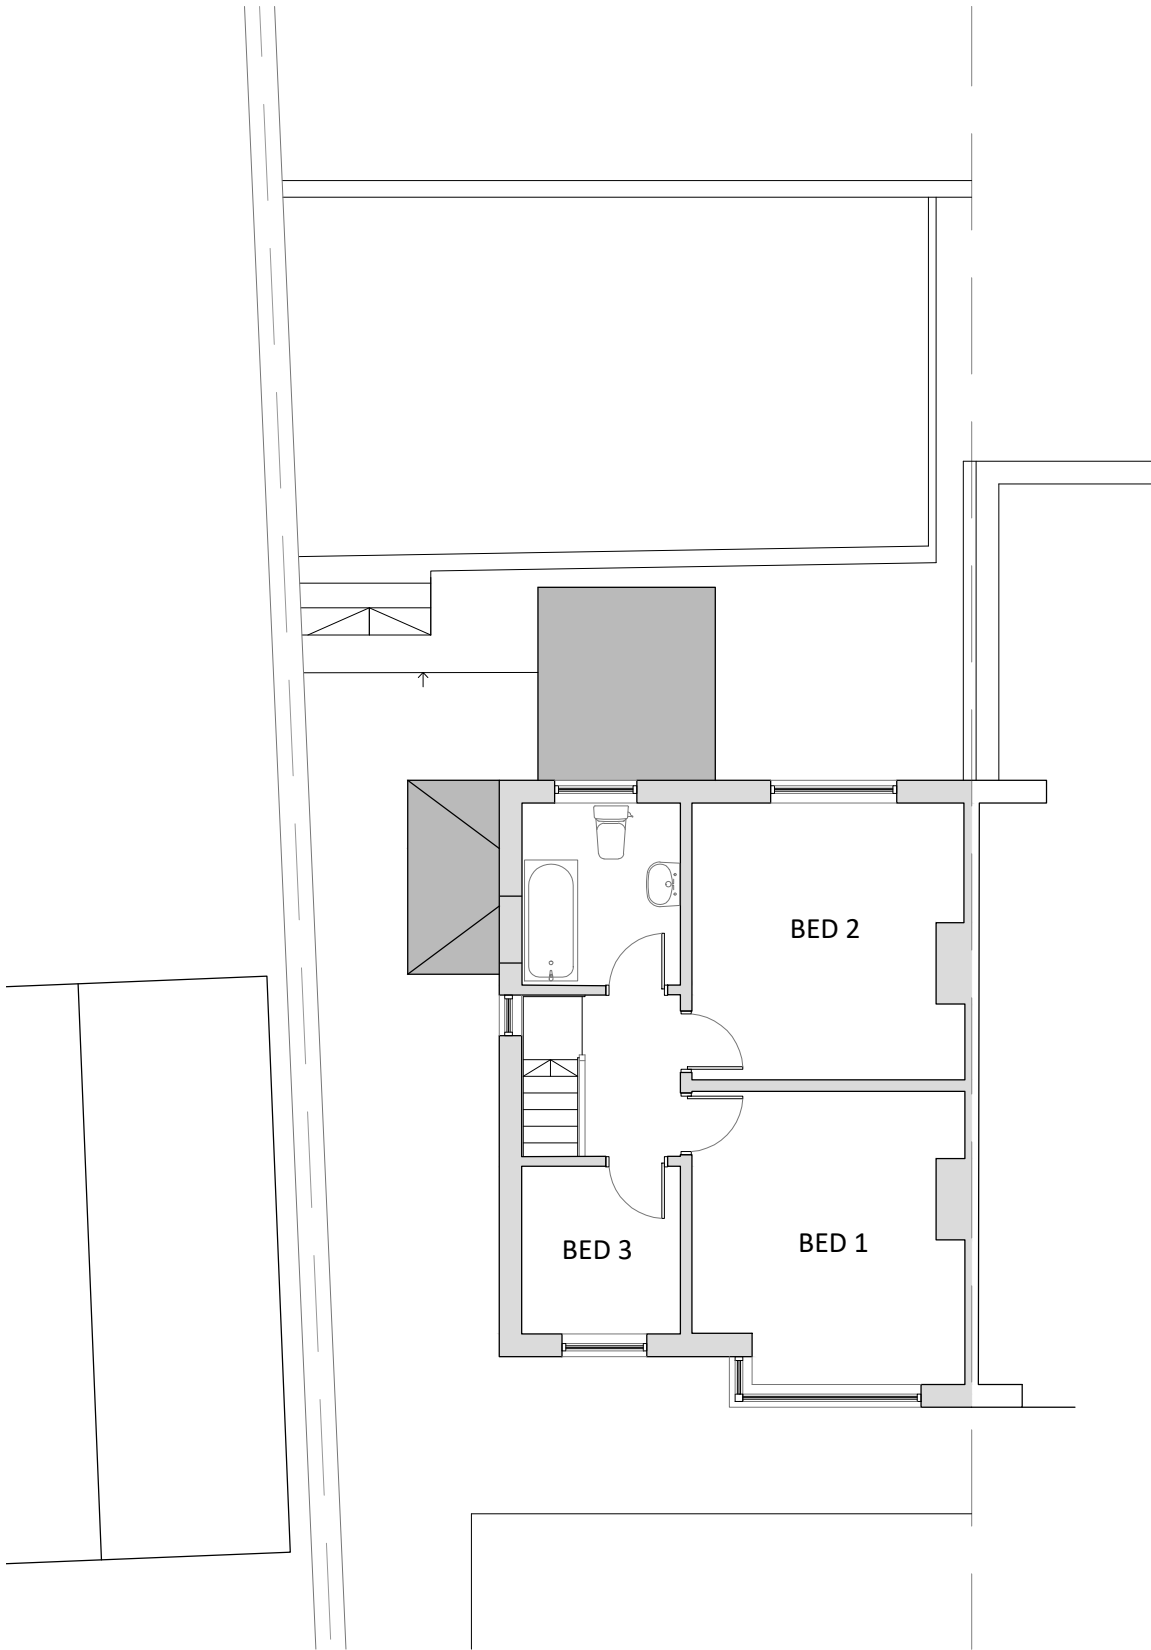


ROOF PLAN

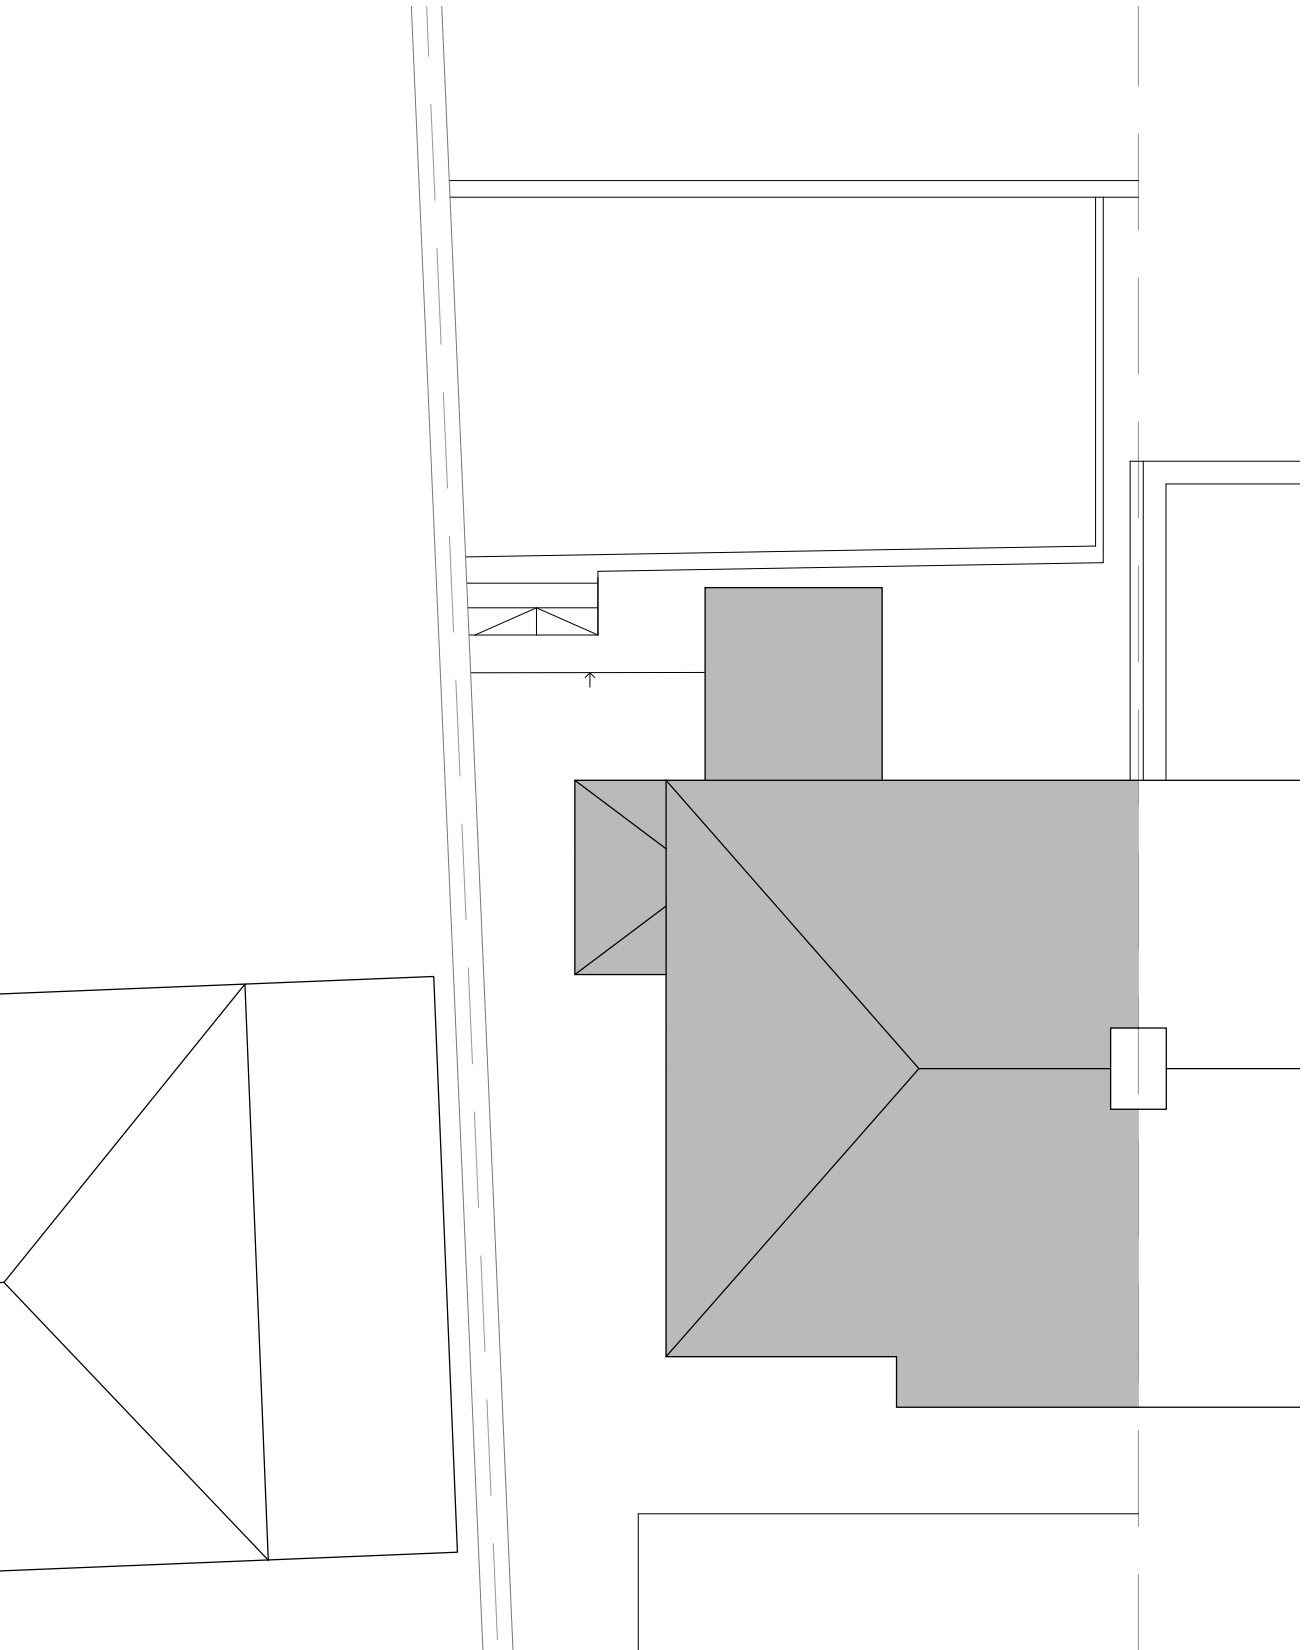


PROPOSED PLANS 1:100

ROOF PLAN

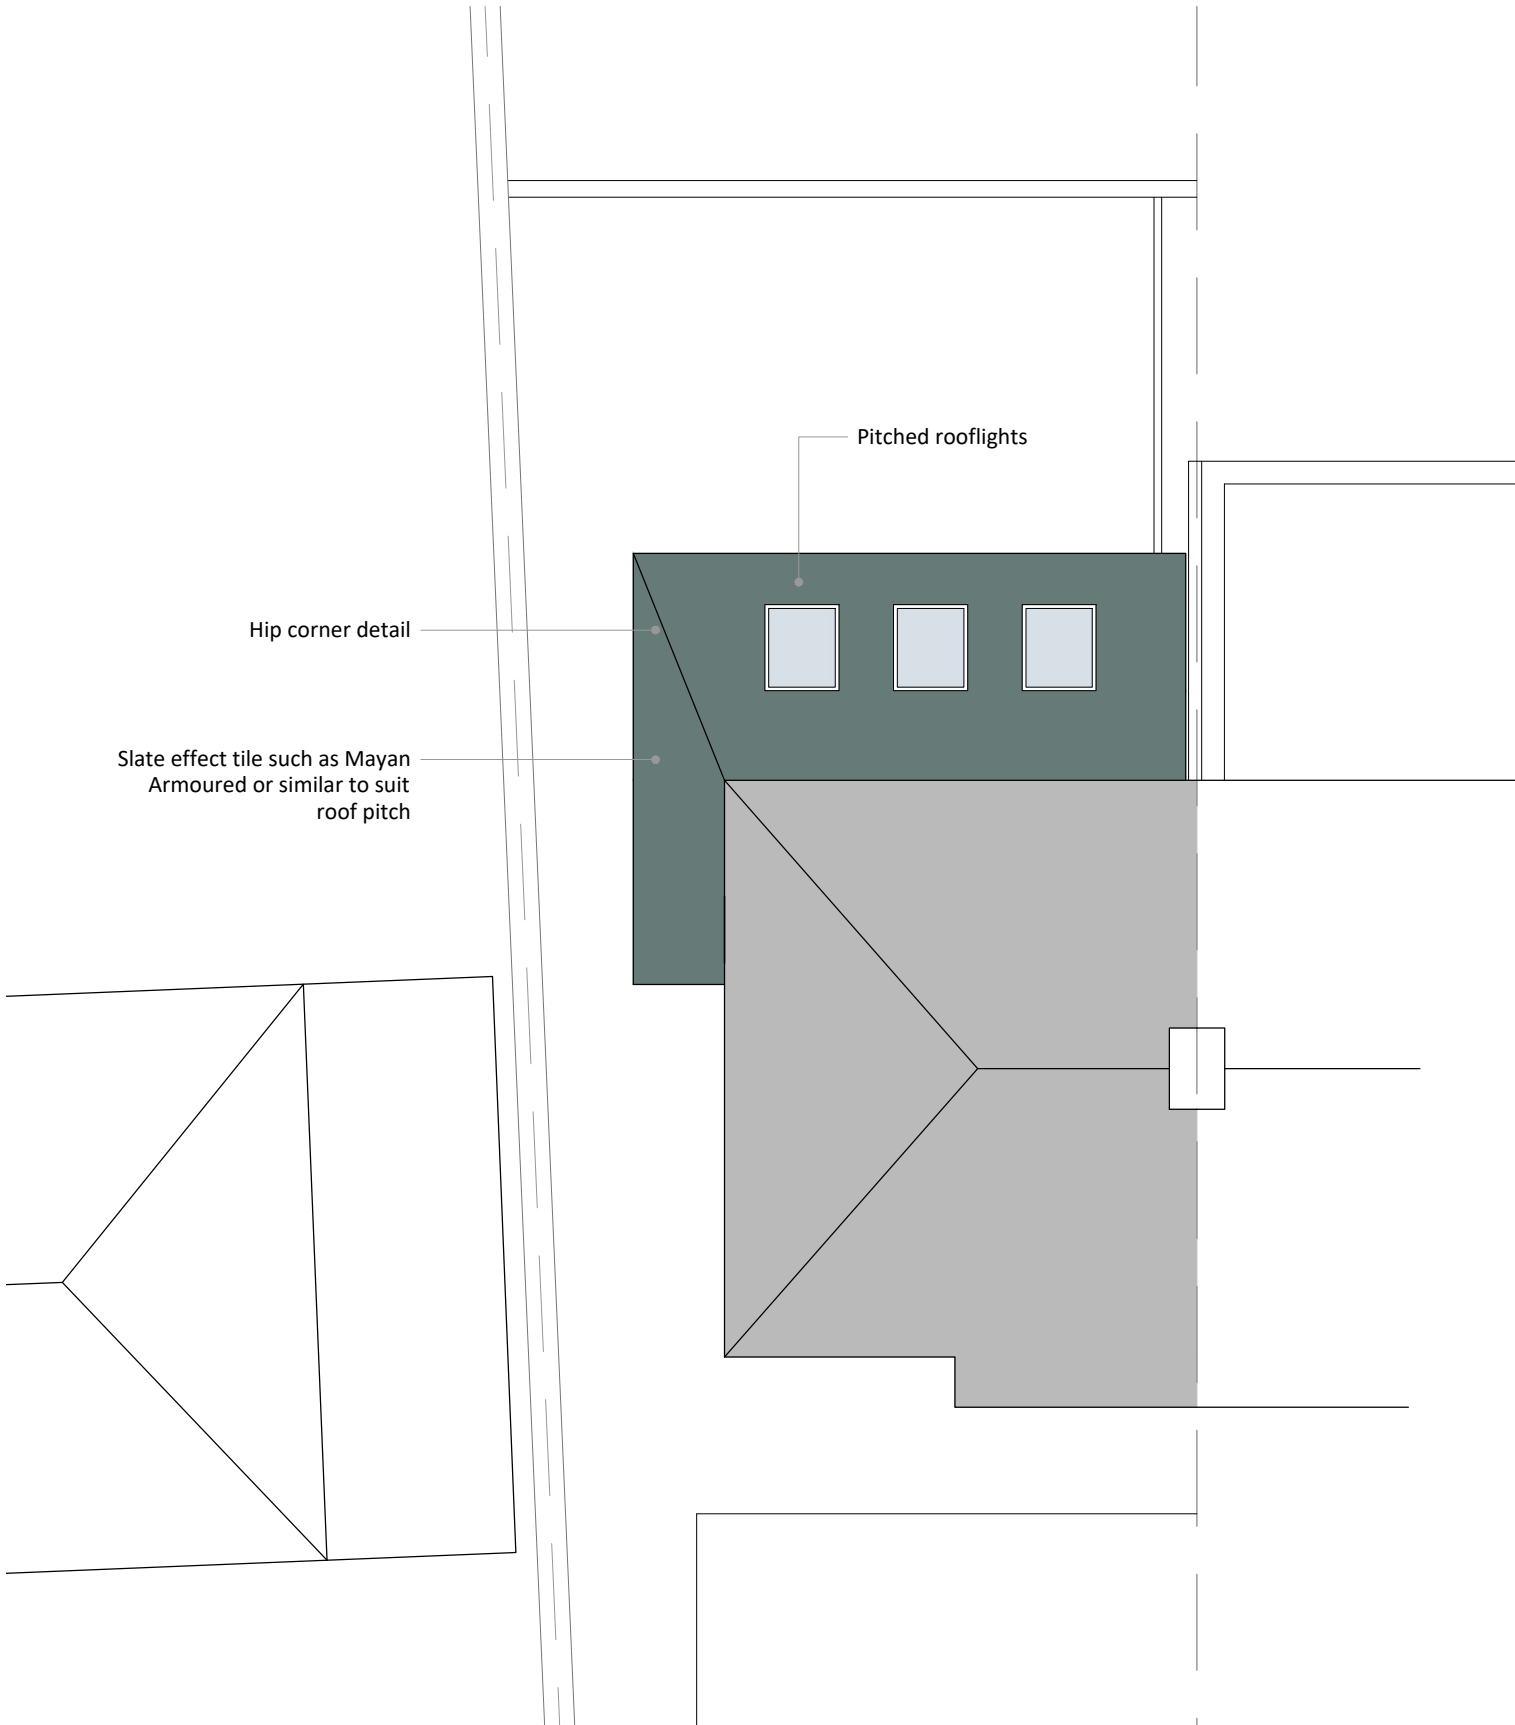

PROPOSED PLANS 1:50

ROOF CONSTRUCTION

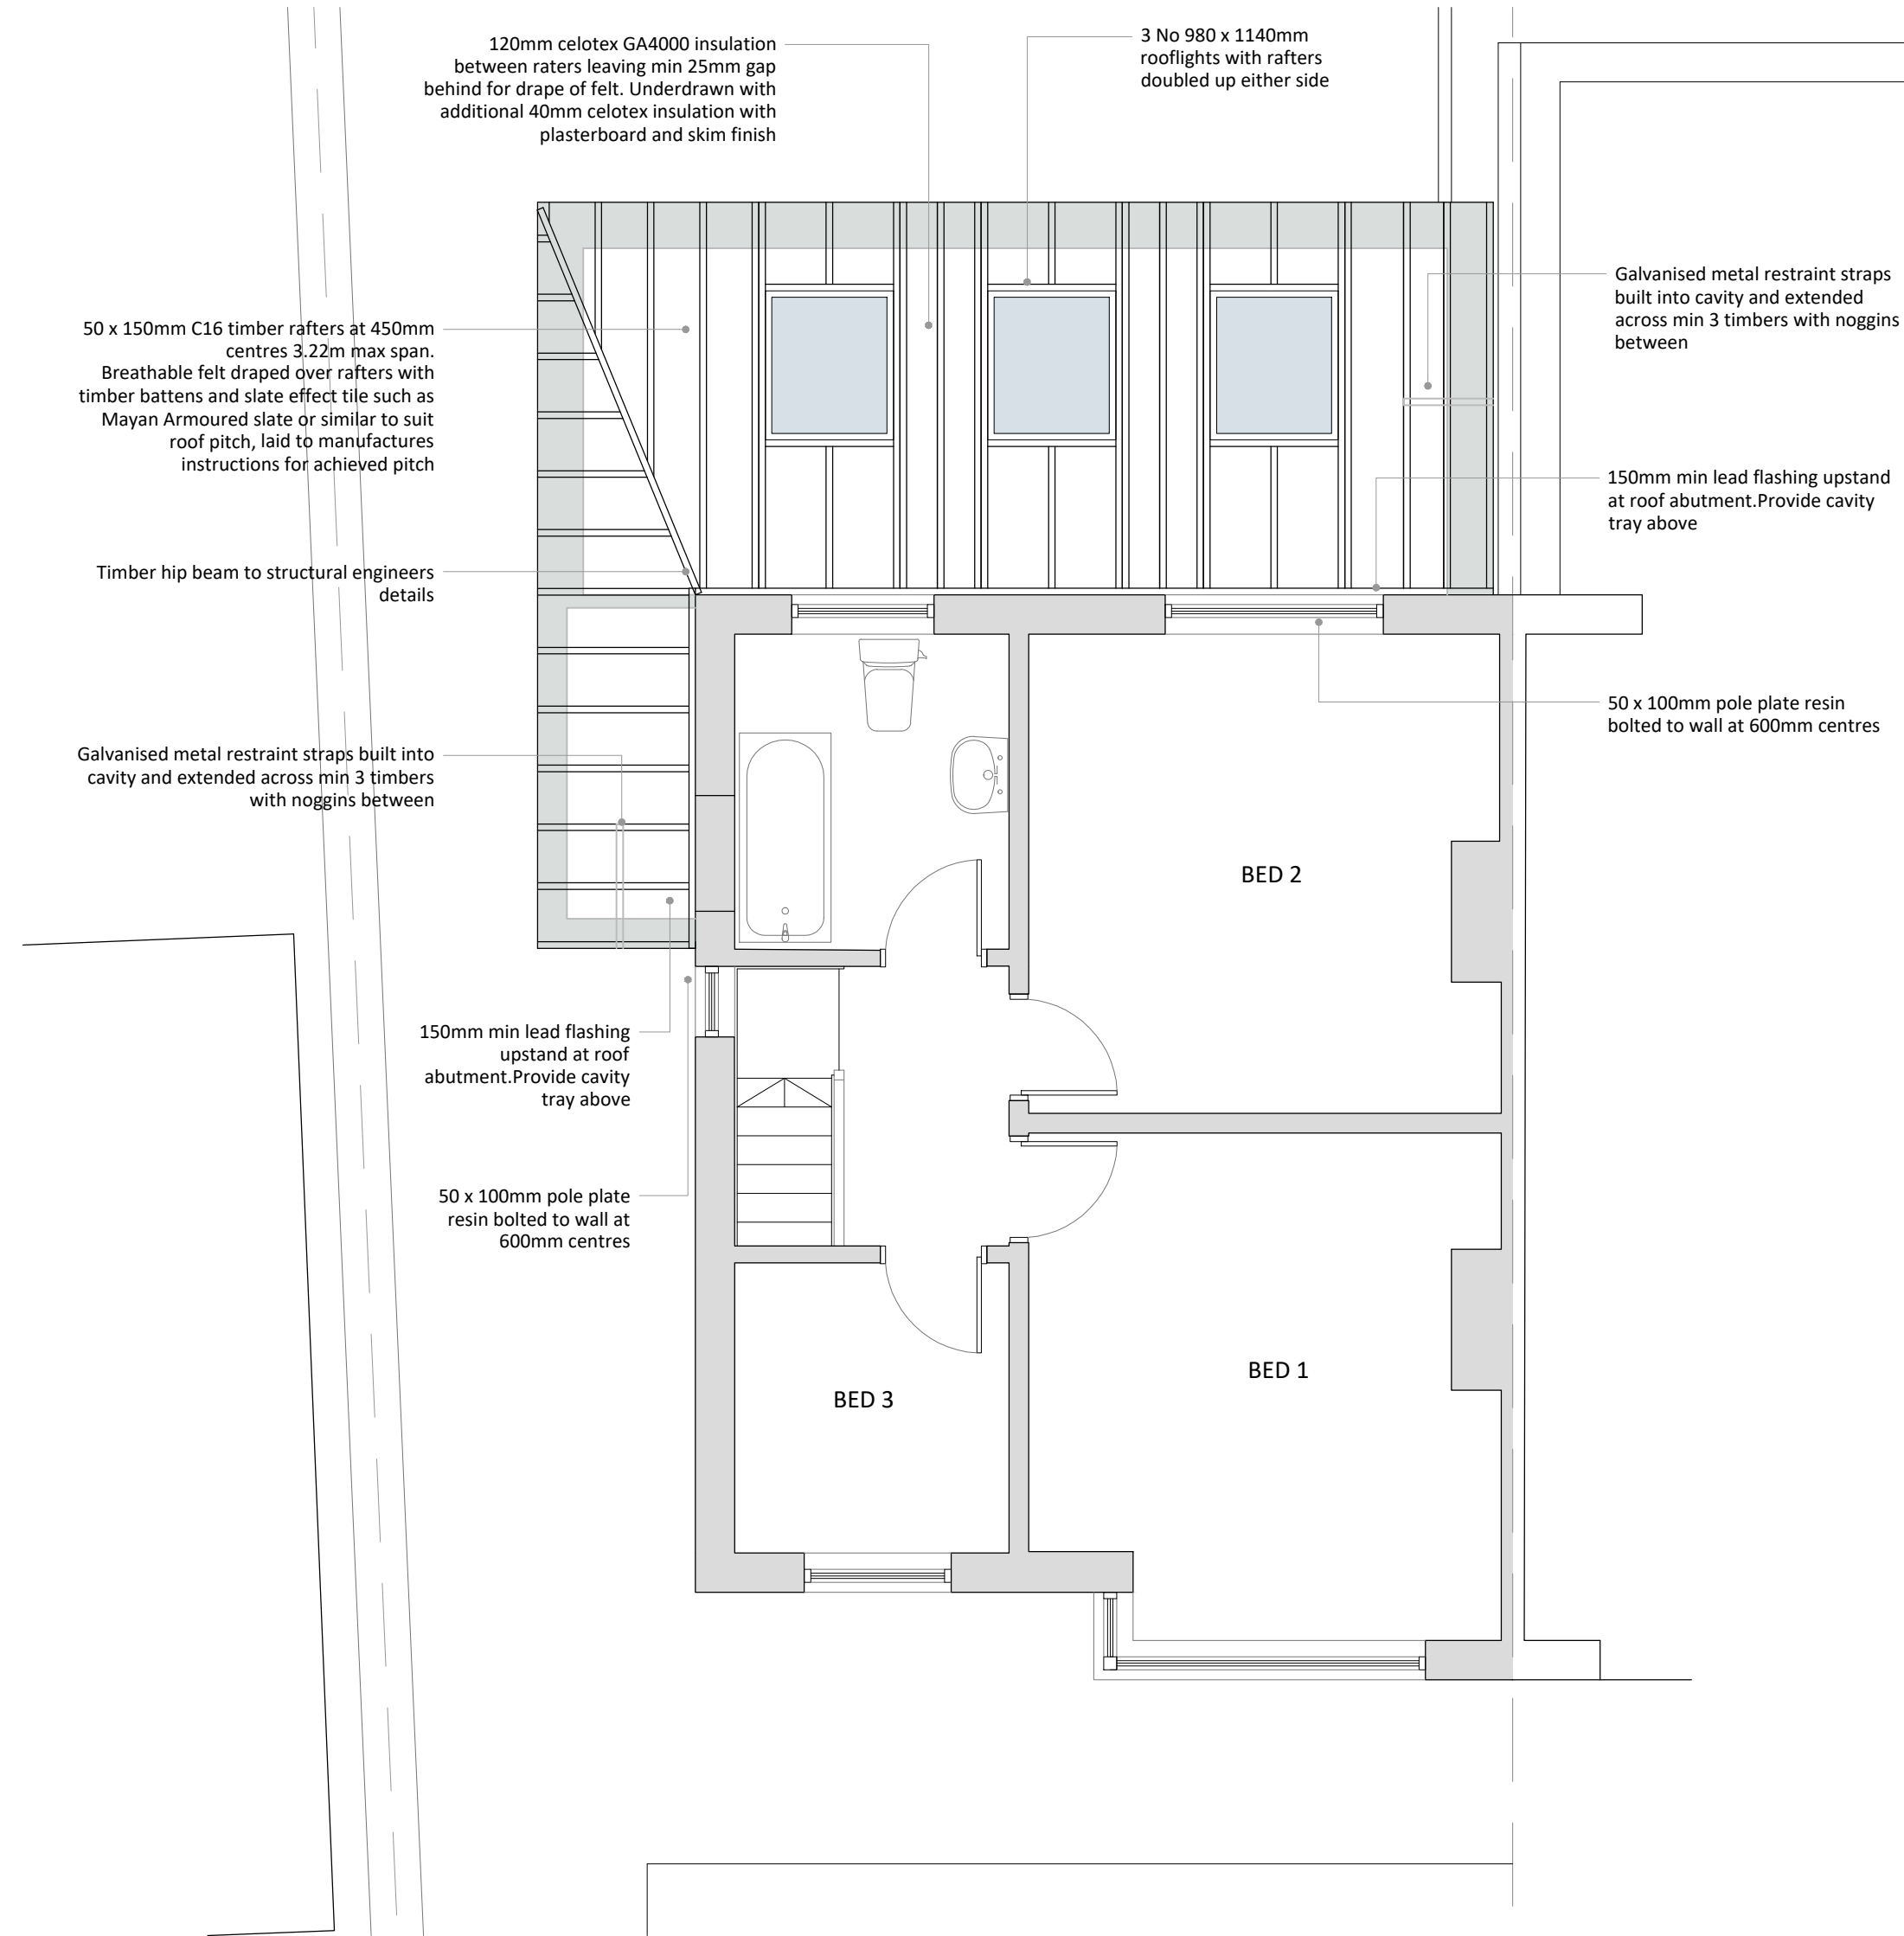

TRENCH FOUNDATION

Provide 750mm thick trench fill concrete foundations with a minimum width equal to the width of the wall plus 300mm. Concrete mix to conform to BS EN 206:2013 (+A2:2021) and BS 8004:2015 Code of practice for foundations (+A1:2020). All foundations to be a minimum of 1000mm below ground level, depth and size of foundation to be approved on site by Building Control to suit site conditions. All constructed in accordance with 2010 Building Regulations A1/2 and BS 8004 Code of Practice for Foundations (+A1:2020). Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions or difference in soil type be found, or any major tree roots in excavations, Building Control to be contacted and the advice of a Structural Engineer should be sought.

PIPES PASSING THROUGH TRENCH FOUNDATIONS

The load-bearing capability of foundations must not be affected where services pass through. The pipe work to be sleeved. Flexible material to be provided around pipe and flexible joints to be provided where pipes exit the foundation. Alternatively

Pipework should pass through a suitably strengthened opening in the foundation, i.e. foundation shuttered and a provided with suitable lintel over the pipe allowing for sufficient space for movement to ensure that the drain is capable of maintaining line and gradient. Opening should be masked with granular backfill (pea shingle) around pipe. DPC to be provided, as required by Building Control. Advice from the Structural Engineer to be sought on suitability of pipe running through foundation before construction.

PIPES PASSING THROUGH WALLS

Walls above pipes passing through substructure walls to be supported on suitable lintel on semi-engineering bricks. Pipe to be provided with a 50mm clearance all round, opening to be masked with granular backfill (pea shingle) around pipe. DPC to be provided, as required by Building Control. Alternatively

Where new pipework passes through external walls the pipe work is to be provided with 'rocker pipes' at a distance of 150mm either side of the wall face. The 'rocker pipes' must have flexible joints and be a maximum length of 600mm.

SOLID FLOOR INSULATION UNDER SLAB

To meet min U value required of 0.18 W/m²K P/A ratio 0.5

Solid ground floor to consist of 150mm consolidated well-rammed hardcore, blinded with 50mm sand blinding. Provide a 1200 gauge polythene DPM, DPM to be lapped in with DPC in walls. Floor to be insulated over DPM with 90mm thick Celotex GA4000 insulation.

25mm insulation to continue around floor perimeters to avoid thermal bridging. A VCL should be laid over the insulation boards and turned up 100mm at room perimeters behind the skirting, all joints to be lapped by 150mm and sealed. Provide 100mm ST2 or Gen2 ground bearing slab concrete mix to conform to BS 8500-2:2023 and BS EN 206 over VCL. Finish over the slab with a floating layer of min 20mm tongue and groove softwood boards or moisture resistant particle/chipboard grade type C4 to BS EN 312 as required. Lay with staggered joints.

Where drain runs pass under new floor, provide A142 mesh 1.0m wide within bottom of slab min 50mm concrete cover over length of drain.

Where existing suspended timber floor air bricks are covered by new extension, ensure cross-ventilation is maintained by connecting to 100mm dia UPVC pipes to terminate at new 65mm x 215mm air bricks built into new cavity wall with 100mm concrete cover laid under the extension. Ducts to be sleeved through cavity with cavity tray over.

WALLS BELOW GROUND

All new walls below ground to be constructed using blockwork compliant with BS EN 771 and suitable for below ground level or semi engineering brickwork. Walls to be built using 1:4 masonry mortar mix or equal approved specification to BS EN 1996-1-1. Cavities below ground level to be filled with lean mix concrete min 225mm below damp proof course. Or provide lean mix backfill at base of cavity wall (150mm below damp course) laid to fall to weepholes.

PARTIAL FILL CAVITY WALL

To achieve minimum U Value of 0.18 W/m²K

20mm two coat sand/cement render to comply to BS EN 13914-1 with waterproof additive on 100mm medium block, 0.45 W/m²K. Ensure a 50mm clear residual cavity and provide 100mm Celotex CW4000 insulation fixed to inner leaf constructed. Inner leaf using 100mm medium block, 0.45 W/m²K. Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1.6 cement mortar.

TIMBER FRAME WALL

To achieve minimum U Value of 0.18 W/m²K

Outer skin to be 102mm suitable facing brick with 50mm vented and drained cavity provided between the stud and brick cladding. Inner stud to have breathable membrane (a vapour resistance of not more than 0.6 MNs/g) fixed to 12mm thick W.B.P external quality plywood sheathing (or other approved). Ply fixed to treated timber frame studs constructed using 100mm x 50mm treated timbers with head and sole plates and noggins at 400mm ctrs or to s/engineer's details and calculations. Insulation to be 90mm Celotex GA4000 between studs with 40mm Celotex TB4000 over. Provide vcl and 12.5mm plasterboard over internal face of insulation. Finish with 3mm skim coat of finishing plaster. All junctions to have water tight construction, seal all perimeter joints with tape internally and with silicon sealant externally.

DPC

Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins, DPC to be placed a minimum 150mm above external ground level. New DPC to be made continuous with existing DPC's and with floor DPM. Vertical DPC to be installed at all reveals where cavity is closed.

WALL TIES

All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS EN 845-1:2013.

Wall ties for cavities over 150mm to be suitable for cavity width, and installed as manufacturer's details.

CAVITIES

Provide cavity trays over openings and where roofs abut walls. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

EXISTING TO NEW WALL

Cavities in new wall to be made continuous with existing, where possible, to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

UNVENTED PITCHED ROOF

Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²) To achieve U-value 0.15 W/m²K

Timber roof structures to be designed by an Engineer in accordance with NHBC Technical Requirement R5 Structural Design. Calculations to be based on BS EN 1995-1-1:2004 Eurocode 5: Design of timber structures (+A2:2014). Roofing tiles to match existing on 25 x 38mm tanalised sw treated battens on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 150mm grade C24 rafters at max 400mm centres, max span 3.47m. Rafters supported on 100 x 50mm treated sw wall plates. Allow min 20mm air space to allow for drape of breathable felt. Insulation to be 130mm Celotex XR4000 between rafters and 50mm GA4000 under. Fix 12.5mm plasterboard (joints staggered) over VCL. Finish with 3mm skim coat of finishing plaster to the underside of all ceilings. Provide cavity tray where roof meets existing wall.

BUILDING REGULATION DRAWINGS

31 Netherfield Road
Chapel en le Frith
High Peak
SK23 0PN

Single Storey Rear and Side Extension

Revision Date

Drawing Ref
31NR/BR/03

Date
January 2025

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.



18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210

info@plansanddesign.co.uk

