

GENERAL NOTES

1. NO DIMENSIONS TO BE SCALED OFF THIS DRAWING.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTS AND ENGINEERS DRAWINGS, DETAILS & SPECIFICATIONS.
3. SHOULD THERE BE ANY CONFLICT BETWEEN THE DETAILS INDICATED ON THIS DRAWING AND THOSE ON OTHER DRAWINGS, THE ENGINEER SHOULD BE INFORMED PRIOR TO CONSTRUCTION.
4. ANY SITE WORKS COMMENCED PRIOR TO THE ISSUE OF CONSTRUCTION STATUS DRAWINGS SHALL BE ENTIRELY AT THE CONTRACTORS OWN RISK.
5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
6. ALL LEVELS ARE IN METRES UNLESS NOTED OTHERWISE.
7. ANY DISCREPANCIES NOTED ON SITE ARE TO BE REPORTED TO THE ENGINEER IMMEDIATELY.
8. ALL RODGERS LEASK RISK ASSESSMENTS AND METHOD STATEMENTS FOR THIS PROJECT MUST BE REVIEWED PRIOR TO COMMENCEMENT OF ANY WORKS ON SITE.


NOTE 1

DETAILS OF TEMPORARY WORKS PROPOSAL TO BE SUBMITTED TO ENGINEER FOR APPROVAL PRIOR TO ERECTION. NO LOADS ARE TO BE APPLIED TO THE EXISTING STRUCTURE WITHOUT CONSULTING THE ENGINEER.

STABILITY OF THE EXISTING TIMBER ROOF STRUCTURE (RAFTERS, PURLINS & TRUSSES) IN THE TEMPORARY CASE (I.E. DURING REMOVAL OF TILES AND SARKING) IS THE RESPONSIBILITY OF THE CONTRACTOR, DETAIL TO BE SUBMITTED TO ENGINEER FOR REVIEW/APPROVAL.

NOTE 2

DETAILED DESIGN OF TEMPORARY WORKS SOLUTION REQUIRED AT CONSTRUCTION STAGE. NO LOADS/PROPS TO BE SUPPORTED OFF FIRST FLOOR STRUCTURE WITHOUT ENGINEERS APPROVAL.

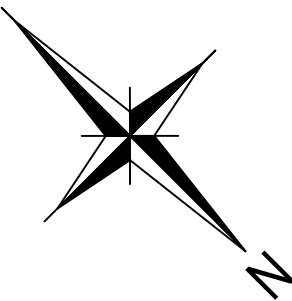


STRUCTURE KEY

- = WALL MATERIAL UNSPECIFIED
 - = WALLS UNDER
 - = DEMOLISHED
 - = STRUCTURE OVER (U.N.O)
- EXISTING
- = EXISTING BRICKWORK
 - = EXISTING BLOCKWORK
 - = EXISTING STONEMWORK
 - = EXISTING STUD PARTITION

LOCATION PLAN
SEE DRG 24253-RLL-25-XX-DR-S-1004

MANCHESTER ROAD


HATCHED AREA INDICATES APPROXIMATE AREA OF ROOF TO BE REMOVED. ALL REMEDIAL WORKS ARE TO BE CARRIED OUT FROM EXTERNAL SCAFFOLD STRUCTURE. SEE NOTE 1.

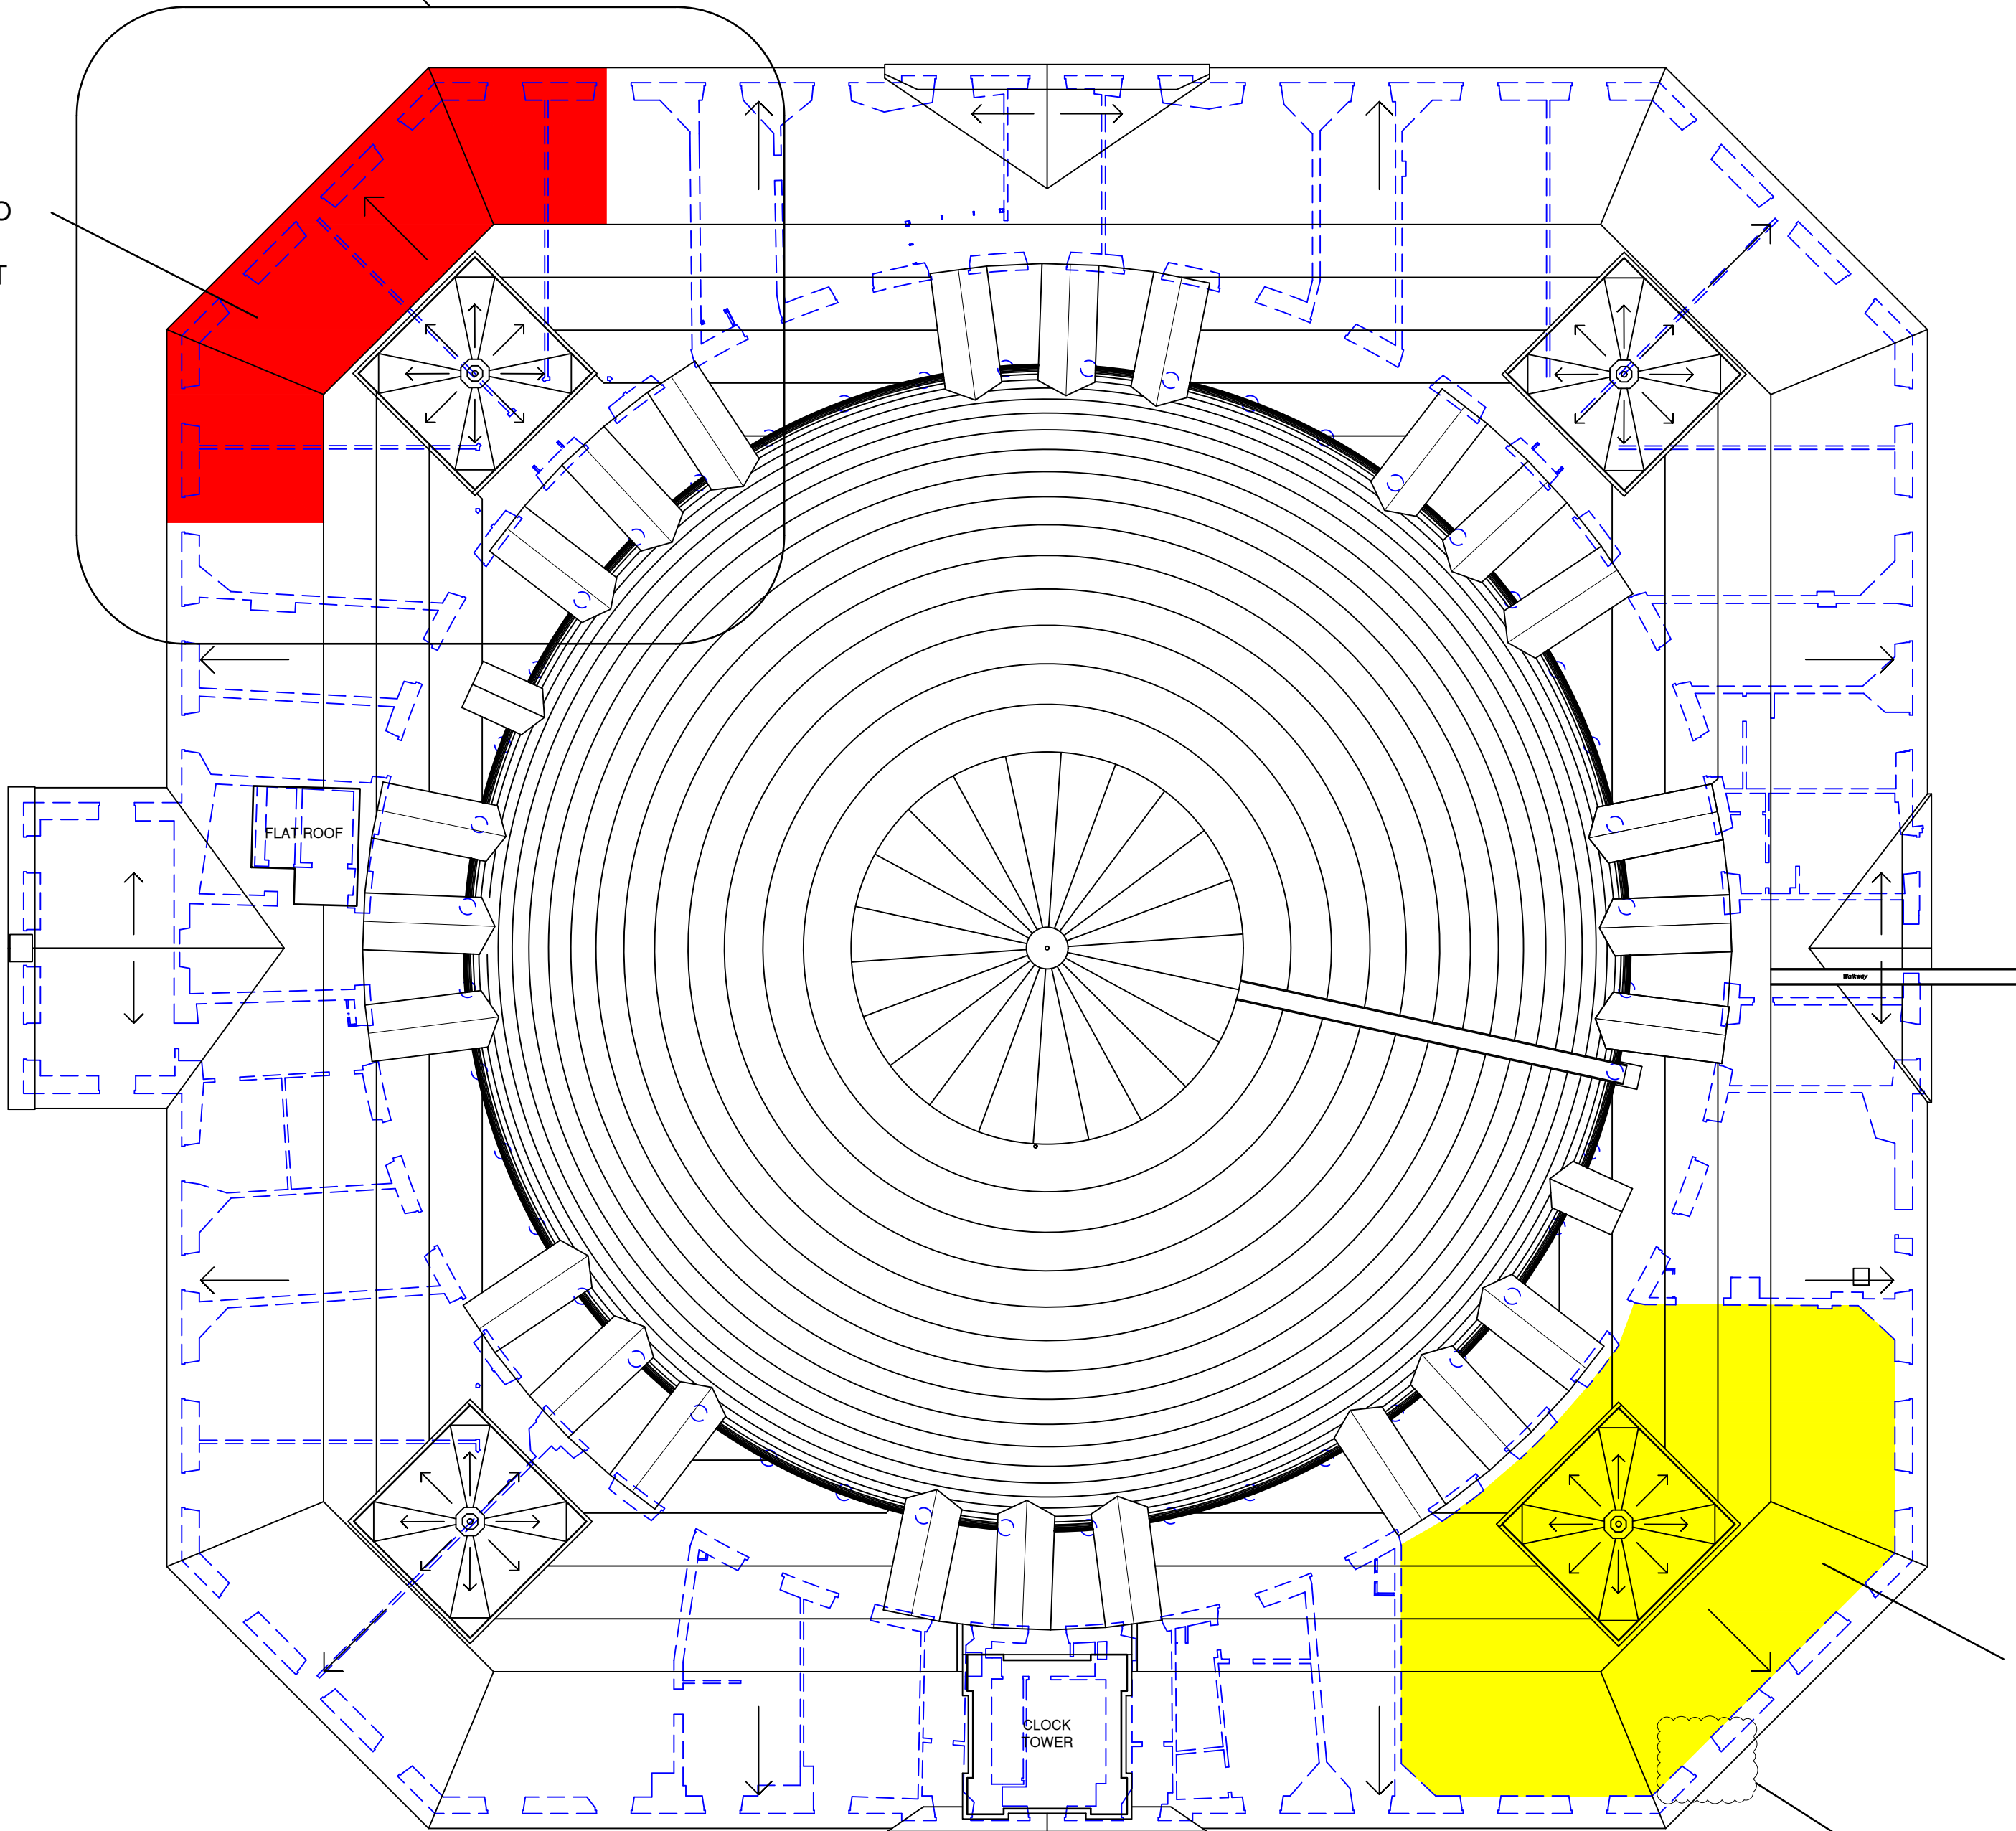

HATCHED AREA INDICATES APPROXIMATE EXTENTS OF ROOF STRUCTURE REQUIRING LOCALISED REMEDIAL WORKS. DETAILS TBC SUBJECT TO OPENING UP WORKS. SEE NOTE 2.

APPROXIMATE LOCATION OF SEVERE WATER INGRESS AND DAMAGED TIMBER PURLIN. NEW 85X195 TIMBER PURLIN (C24 GRADE) TO BE PROVIDED IMMEDIATELY ADJACENT TO EXISTING. PURLIN TO BE PUSHED UP HARD AGAINST EXISTING RAFTERS TO RELIEVE LOAD ON EXISTING DAMAGED PURLIN. FOR DETAILS OF END CONNECTION REFER TO RLL DRAWING 24-253-RLL-25-XX-DR-S-1004

DOME ROOF PLAN
SCALE 1:150



Measurement at drawing scale 1:200

Rev	Date	Amendments	By	Chk
P01	18.03.25	Preliminary issue	CRS	JW



Client

UNIVERSITY OF DERBY

Project

DEVONSHIRE DOME

Drawing Title

DOME ROOF PLAN

Status

PRELIMINARY

Scale Drawn Checked Date

As Indicated CRS JW 18.03.25

Drawing Number Rev.

24253-RLL-25-02-DR-S-1003 P01

BIM Drawing Reference

Copyright © Rodgers Leask Limited