

EXISTING ELEVATIONS 1:100


SOUTH




EAST



NORTH

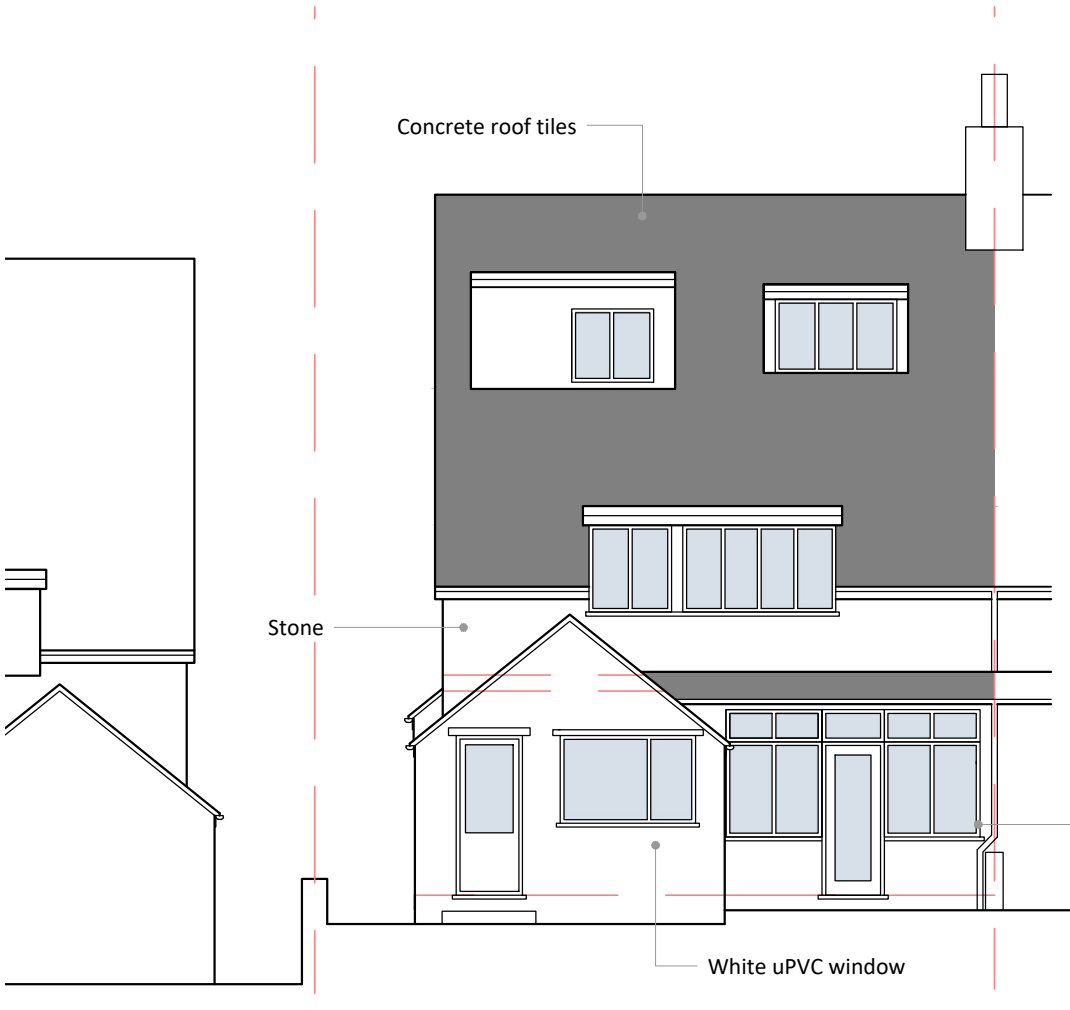

WEST

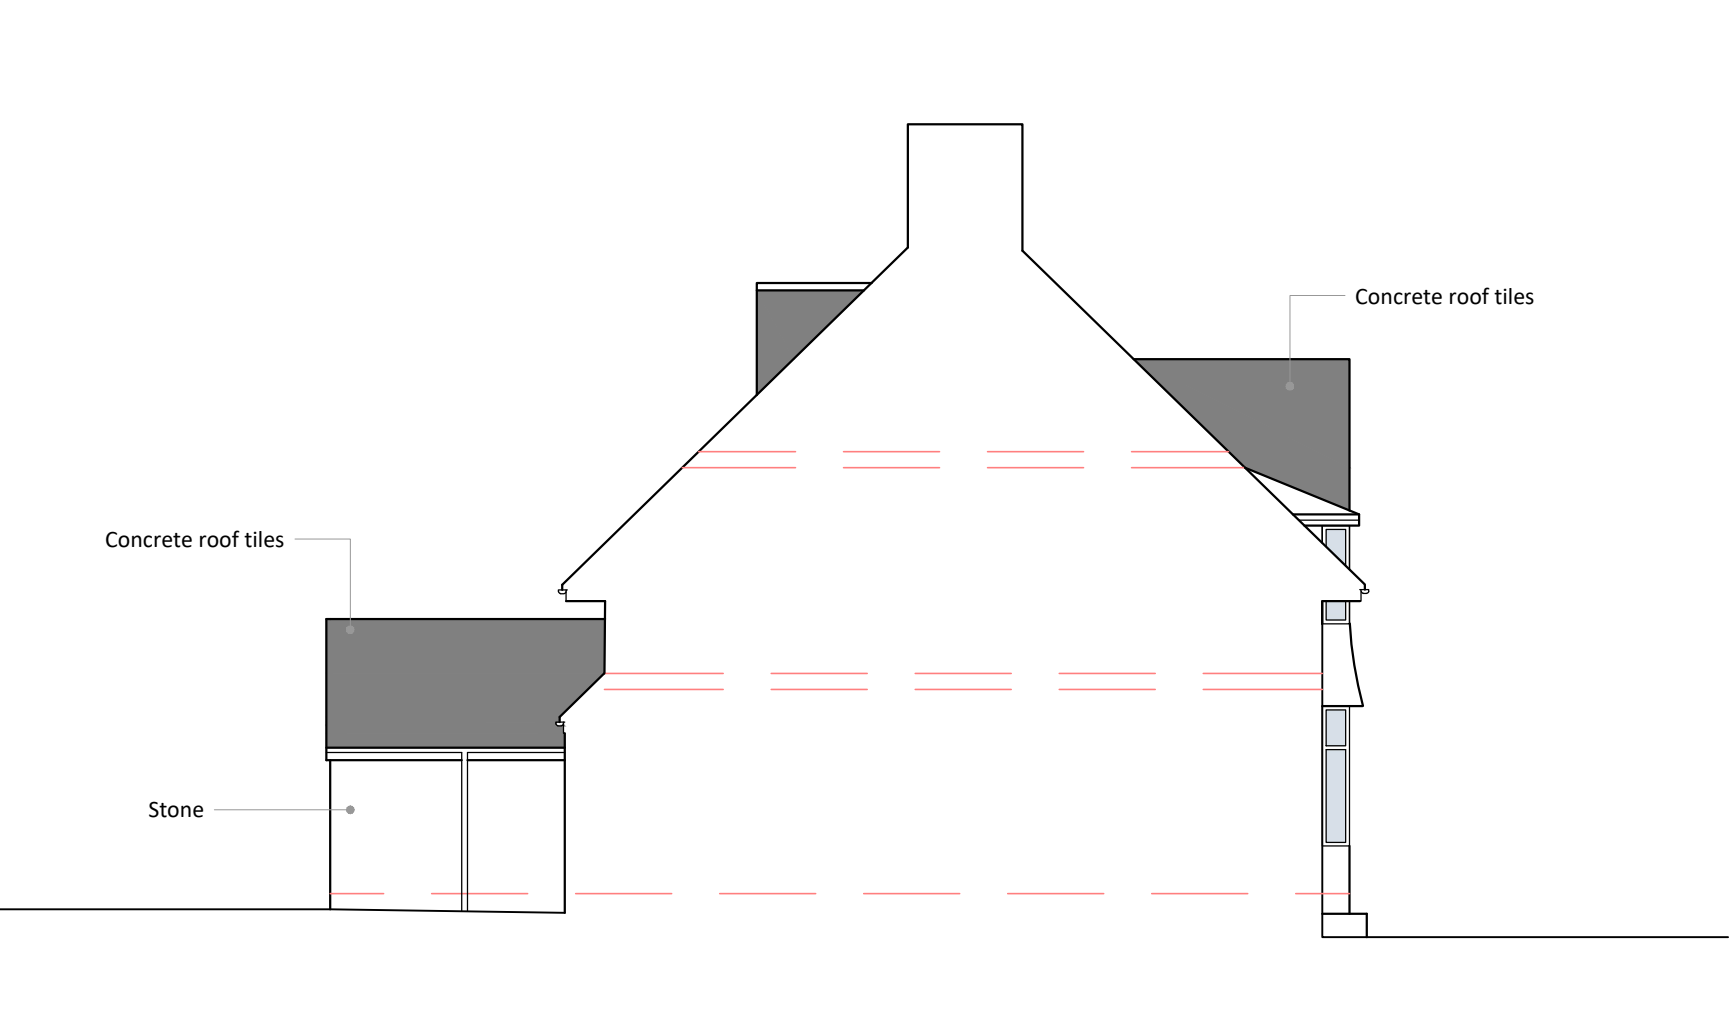

PROPOSED ELEVATIONS 1:100


SOUTH




EAST



NORTH

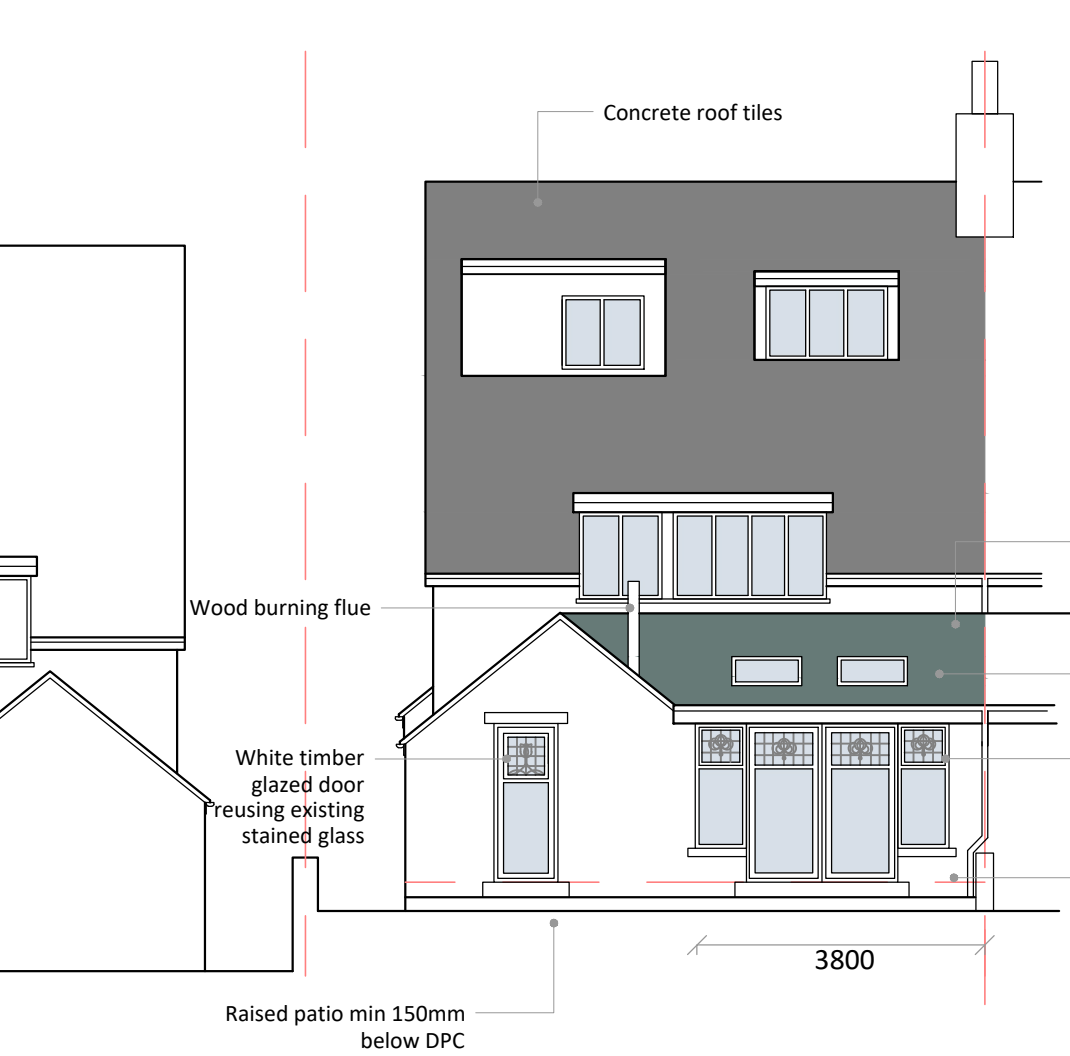


WEST

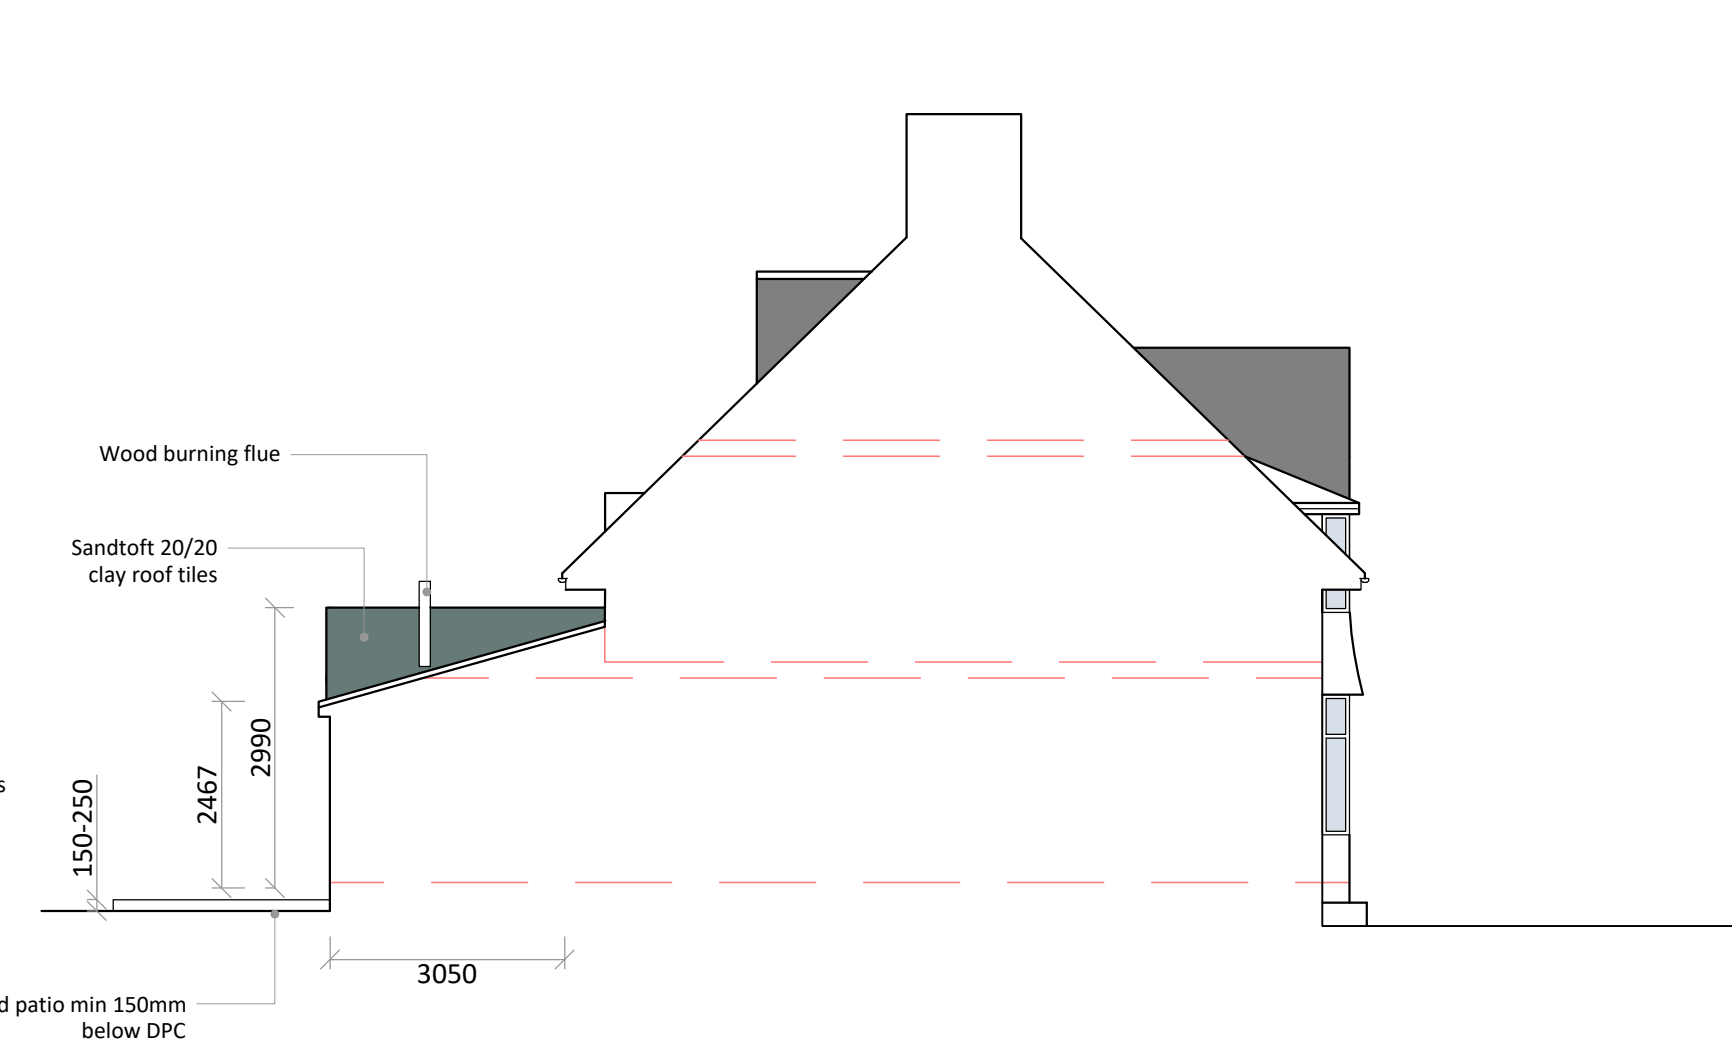

LOCATION PLAN 1:1250



SITE PLAN 1:200

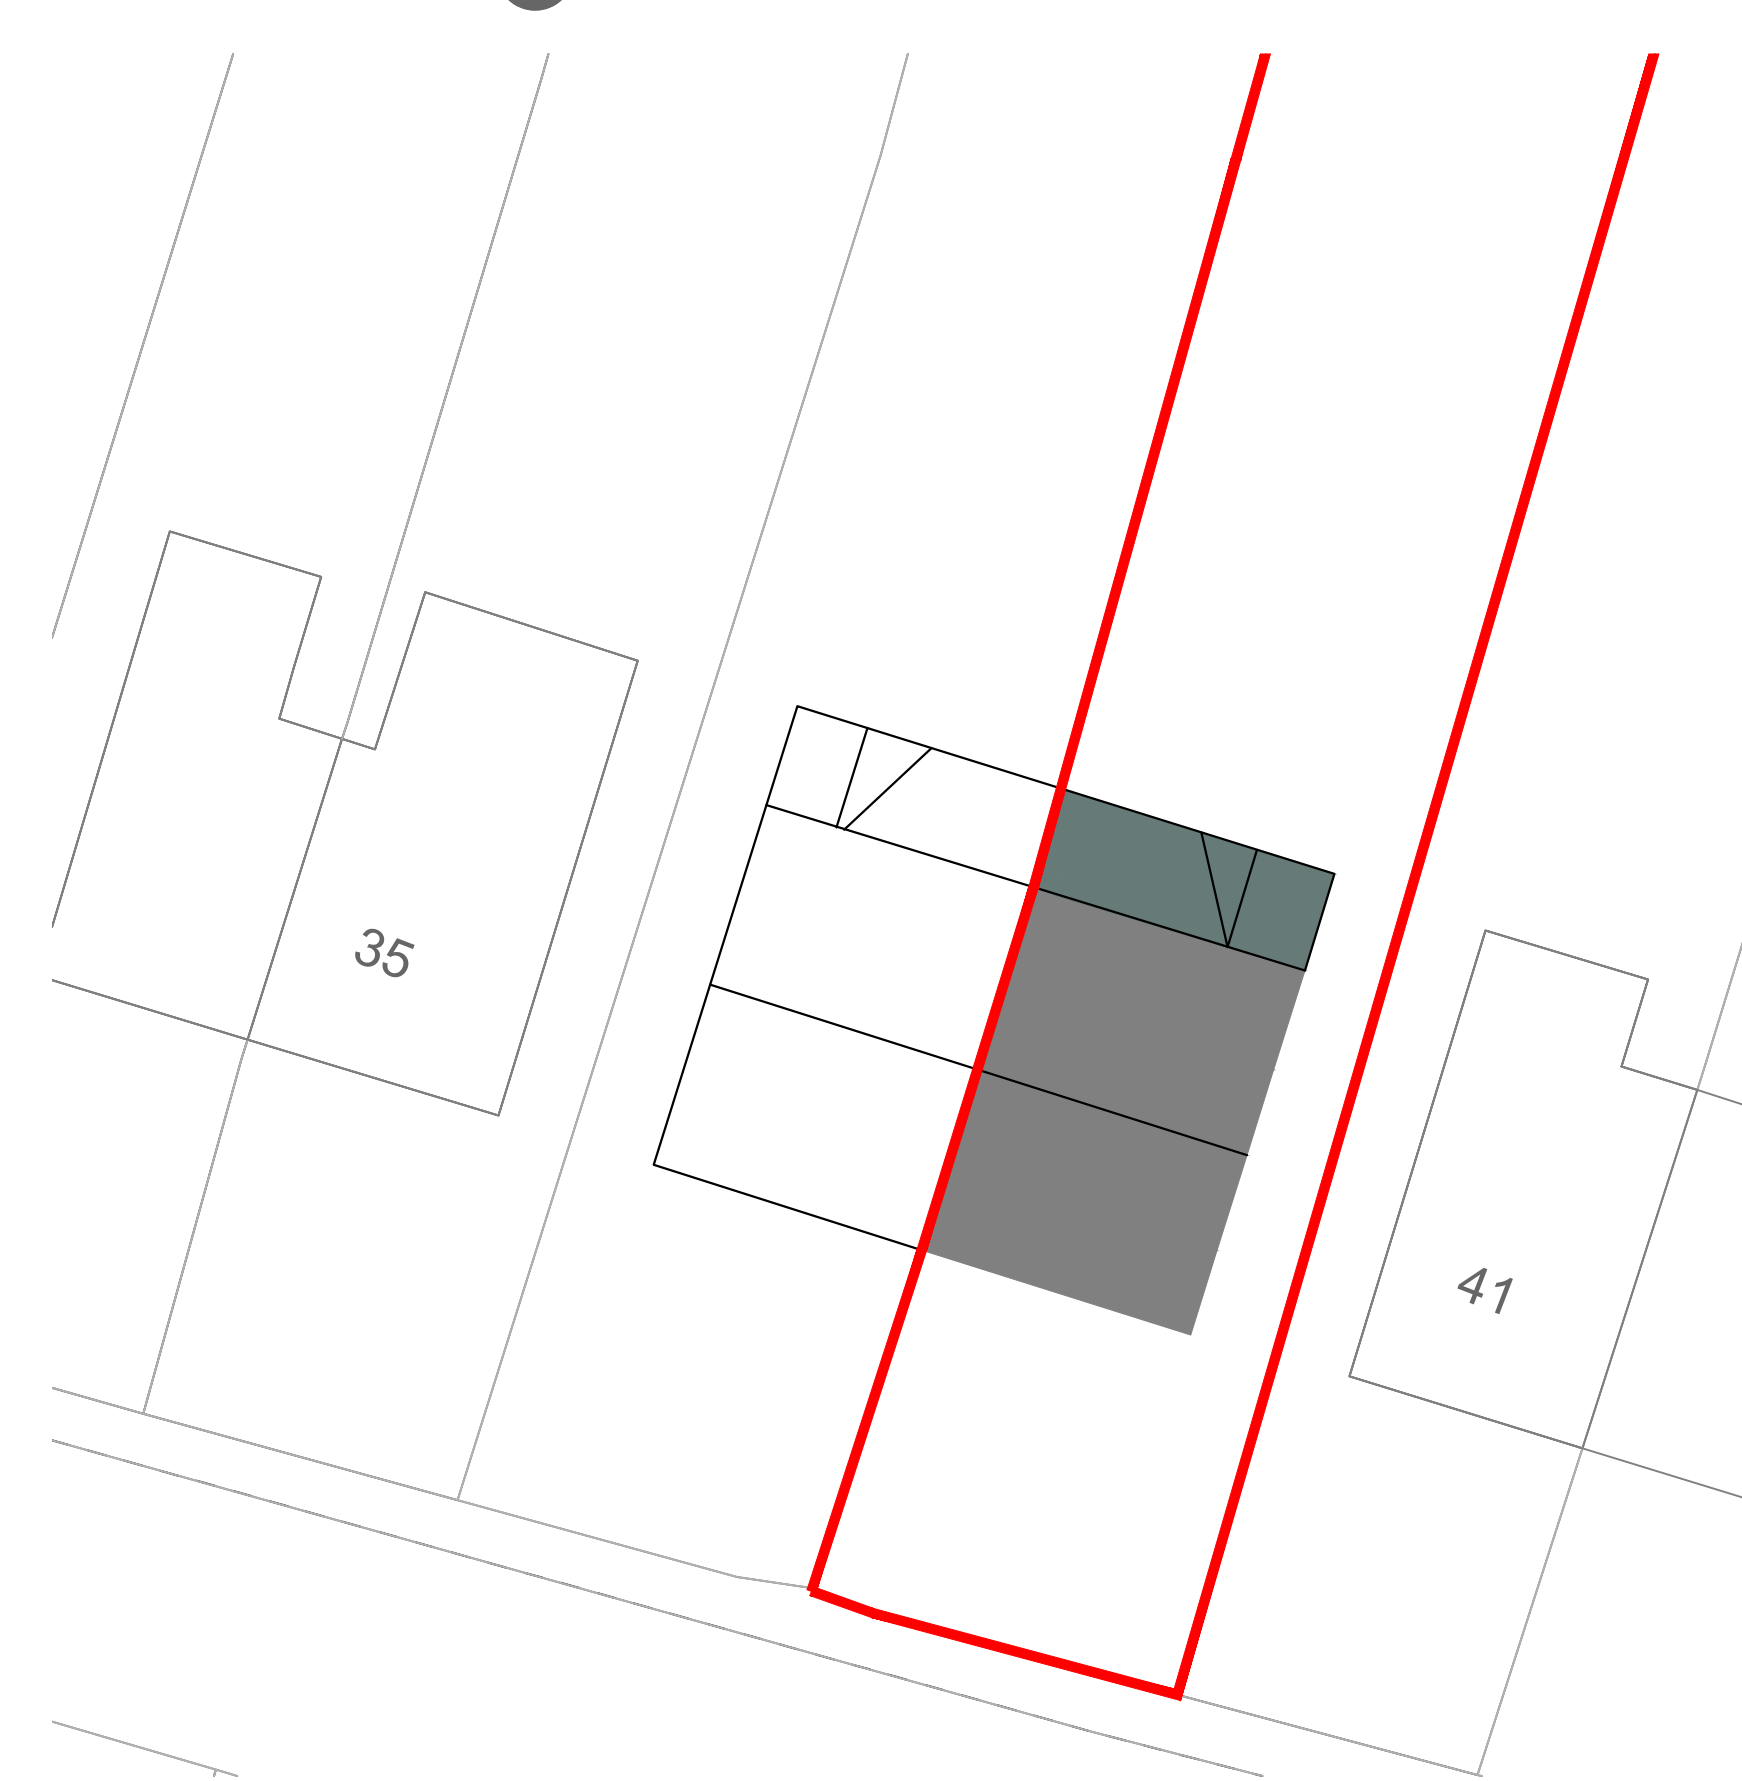

NOTICE OF COMMENCEMENT

A notice of commencement is to be submitted to Building Control within 5 days of work being regarded as commenced, under regulation 16 of The Building Regulations etc. (Amendment) (England) Regulations 2010.

Work will be deemed to have commenced when the build has progressed to at least one of the following:

For complex buildings – Foundations are constructed, and the structure of the lowest floor level is complete.

For new buildings and horizontal extensions - Sub surface structure of the building or the extension including all foundations and the structure of the ground floor level is completed.

For all other works – constructed 15% of the overall work.

NOTICE OF COMPLETION

A Notice of Completion to be given to Building Control not more than 5 days after the work has been completed. The notice to contain the following information:

- The name, address, telephone number and (if available) email address of the client, principal contractor, and principal designer.
- A statement from the applicant to say that the works have been completed and complies with all the applicable regulations to the best of their knowledge.
- A statement from both the principal contractor and principal designer to confirm they have fulfilled their duties under Part 2A (duty holders and competence).

PARTY WALL ACT

Should they need to do so under the requirements of the Party Wall Act 1996, the owner has a duty to serve a Party Structure Notice on any adjoining owner if the building work involves any of the following to a Party Wall:

- Support of beam
- Insertion of DPC through wall
- Raising a wall or cutting off projections
- Demolition and rebuilding
- Underpinning
- Insertion of lead flashings

A Party Wall Notice is also required for:

- Any excavations within 3 metres of any part of a neighbouring owner's building or structure, where any part of that work will go deeper than the neighbour's foundations; or
- Any excavations for a new building or structure, within 6 metres of any part of a neighbouring owner's building or structure, where any part of that work will meet a line drawn downwards at 45° in the direction of the excavation from the bottom of the neighbour's foundations, see diagram 7 in the following Government guidance, https://www.gov.uk/government/publications/preventing-and-resolving-disputes-in-relation-to-party-walls/the-party-wall-etc-act-1996-explanatory-booklet#para_28

A Party Wall Agreement is to be in place prior to start of works on site.

THERMAL BRIDGING

Care shall be taken to limit the occurrence of thermal bridging in the insulation layers caused by gaps within the thermal element, (i.e. around windows and door openings). Reasonable provision shall also be made to ensure the extension is constructed to minimise unwanted air leakage through the new building fabric.

MATERIALS AND WORKMANSHIP

All works are to be carried out in a workmanlike manner. All materials and workmanship must comply with Regulation 7 of the Building Regulations, all relevant British Standards, European Standards, Agreement Certificates, Product Certification of Schemes (Kite Marks) etc. Products conforming to a European technical standard or harmonised European product should have a CE marking. The latest edition of the British Standard (including any amendments) applies to any undated references within these specifications.

EXISTING STRUCTURE

Existing structure including foundations, beams, walls and lintels carrying new and altered loads are to be exposed and checked for adequacy prior to commencement of work and as required by Building Control.

BEAMS

Supply and install new structural elements such as new beams, roof structure, floor structure, bearings, and padstones in accordance with the Structural Engineer's calculations and details. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance, as agreed with Building Control. All fire protection to be installed as detailed by specialist manufacturer.

OPENINGS AND RETURNS

An opening or recess greater than 0.1m² shall be at least 550mm from the supported wall (measured internally).

LINTELS

For uniformly distributed loads and standard 2 storey domestic loadings only
Lintel widths are to be equal to wall thickness. All lintels over 750mm sized internal door openings to be 65mm deep pre-stressed concrete plank lintels. 150mm deep lintels are to be used for 900mm sized internal door openings. Lintels to have a minimum bearing of 150mm on each end. Any existing lintels carrying additional loads are to be exposed for inspection at commencement of work on site. All pre-stressed concrete lintels to be designed and manufactured in accordance with BS EN 1992-1-1:2023 Eurocode 2, with a concrete strength of 50 or 40 N/mm² and incorporating steel strands to BS 5896 to support loadings assessed to BS EN 845-2:2013. For other structural openings provide proprietary insulated steel lintels suitable for spans and loadings in compliance with Approved Document A and lintel manufacturer's standard tables. Stop ends, DPC trays and weep holes to be provided above all externally located lintels. Independent lintels to have an insulated cavity closure between the inner and outer lintel. Unless only supporting a roof, lintels to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance. All fire protection to be installed as detailed by specialist manufacturer.

TRENCH FOUNDATION

Provide 750mm thick trench fill concrete foundations with a minimum width equal to the width of the wall plus 300mm. Concrete mix to conform to BS EN 206:2013 (+A2:2021) and BS 8004:2015 Code of practice for foundations (+A1:2020). All foundations to be a minimum of 1000mm below ground level, depth and size of foundation to be approved on site by Building Control to suit site conditions. All constructed in accordance with 2010 Building Regulations A1/2 and BS 8004 Code of Practice for Foundations (+A1:2020). Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions or difference in soil type be found, or any major tree roots in excavations, Building Control to be contacted and the advice of a Structural Engineer should be sought.

BASIC RADON PROTECTION

Provide a 1600g (400 um) radon membrane under floor slab lapped 300mm double welted and taped with gas proof tape at joints and service entry points. Carry membrane over cavity and provide suitable cavity tray and weep holes.

SOLID FLOOR INSULATION UNDER SLAB

To meet min U value required of 0.18 W/m²K. P/A ratio 0.5
Solid ground floor to consist of 150mm consolidated well-rammed hardcore, blinding with 50mm sand blinding. Provide a 1200 gauge polythene DPM, DPM to be lapped in with DPC in walls. Floor to be insulated over DPM with 90mm thick Celotex GA4000 insulation.
25mm insulation to continue around floor perimeters to avoid thermal bridging. A VCL should be laid over the insulation boards and turned up 100mm at room perimeters behind the skirting, all joints to be lapped by 150mm and sealed. Provide 100mm ST2 or Gen2 ground bearing slab concrete mix to conform to BS 8500-2:2023 and BS EN 206 over VCL. Finish over the slab with a floating layer of min 20mm tongue and groove softwood boards or moisture resistant particle/chipboard grade type C4 to BS EN 312 as required. Lay with staggered joints. Where drain runs pass under new floor, provide A142 mesh 1.0m wide within bottom of slab min 50mm concrete cover over length of drain.

BUILDING REGULATION DRAWINGS

39 Buxton Road
Chinley
High Peak
SK23 6DJ

Single Storey Rear Pitched Roof
Extension

Revision	Date
A - Following client comments	03/04/25

Drawing Ref	Date
39BR/BR/01/A	February 2025

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.



18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210

info@plansanddesign.co.uk