



PROPOSED PLANS 1:50

GROUND FLOOR

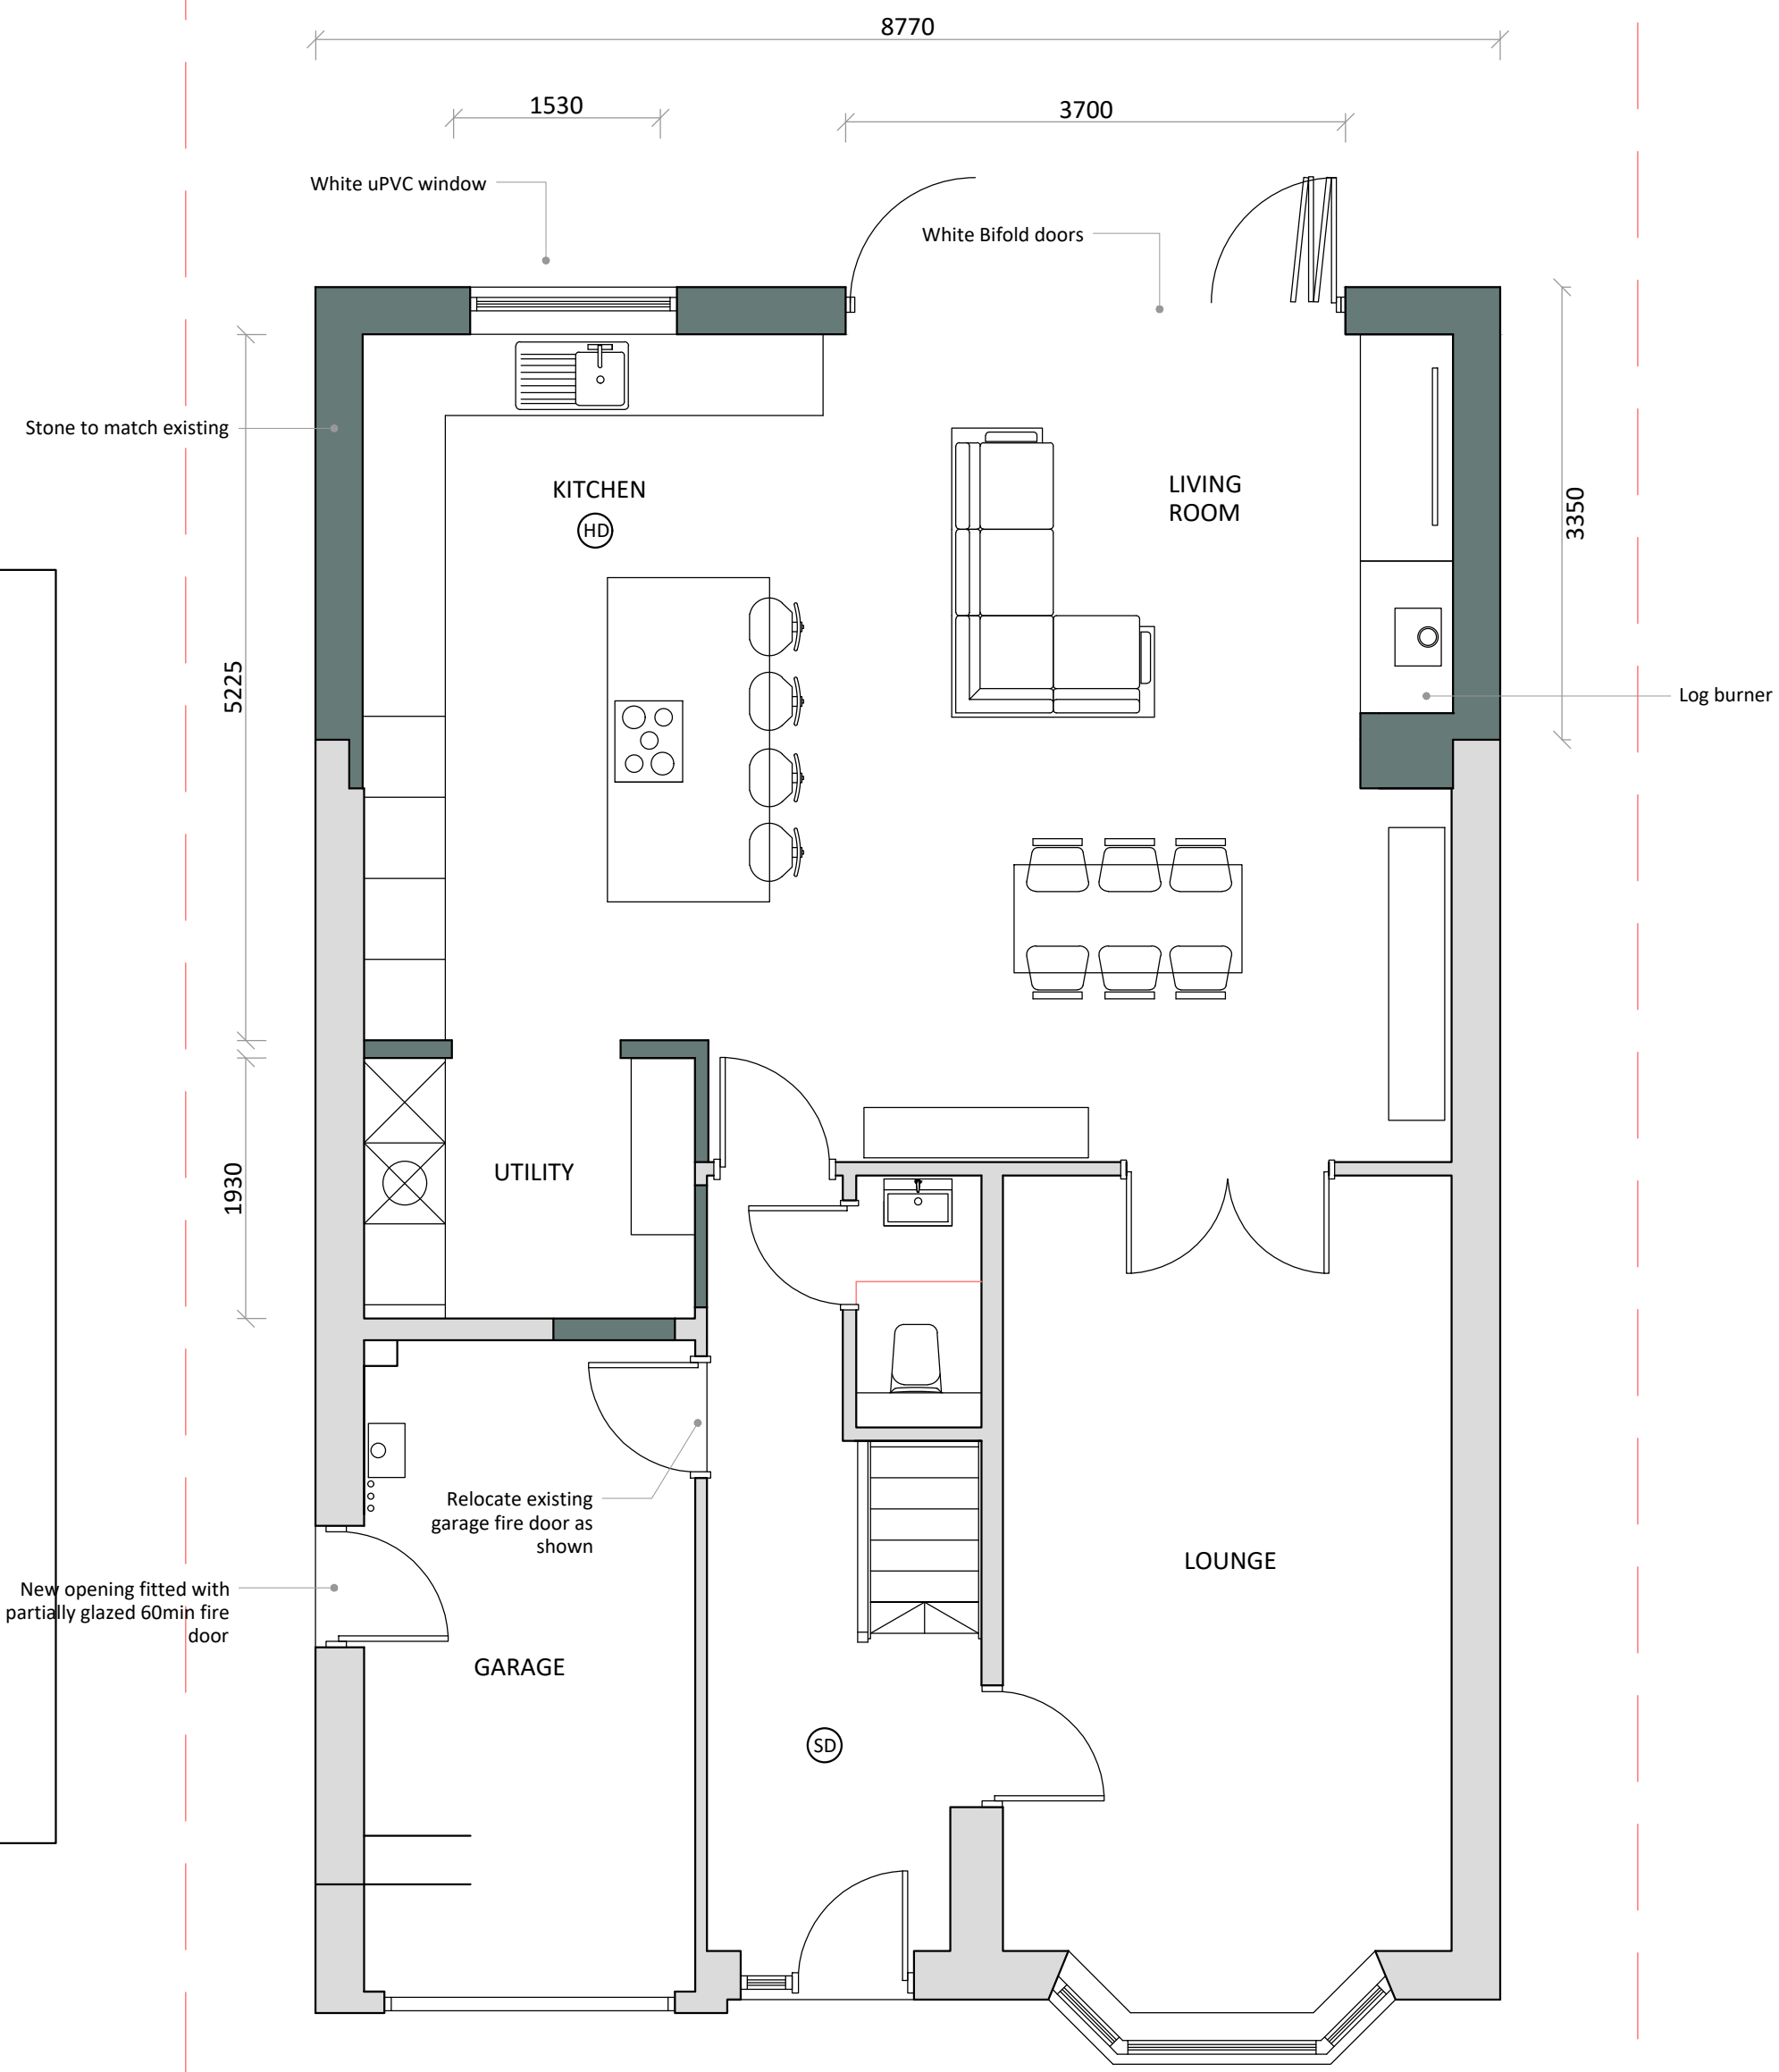

ROOF CONSTRUCTION PLAN

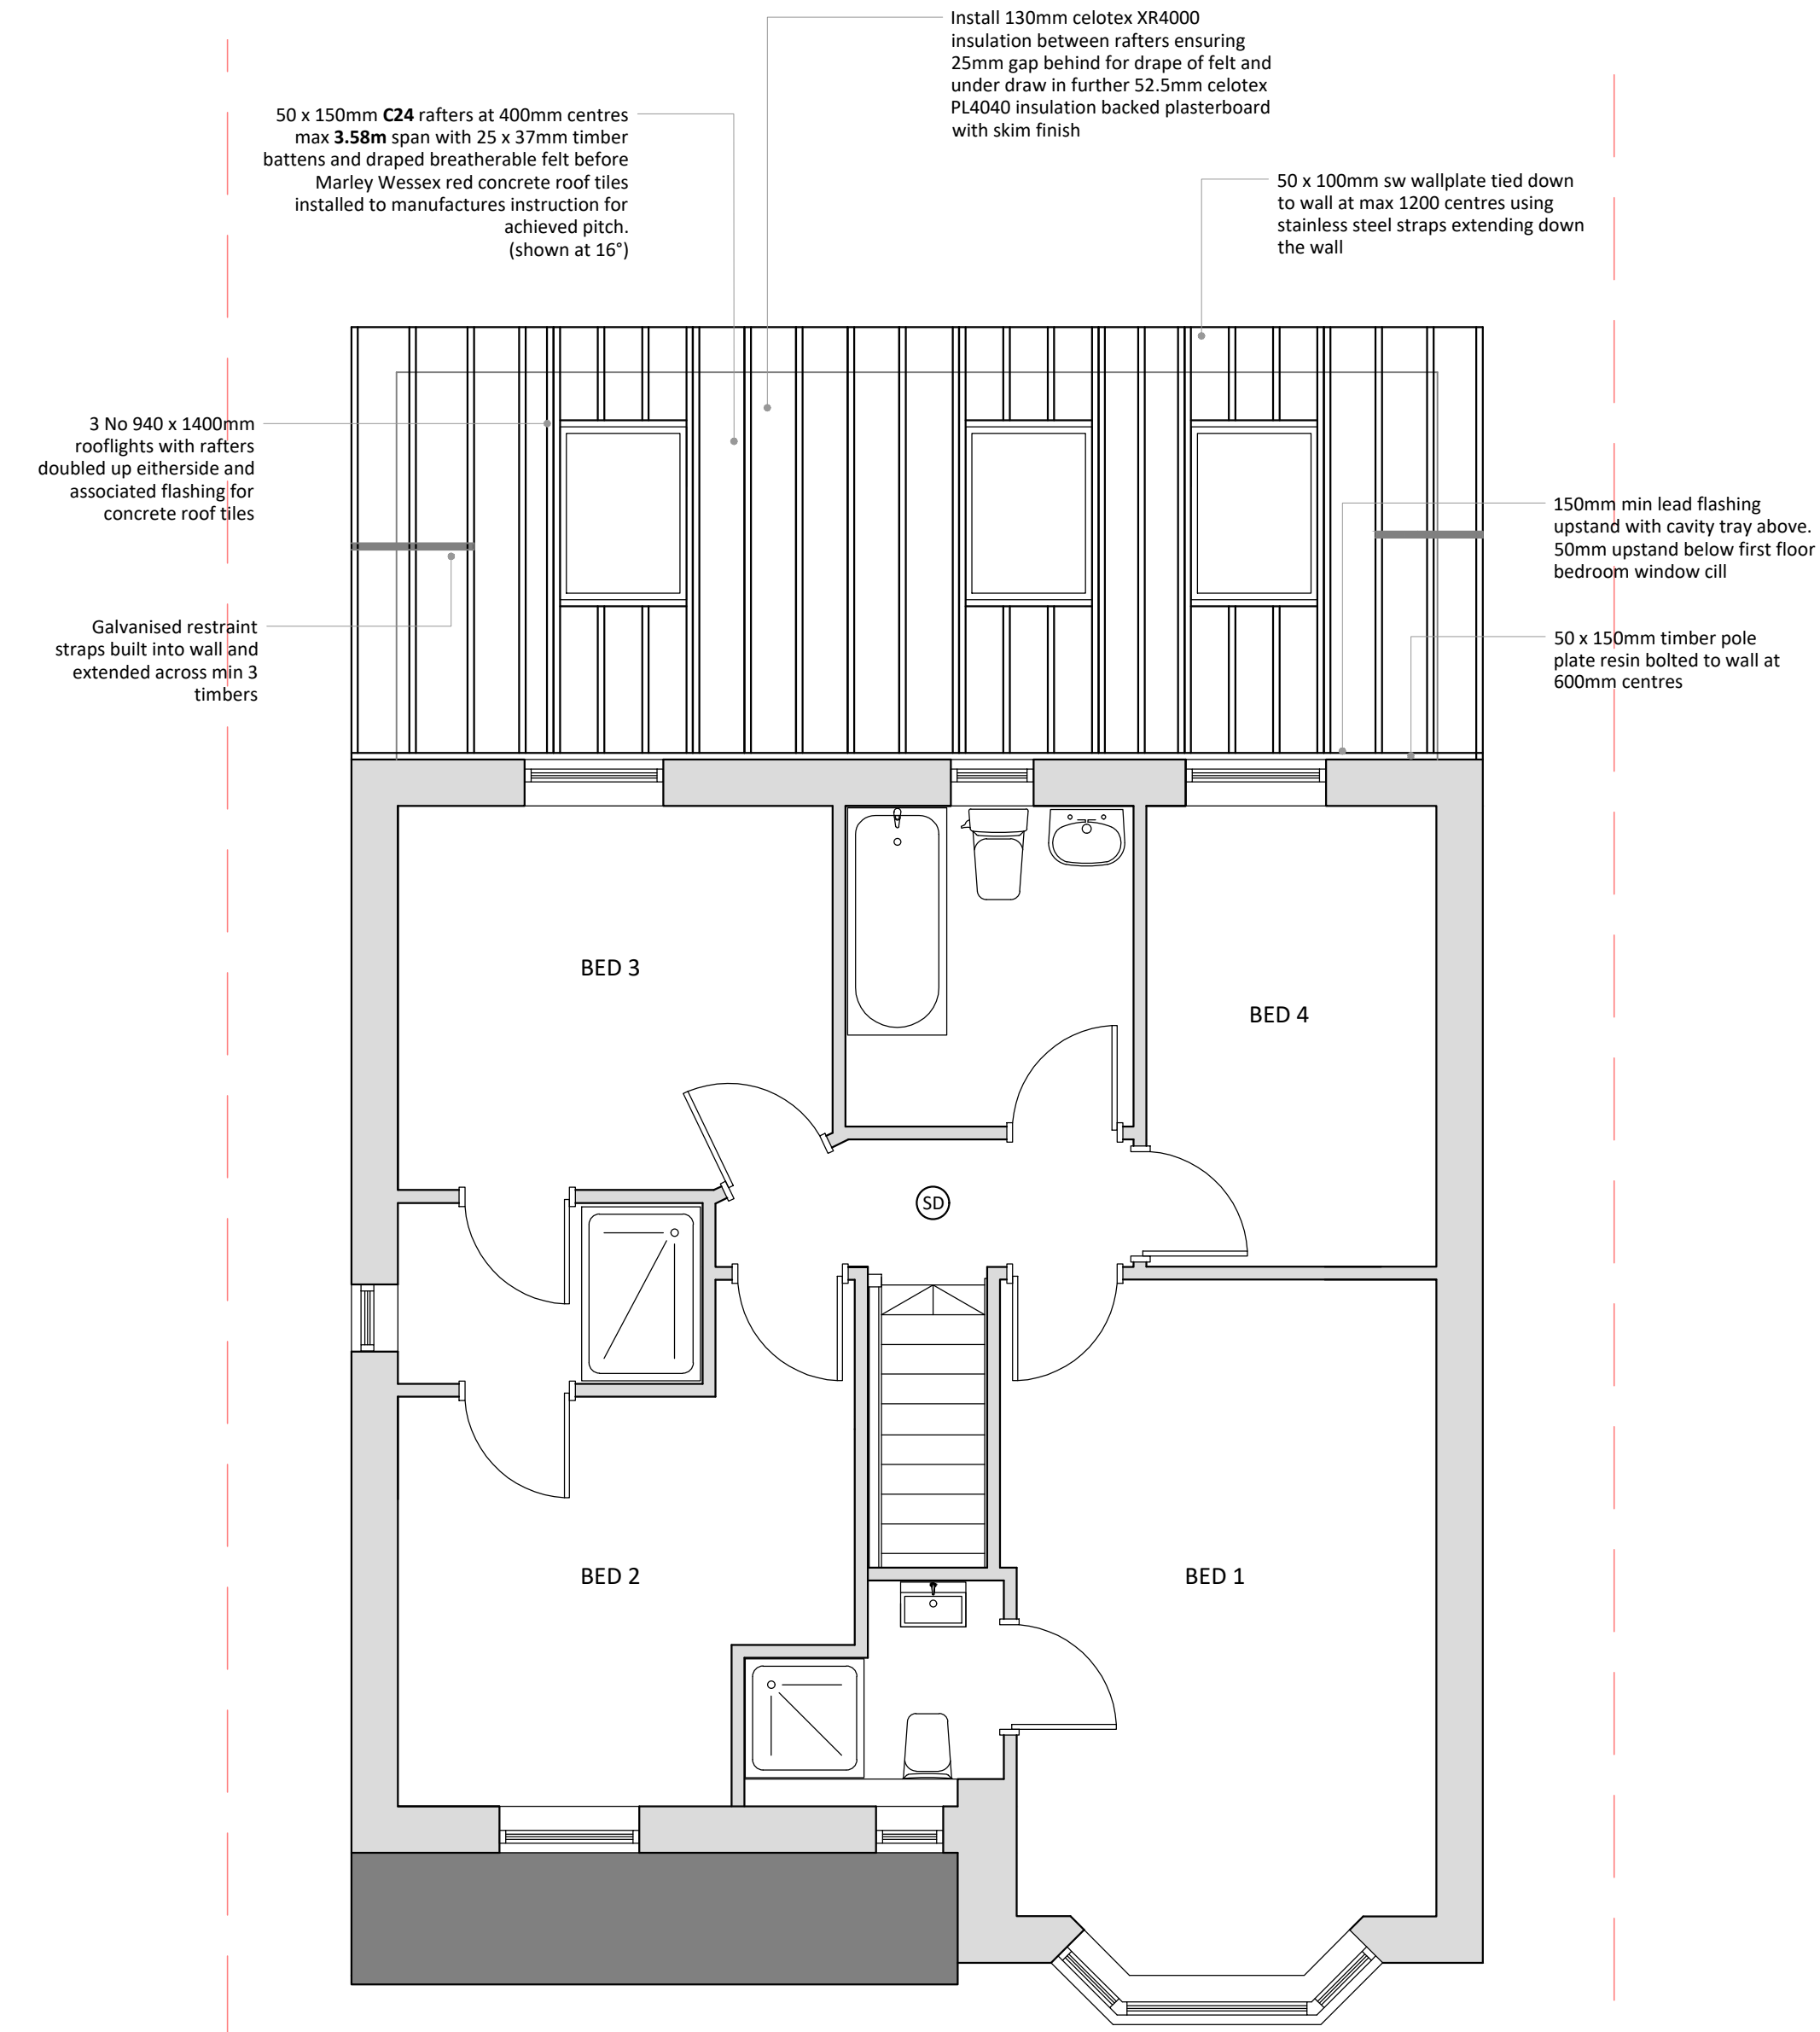

PARTIAL FILL CAVITY WALL
To achieve minimum U Value of 0.18 W/m²K
Provide 103mm suitable facing brick. Ensure a 50mm clear residual cavity and provide 100mm Celotex CW4000 insulation fixed to internal leaf. Inner leaf constructed using 100mm, 0.45 W/m²K standard block. Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1:6 cement mortar.

DPC
Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins, DPC to be placed a minimum 150mm above external ground level. New DPC to be made continuous with existing DPC's and with floor DPM. Vertical DPC to be installed at all reveals where cavity is closed.

WALL TIES
All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS EN 845-1:2013. Wall ties for cavities over 150mm to be suitable for cavity width, and installed as manufacturer's details.

CAVITIES
Provide cavity trays over openings and where roofs abut walls. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

EXISTING TO NEW WALL
Cavities in new wall to be made continuous with existing, where possible, to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

UNVENTED PITCHED ROOF
Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)
To achieve U-value 0.15 W/m²K
Timber roof structures to be designed by an Engineer in accordance with NHBC Technical Requirement RS Structural Design. Calculations to be based on BS EN 1995-1-1:2004 Eurocode 5: Design of timber structures (+A2:2014). Roofing tiles to match existing on 25 x 38mm tanalised sw treated battens on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 150mm grade C24 rafters at max 400mm centres, max span 3.47m. Rafters supported on 100 x 50mm treated sw wall plates. Allow min 20mm air space to allow for drape of breathable felt.
Insulation to be 130mm Celotex XR4000 between rafters and 50mm GA4000 under. Fix 12.5mm plasterboard (joints staggered) over VCL. Finish with 3mm skim coat of finishing plaster to the underside of all ceilings. Provide cavity tray where roof meets existing wall.
Restraint strapping - Ceiling joists tied to rafters (if raised collar roof consult Structural Engineer). 100mm x 50mm wall plate strapped down to walls. Ceiling joists and rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1200 x 30 x 5mm galvanized straps or other approved to BS EN 845-1 (+A1:2016) at 2m centres.

LEAD WORK AND FLASHINGS
All lead flashings, any valleys or soakers to be Code 5 lead and laid in accordance with BS 5534 and BS EN 12588. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc.

INTERNAL STUD PARTITIONS
100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm c/cs. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (e.g.100mm Rockwool or Isovol mineral fibre sound insulation) in all voids the full depth of the stud. Partitions to be built off doubled up joists where partitions run parallel or provide noggins where at right angles, or to be built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plasterboard with skim plaster finish. Plasterboard to be taped and jointed complete with beads and stops.


HEATING
Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.
The energy performance of the new components to be assessed. The results should be recorded and given to the building owner.
All accessible pipes to be insulated to the standards in Table 4.4 Approved Document L.

ELECTRICAL
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a Competent Person registered under a Competent Person Self Certification Scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.


INTERNAL LIGHTING
Install low energy light fittings that only take lamps having a luminous efficiency better than 80 lumens per circuit watt. All fixed to have lighting capacity (lm) 185 x total floor area, to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

EXISTING PLANS 1:100


GROUND FLOOR

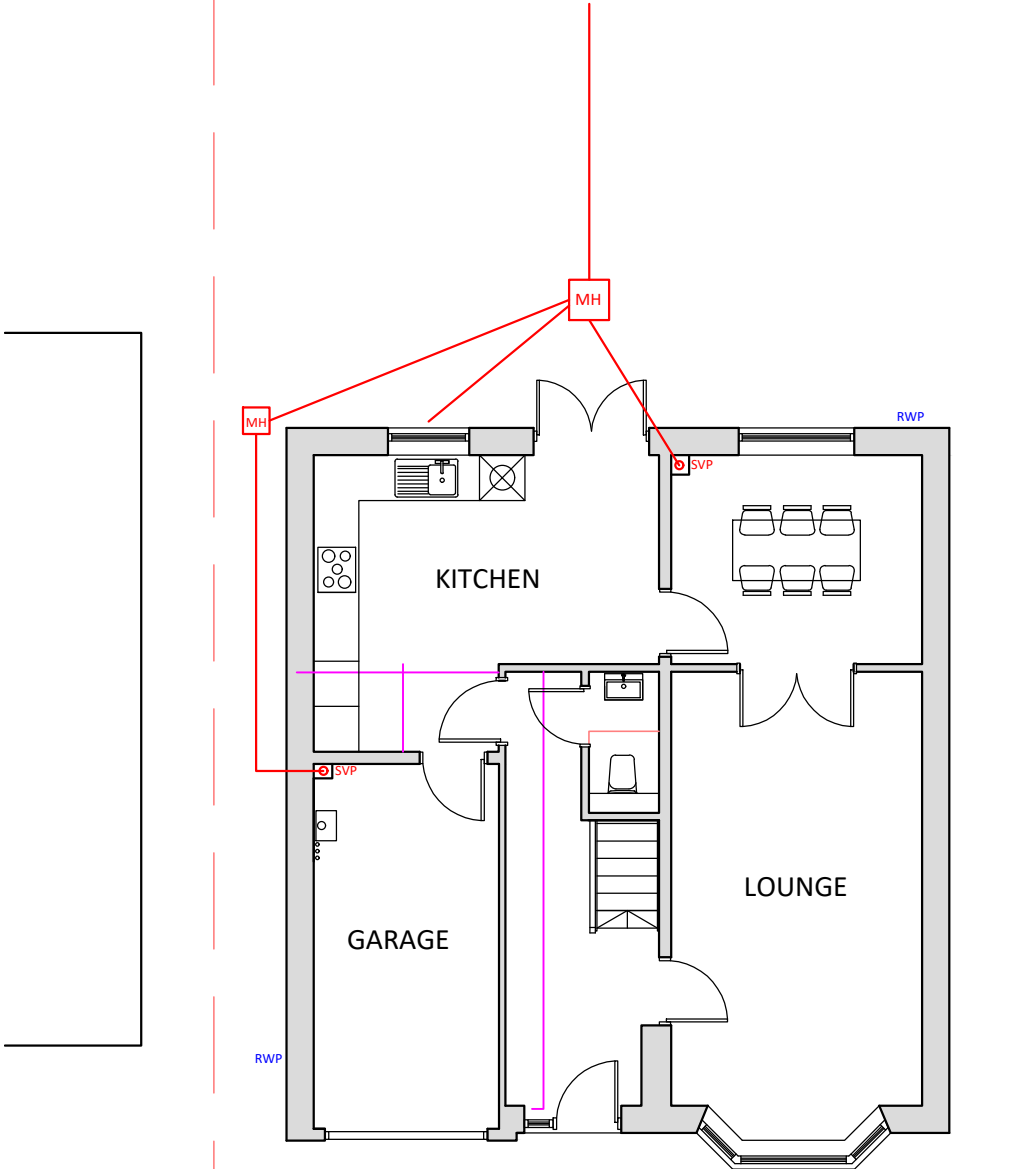

FIRST FLOOR


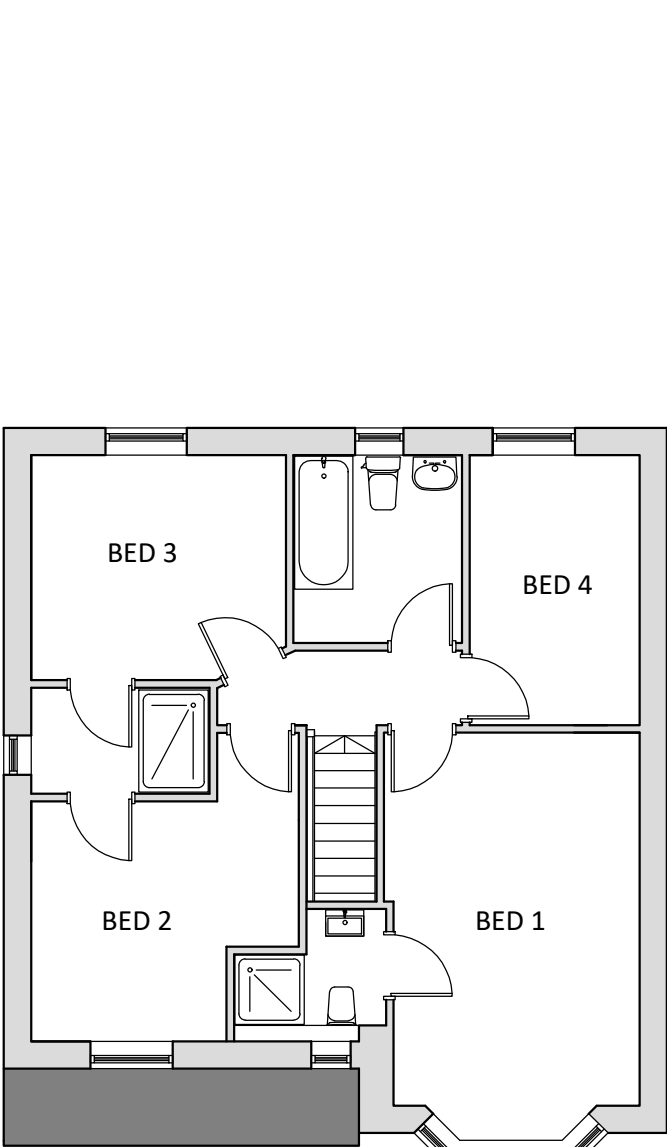


ROOF PLAN

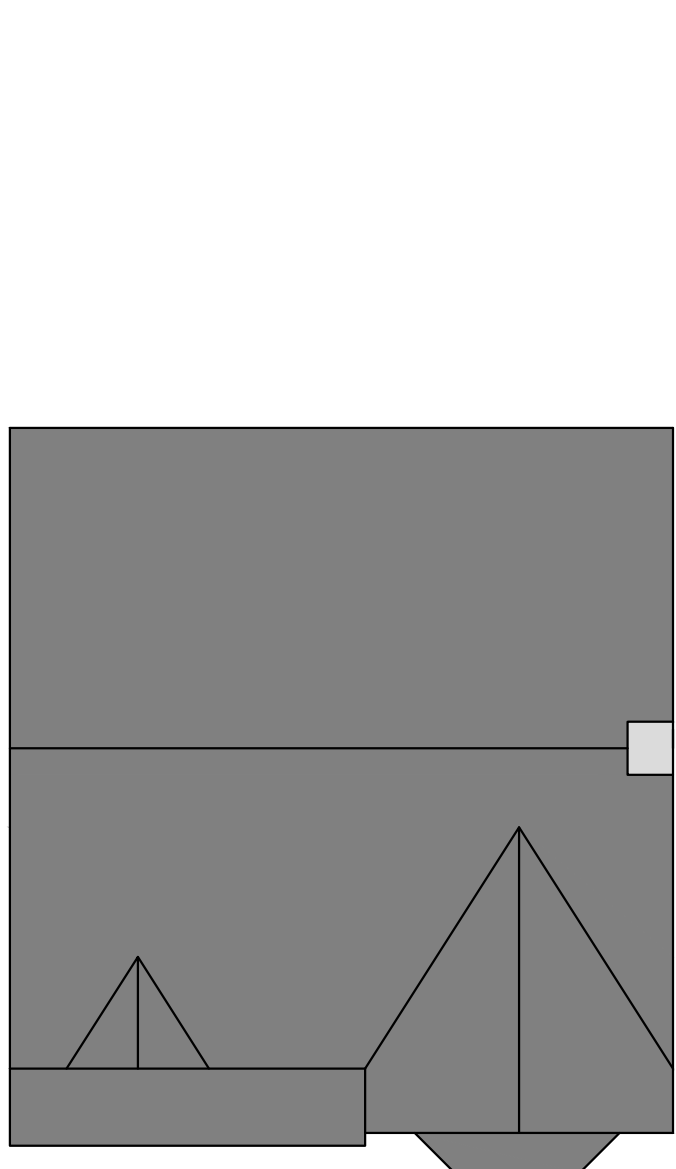

PROPOSED PLANS 1:100

ROOF PLAN

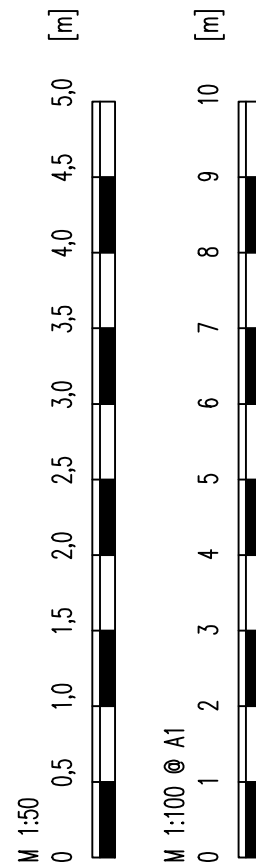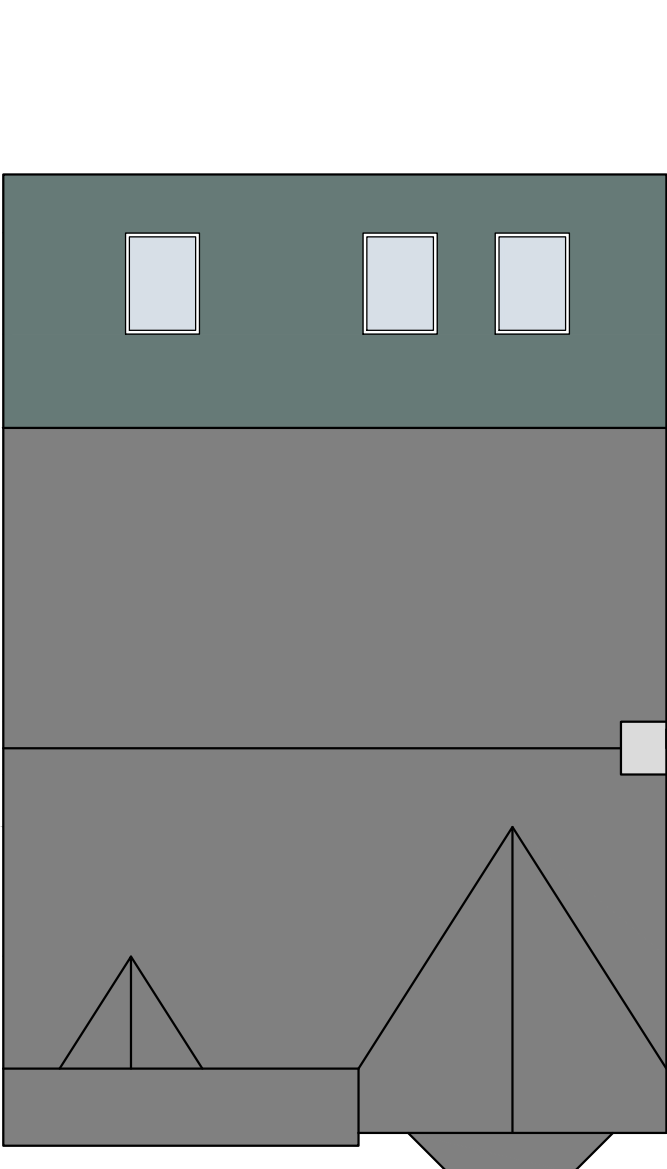

BUILDING REGULATION DRAWINGS

16 Eley Way
Chapel en le Frith
High Peak
SK23 0UH

Single Storey Rear Extension

Revision	Date
A - Following client meeting	10/09/25

Drawing Ref	Date
16EW/BR/02/A	August 2025

PLANS ARE TO BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEERS DETAILS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL MEASUREMENTS ON SITE PRIOR TO WORK COMMENCING. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL ASPECTS OF THE PARTY WALL ETC ACT 1996 ARE MET. PLEASE CONTACT PLAN DRAWER IF ANY ON SITE AMENDMENTS ARE TO BE MADE.

PLANS + DESIGN
Architectural Drawing

18 Eccles Road
Chapel en le Frith
High Peak
SK23 9RG

07912 845 210
info@plansanddesign.co.uk