


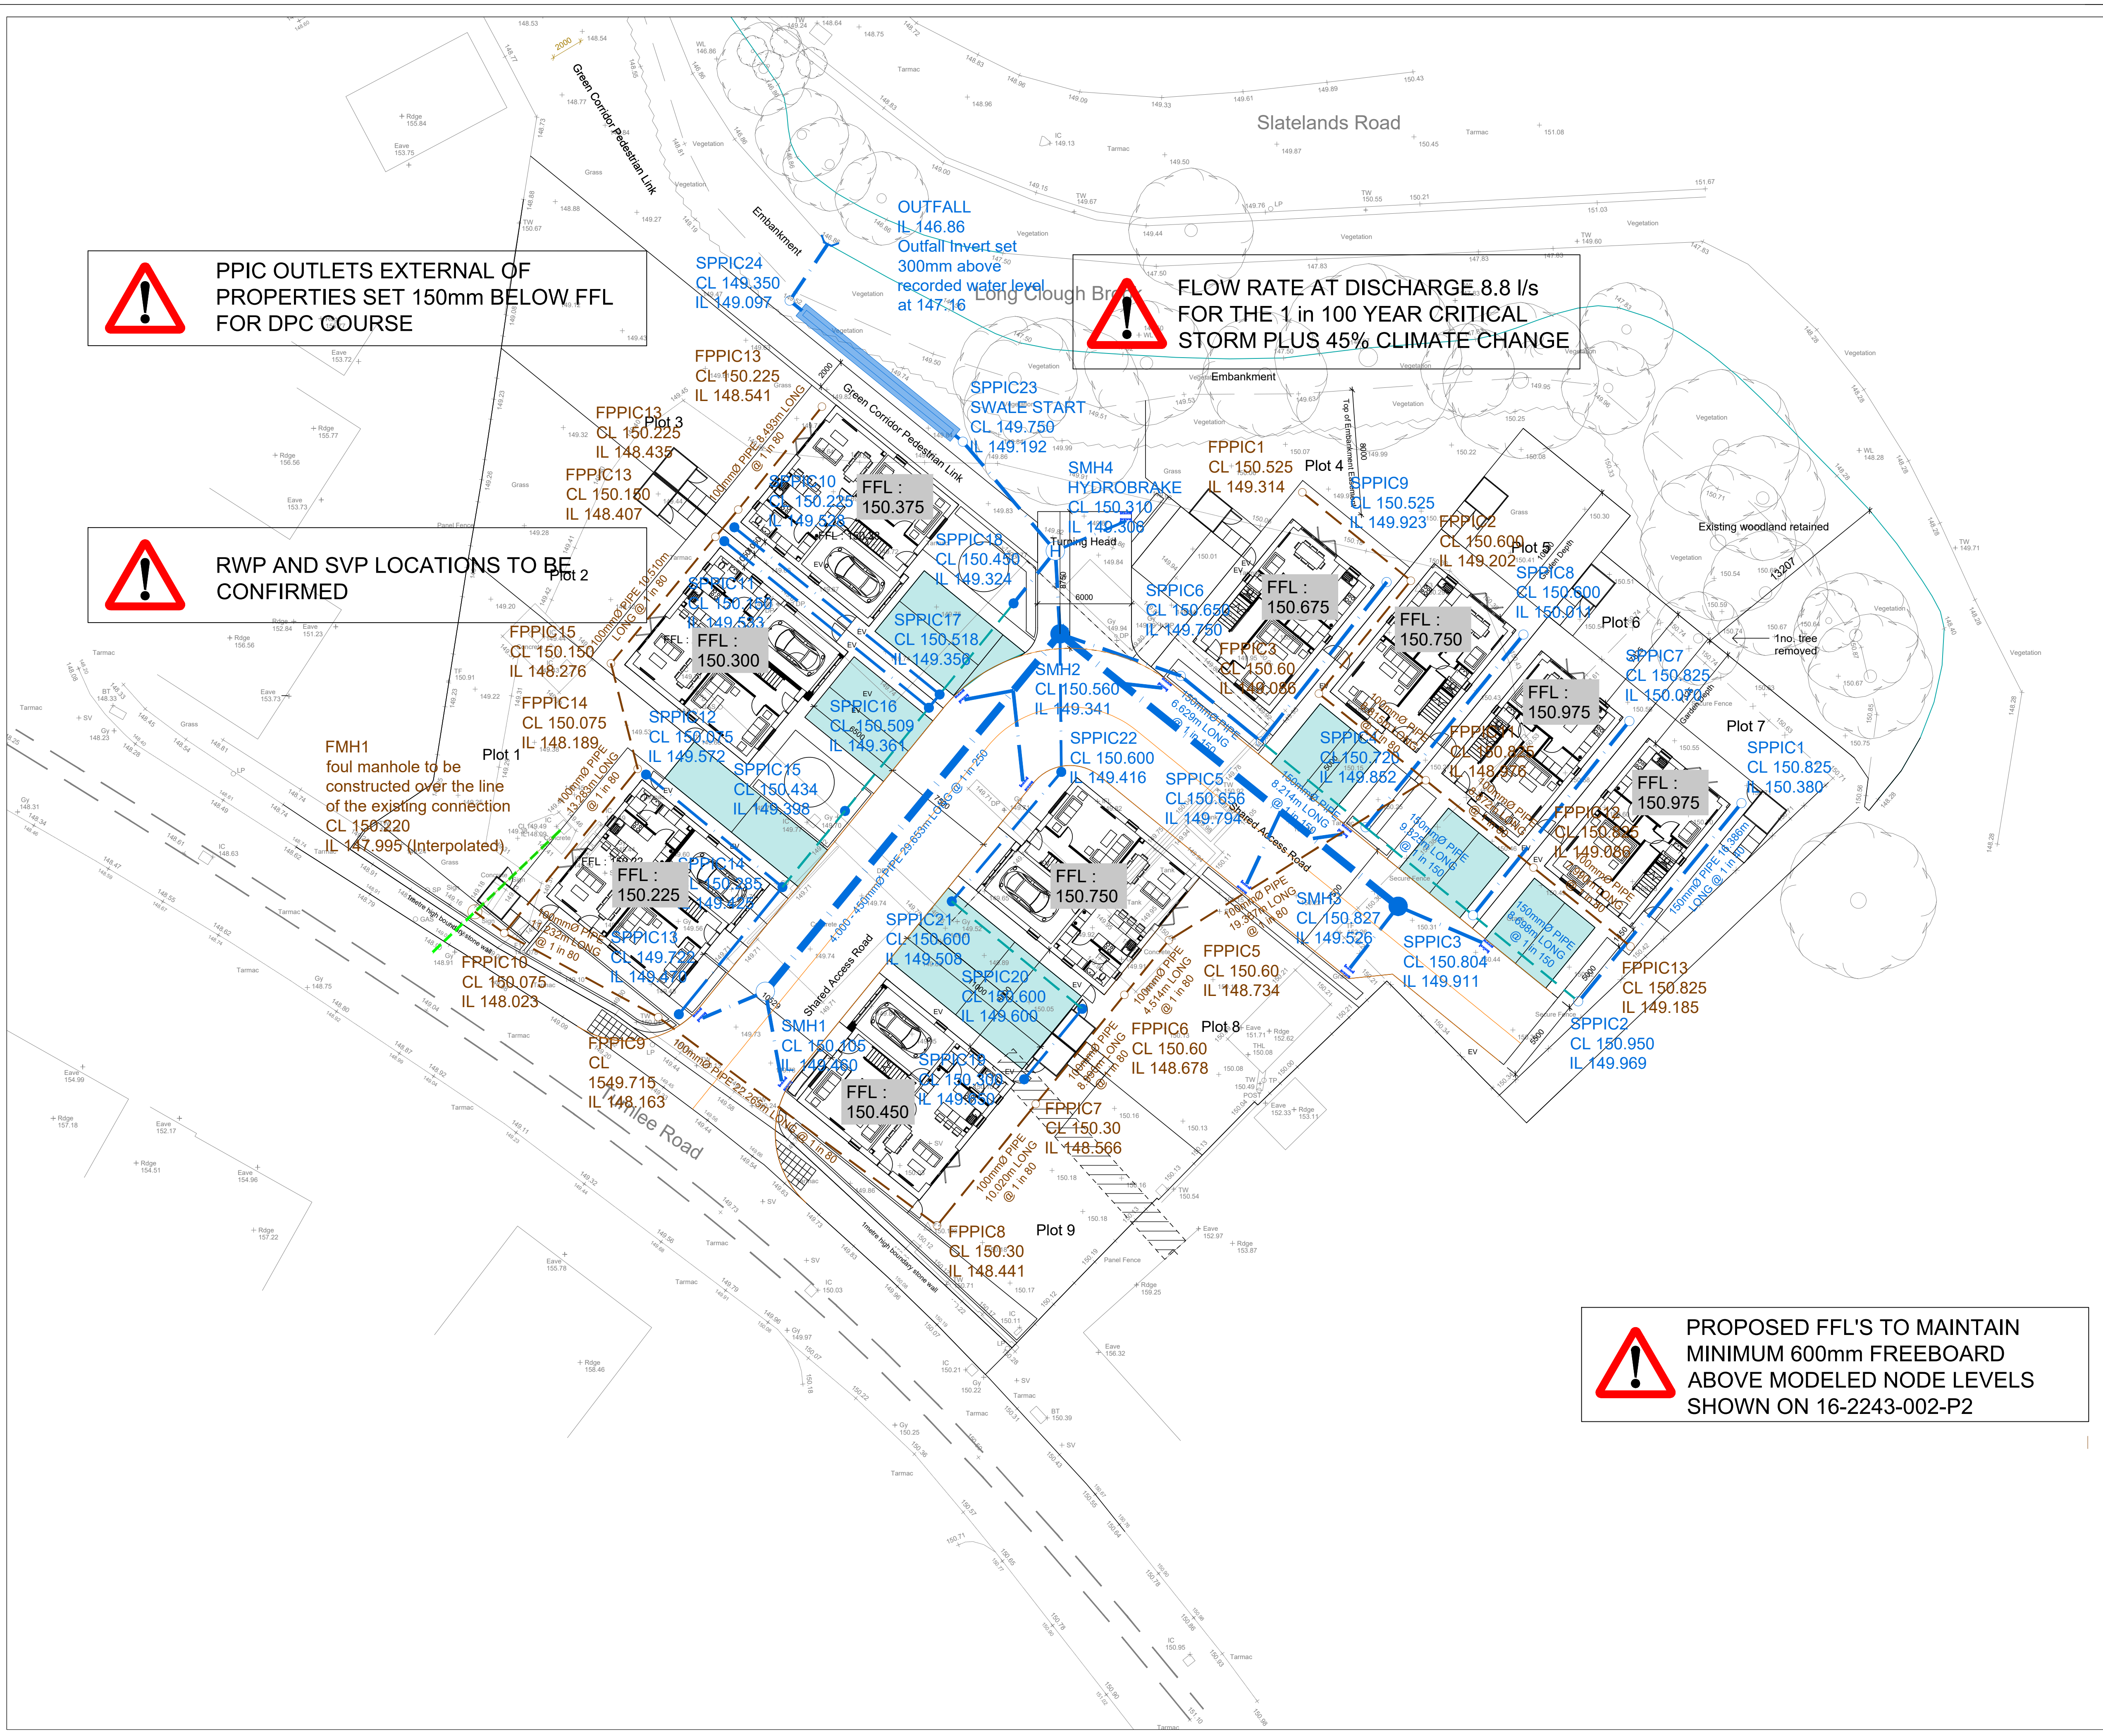

 PPIC OUTLETS EXTERNAL OF PROPERTIES SET 150mm BELOW FFL FOR DPC COURSE

 RWP AND SVP LOCATIONS TO BE CONFIRMED

 FLOW RATE AT DISCHARGE 8.8 l/s FOR THE 1 in 100 YEAR CRITICAL STORM PLUS 45% CLIMATE CHANGE

 PROPOSED FFL'S TO MAINTAIN MINIMUM 600mm FREEBOARD ABOVE MODELED NODE LEVELS SHOWN ON 16-2243-002-P2

- KEY**
- PROPOSED 150mmØ SURFACE WATER SEWER
 - PROPOSED 100mmØ FOUL WATER SEWER
 - LINE OF EXISTING FOUL NETWORK
 - PROPOSED PERFORATED PIPE WRAPPED IN PERMEABLE MEMBRANE
 - NEW FOUL WATER INSPECTION CHAMBER 300mm DIAMETER
 - NEW SURFACE WATER CATCHPIT INSPECTION CHAMBER 600mm DIAMETER
 - NEW FOUL WATER INSPECTION CHAMBER 300mm DIAMETER
 - NEW SURFACE WATER CATCHPIT INSPECTION CHAMBER 600mm DIAMETER
 - PROPOSED AREAS OF PERMEABLE SURFACING
 - PROPOSED OPEN SWALE

P5	Jan 26	UPDATED FFL'S ADDED	GRE
P4	Sep 25	SITE LAYOUT UPDATED	GRE
P3	Dec 24	ANNOTATION ADDED	GRE
P2	Nov 24	ANNOTATION ADDED	GRE
P1	Apr 24	FIRST ISSUE	GRE
Rev	Date	Revision Details	By ChkdAppd



Cora

Client
CAPRICE CONSTRUCTION LIMITED

Project
FORMER RELIANCE GARAGE ,
TURNLEE ROAD, GLOSSOP

Title
PROPOSED DRAINAGE ARRANGEMENT
SHEET 1 of 2

Drawing No. 16-2243-001	Revision P5
Scale 1:200 @ A1	Date April 2024
Drawn GRE	Chk App